

PARTITION TYPES

Diagram illustrating a cross-section of a suspended ceiling assembly, showing the connection between a partition wall and the ceiling structure.

Labels and Dimensions:

- FLOOR / ROOF DECK
- 24"
- VARIABLES
- 24"
- SEE PLAN
- 2X4 STUD BRACING AT 4'-0" OC - ALTERNATE DIRECTION / SIDE
- 3 1/2" SOUND ATTENUATION BLANKET, EXTEND 24" ON EITHER SIDE OF PARTITION
- SUSPENDED ACOUSTICAL CEILING TILE OR GWB SEE REFLECTED CEILING PLAN
- DOUBLE 2X TOP PLATE, LAP CORNERS
- 5/8" GWB TYPICAL EACH SIDE, AT WET LOCATIONS PROVIDE MOISTURE RESISTANT GWB
- 2X STUDS AT 16" OC

31. OVERLAPPING/

ROOF - USE 2" MIN. Gypsum Board
 AT CONCRETE FLOOR SLAB
 CONCRETE FLOOR SLAB

CEILING HEIGHT SOUND PARTITION

STC RATING: 50

3
 A-0.1

PARTITION SECTION

SCALE: 1" = 1'-0"

7 1/4" @ 2X6
5 1/4" @ 2X4

FIRE CAULK (INSIDES)

FLOOR / ROOF

2X4 TOP PLATE
2X6 TOP PLATE

5 1/2" OR 3 1/2" FOIL FACED

Diagram illustrating the construction of a suspended ceiling assembly. The components shown from top to bottom are:

- BATT INSULATION
- SUSPENDED ACCOUSTICAL CEILING TILE OR GWB SEE REFLECTED CEILING PLAN
- 5/8" FIRECODE C CORE GWB, TYPICAL AT WET LOCATIONS

Diagram illustrating the exterior wall assembly components:

- PROVIDE MOISTURE RESISTANT
- 5/8" CDX RATED EXTERIOR PLYWOOD SHEATHING
- BUILDING WRAP "WRB"
- EXTERIOR FINISH


SEE ELEVATIONS
 2X4 OR 2X6 STUDS AT 16" OC
 SEE PLAN
 SILL FLASHING
 & TERMITE SHIELD
 2X4 OR 2X6 PLATE SET IN FIRE

ONE HOUR FIRE RATED EXTERIOR WALL
UL DESIGN NUMBER: U - 3 5 6 - EXT. WALL CONSTRUCTION

6 PARTITION SECTION
A-01 SCALE: 1" = 1'-0"

PARTITION NOTE:
REFER TO FLOOR PLANS FOR 2X4 AND 2X6 WALL LOCATIONS.
USE THE APPROPRIATE WALL TYPE AS INDICATED.

WILLINGSLEY BUILDINGS 1&2

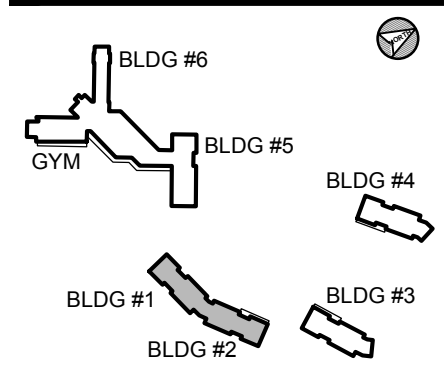

- ☐ Alteration
- ☒ Remodel
- ☒ New Addition
- ☐ New Construction

- ☐ Design Phase
- ☐ Not For Construction
- ☐ For Pricing
- ☐ For Permit
- ☒ Revision
- ☒ For Construction

No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title: AS NOTED

Code Chapter	NFPA 101 - 2015 Required	IBC 2015 Required	Provided	Comment
Use Group/Occupancy	Chapter 32 - New Residential Board and Care Occupancies - Large Facility	I-1 (308.3) In-Patient Areas Condition 1	I-1, Condition 1 Residential Board & Care - Large Facility	Buildings used for Drug and Alcohol Treatment Centers, Occupants are capable of responding to emergency situation with-out physical assistance from staff.
Special requirements based on use & occupancy I-1		Separation Walls - between sleeping units and corridor walls are to be fire partitions in accordance to 708	Yes	
		Horizontal separation in accordance with 712		
General building heights and areas				
Existing / New Building Area and Height				
Building 1 & 2 - First Floor	V (111) / 2 Stories	31,500 SF / 3 Stories	11,927 SF	I - 1 Use, V-B Construction
Building 1 & 2 - Second Floor	V(111) / 2 Stories		11,927 SF	I - 1 Use, V-B Construction
Total Building Square Footage		[13,500 + (4,500 x 0.5)] x 2 = 31,500 SF	23,854 SF	
Incidental accessory occupancy		See (Table 509)	Fire Rated Per	
Construction Type	V (111) (Table 32.3.1.3)	5 B (Table 506.2)	V (111) (Table A.8.2.1.2)	
Primary Structure	1 Hr	0 Hr	1 Hr	
Bearing walls interior or exterior	1 Hr	0 Hr	1 Hr	
Non bearing walls exterior	0 Hr	0 Hr (Table 602), >10 feet	0 Hr	
Non bearing walls and partitions interior	0 Hr	0 Hr	0 Hr	
Floor Construction and Secondary Members	1 Hr	0 Hr	1 Hr	
Roof Construction and Secondary Members	1 Hr	0 Hr	1Hr	
Fire Partitions / Barriers	1 Hr	1 hr 709.3	1 Hr	I-1 In-Patient Areas
Flame Spread Index		<25	<25	
Fire and smoke protection				
Fire Door - 1 hr Fire Rated Wall	3/4 Hr	1 hr	1 Hr	
Fire Door - 1 hr Fire Rated Corridor Wall	1/3 Hr	1/3 hr	1/3 Hr	Corridor Walls
Interior finishes				
Exit Enclosures and Passage Ways	Class A / Floor - Class II	Class B (Table 803.11)	Class A	
Corridors	Class B / Floor - Class I or II	Class C (Table 803.11)	Class B	
Rooms and Enclosed spaces	Class B / Floor - Class I or II	Class C (Table 803.11)	Class B	
Contents and Furnishings	Section 10.3 (10.3.1 thru 10.3.9.2)		Provided per NFPA (10.3)	
Fire protection systems				
Sprinkler System	Required (32.2.3.5.3) - NFPA 13	Required (903.2.6) - NFPA 13R	Provide per NFPA 13	
Portable fire extinguishers	Required (9.9)	Required (906.1)	Provide per NFPA 101 Sec 9.9	
Fire Alarm & Detection system	Required (9.6) & (32.3.3.4)	Required (907.2.6.1 & 907.2.6.2)	Provide per NFPA 101 Sec 9.6 & 32.3.3.4	
Means of egress				
Design Occupant Load - Building 1 & 2 First Floor	073 Occupants	073 Occupants	See Occupant Tables	
Design Occupant Load - Building 1 & 2 Second Floor	071 Occupants	071 Occupants		
Egress Width - Building 1 & 2 First Floor	Other Components: 73 x .20" = 14.6" Min	Other Components: 73 x .20" = 14.6" Min	306" Provided	
Egress Width - Building 1 & 2 Second Floor	Stairs: 71 x .40" = 28.4" Other Components: 71 x .20" = 14.2" Min	Other Components: 71 x .20" = 14.2" Min	102" Provided	
Corridor wall rating	1/2 Hr (32.3.3.6.3)	1/2 Hr (711.2.4.3 Exception 1)	1/2 Hr	
Maximum Exit Travel Distance	200', Sprinklers Provided	250', Sprinklers Provided (Table 1017.2)	<200'	
Means of egress illumination	1 FC Min Typical / 10 FC Stairs	Required 24 hrs./ day, 1 FC Min	Provide per NFPA (7.8.1.3)	Illumination required during power failure
Special locking arrangements	Permitted (7.2.1.6.1.1)	Permitted (1010.1.9.7(1) thru (8)	Provide per NFPA (7.2.1.6.1.1)	Delayed-Egress Locking Systems
Exit signs	Located / Lighted per 7.10	Located per section 1013		
Exit through intervening spaces	Allowed through accessory spaces, but must provide a discernable path of egress travel through that space.	Allowed through accessory spaces, but must provide a discernable path of egress travel through that space.		

3 2015 NFPA AND IBC 2015 CODE REQUIREMENTS - BUILDING 1 & 2 (CONSIDERED ONE BUILDING)

A-0.2 SCALE: NO SCALE

NOTE:
- SPRINKLER SHOP DRAWINGS AND FIRE ALARM SHOP DRAWINGS TO BE SUBMITTED TO THE FIRE MARSHALL
- FIRE ALARM DEVICES IN SLEEPING AREA SHALL PROVIDE LOW FREQUENCY SIGNAL IN ACCORDANCE WITH NFPA 72

BUILDING 1 & 2

FIRST FLOOR	11,927 SF
SECOND FLOOR	11,927 SF

WITHDRAWAL MANAGEMENT AREA 11,927 SF

FIRST FLOOR		
SLEEPING ROOM AREA	7,575 SF (18 RM - 2 OCC)	36 OCC
FIXTURE	REQUIRED	PROVIDED
PATIENT ROOMS		
18 ROOMS - 2 OCC / RM MAX	1 B.RM / 8 OCC	18 B.RM

SLEEPING AREA STAFF	4,352 SF AT 120 SF/OCC	37 OCC
FIXTURE	REQUIRED	PROVIDED
TOILET		
37 OCC / 1 WC PER 25 OCC	2 WC	2 WC
LAVATORIES		
37 OCC / 1 LAV PER 35 OCC	2 LAV	2 LAV
DRINKING FOUNTAIN	1 EWC	2 EWC
SERVICE SINK	1 SS	1 SS

RESIDENTIAL AREAS 11,927 SF

SECOND FLOOR		
SLEEPING ROOM AREA	7,575 SF (20 RM - 2 OCC)	40 OCC
FIXTURE	REQUIRED	PROVIDED
PATIENT ROOMS		
20 ROOMS - 2 OCC / RM MAX	1 B.RM / 8 OCC	20 B.RM

SLEEPING AREA STAFF	3,648 SF AT 120 SF/OCC	31 OCC
FIXTURE	REQUIRED	PROVIDED
TOILET		
31 OCC / 1 WC PER 25 OCC	2 WC	2 WC
LAVATORIES		
31 OCC / 1 LAV PER 35 OCC	1 LAV	2 LAV
DRINKING FOUNTAIN	1 EWC	2 EWC
SERVICE SINK	1 SS	1 SS

CODE OFFICIAL CONTACT

MARYLAND CODES ADMINISTRATION

ED LONDON
DIRECTOR OF CODE ADMINISTRATION
100 COMMUNITY PLACE
CROWNSVILLE, MD 21032
(410) 514-7444
london@mdhousing.org

STATE FIRE MARSHALL

WILLIAM E. BARDARD
1201 REGISTERSTOWN ROAD
PIKESVILLE, MD 21208
(410) 653-8980
SFM@mdsp.org

5 CODE OFFICIALS

A-0.2 SCALE: NO SCALE

CODES

ADOPTED CODES FOR USE IN THE STATE OF MARYLAND
CHARLES COUNTY - EFFECTIVE 3 AUG 2015

2015 INTERNATIONAL BUILDING CODE
CHARLES COUNTY BUILDING CODE
(COMAR 05.02.02) MARYLAND ACCESSIBLE CODE
GUIDELINES FOR BUILDINGS AND FACILITIES - 2012
2010 ADA STANDARDS FOR ACCESSIBLE DESIGN

2015 NFPA 101 LIFE SAFETY CODE
2015 NFPA 220 STANDARD ON TYPES OF BUILDING CONSTRUCTION
2015 INTERNATIONAL ENERGY CODE
2015 INTERNATIONAL EXISTING BUILDING CODE
2015 INTERNATIONAL MECHANICAL CODE
2015 INTERNATIONAL PLUMBING CODE
2015 INTERNATIONAL FUEL GAS CODE
2015 INTERNATIONAL FIRE CODE
2013 NFPA 13 - SPRINKLER SYSTEMS
2014 NATIONAL ELECTRIC CODE NFPA 70
2013 NFPA 72 - NATIONAL FIRE ALARM AND SIGNALING CODE

4 APPLICABLE CODES

A-0.2 SCALE: NO SCALE

BUILDING #1&2 SECTION 1107.5 GROUP I-1 ACCESSIBLE UNITS

THE SLEEPING UNITS (SU) ARE DESIGNED AS FOLLOWS:

- "FA" SLEEPING UNITS - CONDITION 1
4% OF THE SLEEPING UNITS WITH TOILETS
 - "FA" SLEEPING UNITS - CONDITION 2
10% OF THE SLEEPING UNITS WITH TOILETS
 - TYPE "B" SLEEPING UNITS
ALL REMAINING TO BE SLEEPING UNITS WITH TOILETS

4% "FA" - CONDITION 1	25 SU x 4% = 1	1 REQ'D	3 PROV'D
10% "FA" - CONDITION 2	10 SU x 10% = 1	1 REQ'D	1 PROV'D
TYPE "B" - ALL OTHERS		31 PROV'D	31 PROV'D


TOTAL - SLEEPING UNITS 35 TOTAL

6 DESIGN OCCUPANT LOAD AND REQUIRED PLUMBING FIXTURES

A-0.2 SCALE: NO SCALE


7 SLEEPING UNIT CALCULATIONS

A-0.2 SCALE: N/A

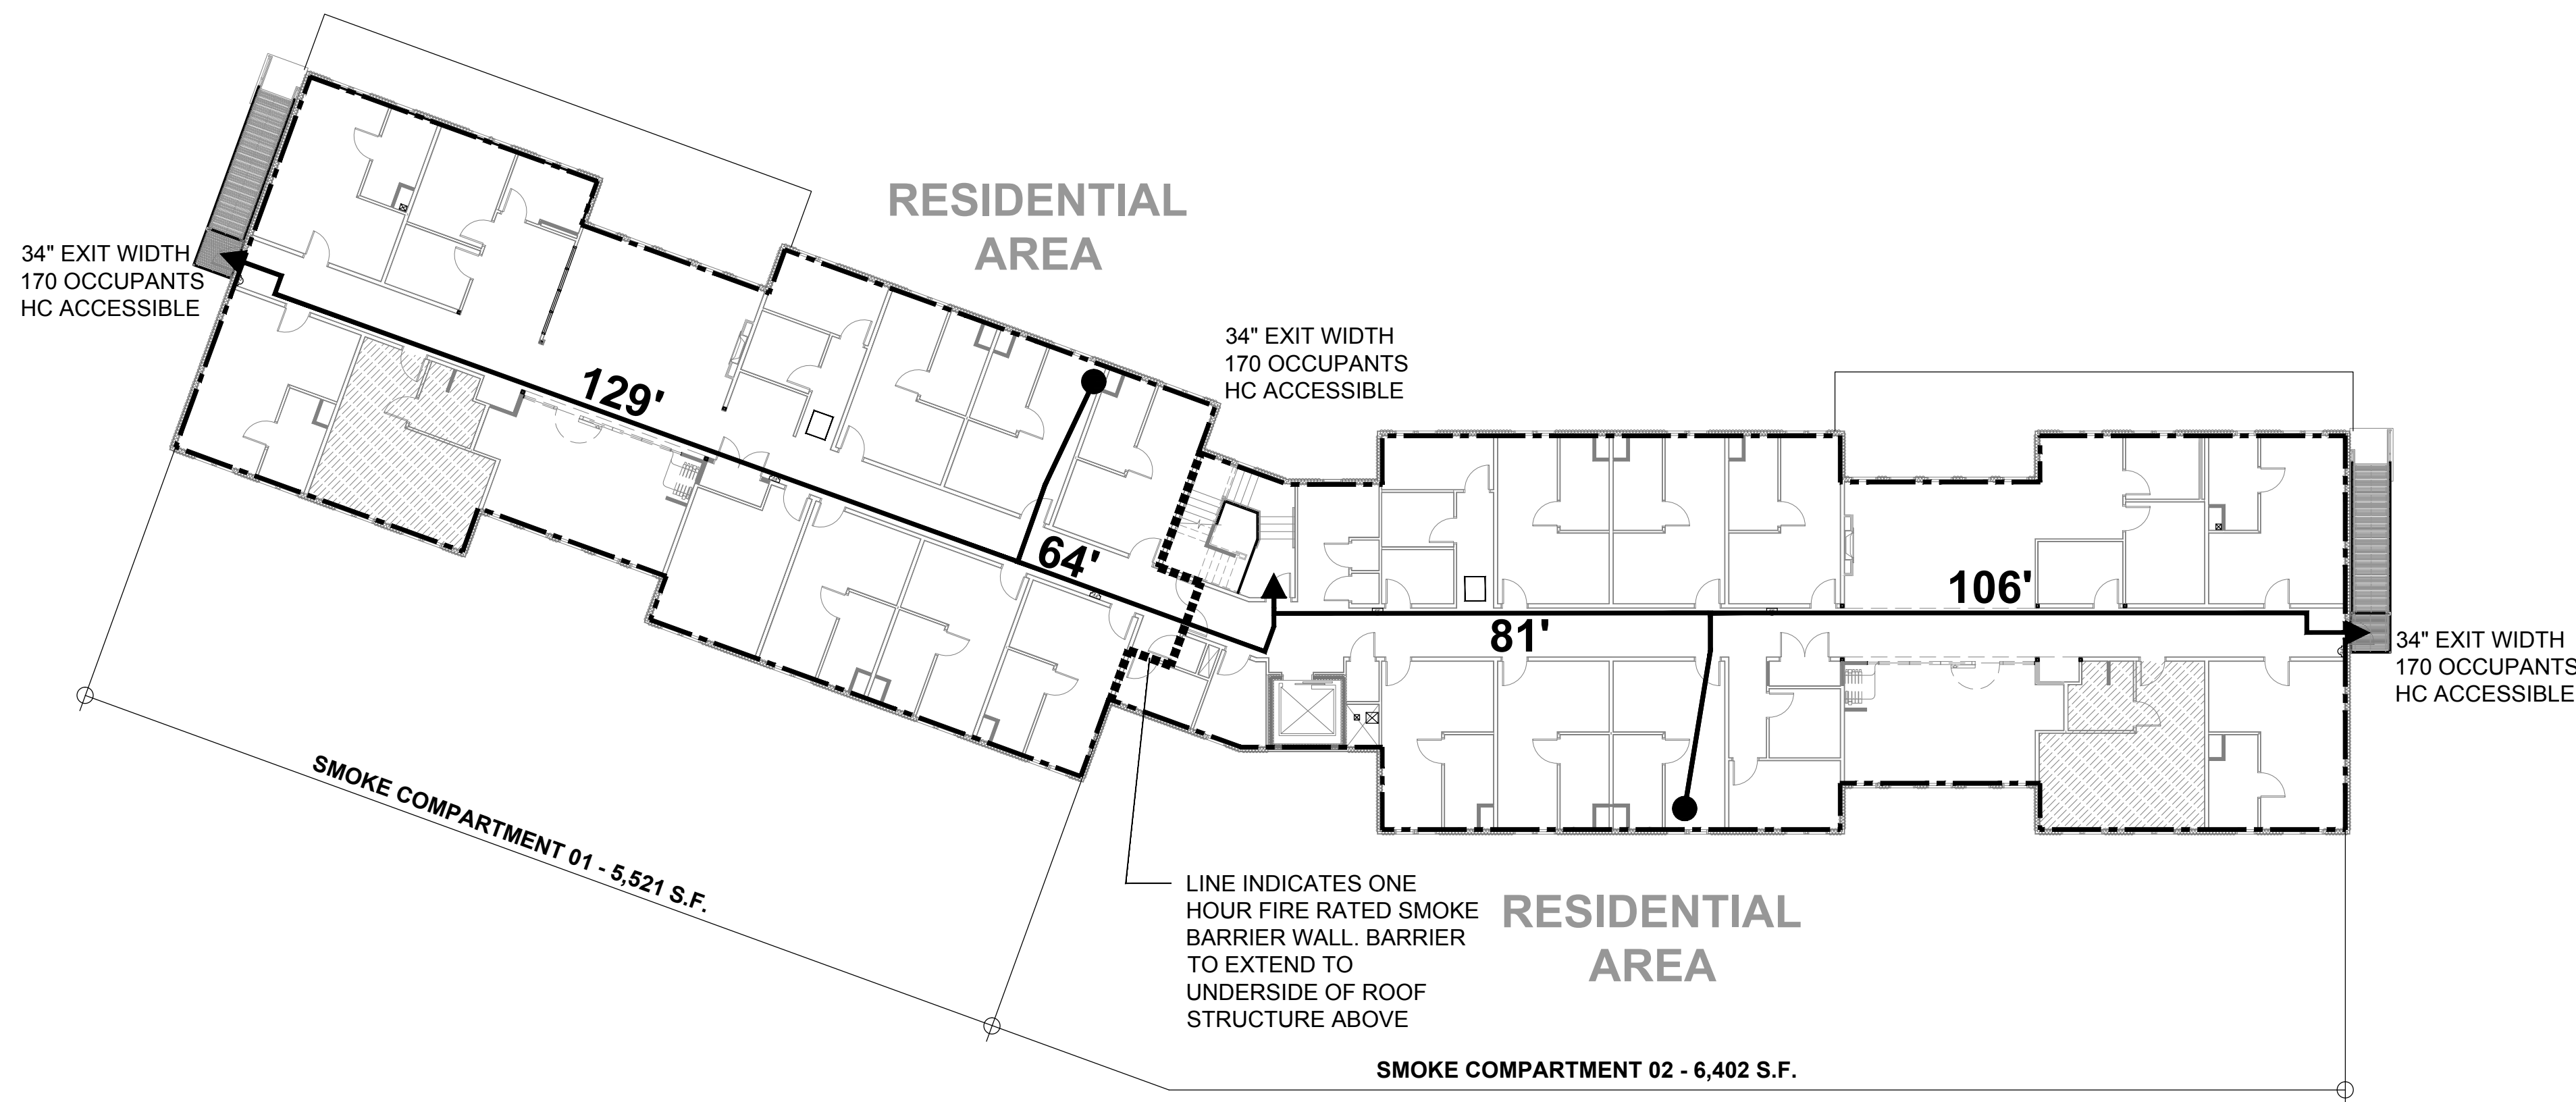

2 EGRESS PLAN - BUILDING ONE AND TWO (CONSIDERED ONE BUILDING) SECOND FLOOR

A-0.2 SCALE: 1/16" = 1'-0"

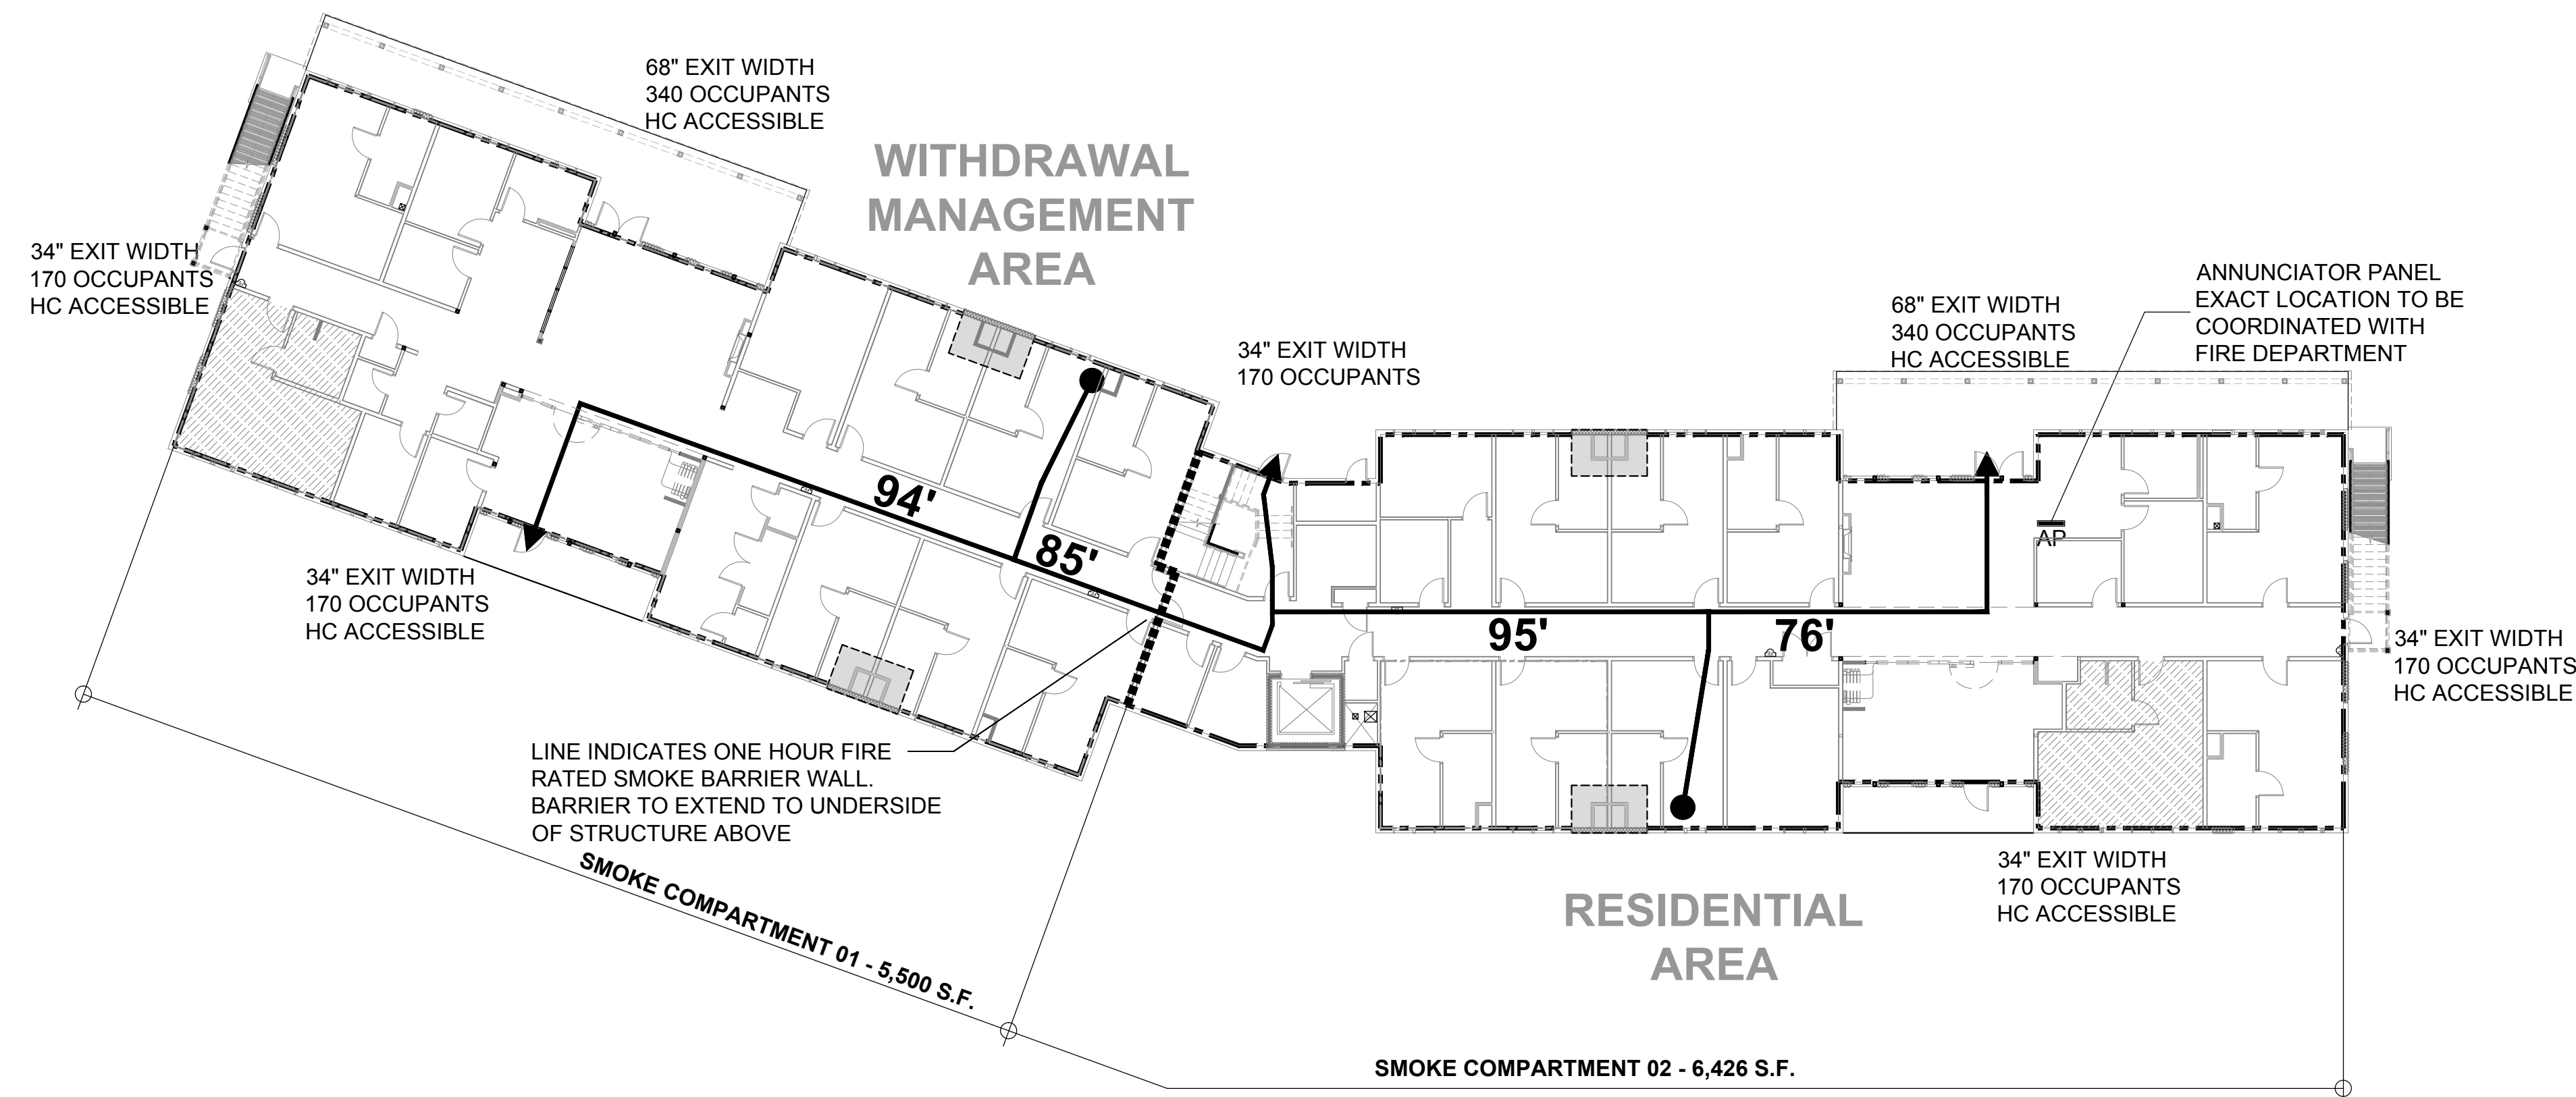

1 EGRESS PLAN - BUILDING ONE AND TWO (CONSIDERED ONE BUILDING) FIRST FLOOR

A-0.2 SCALE: 1/16" = 1'-0"

	FULLY RECESSED FIRE EXTINGUISHER CABINET FOR ONE 10# ABC FIRE EXTINGUISHER (MP SERIES); PROVIDE FIRE RATED CABINET AS REQUIRED.
	FULLY ACCESSIBLE PATIENT ROOM AND BATH
	NEW CONSTRUCTION
	INFILL IN PLACE CONCRETE SLAB @ HIGHER ELEVATION TO ALIGN WITH EXISTING CONCRETE FLOOR TO BE SMOOTH AND READY TO RECEIVE NEW FLOOR FINISH. SEE STRUCTURAL DRAWINGS

1. GC TO REMOVE EXISTING WALL AND ROOF SHEATHING AS REQUIRED. GC TO VERIFY THE CONDITION OF THE EXISTING FRAMING IS FREE OF: MOLD, DRY ROT, WATER DAMAGE, INSECT DAMAGE, STRUCTURAL DAMAGE, ETC. AND IS SUITABLE FOR INSTALLATION OF NEW WALL AND ROOF SHEATHING PRIOR TO INSTALLATION OF ANY NEW EXTERIOR SHEATHING, TYPICAL.
2. INSTALL NEW ROOFING SYSTEMS AND ALL OF THEIR COMPONENTS PER THE ROOFING MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY.
3. INSTALL ALL WINDOWS, DOORS AND ALL OF THEIR COMPONENTS PER MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY. TYPICAL.
4. G.C. TO VERIFY EXISTING CATAWK LOCATIONS IN ATTIC AND COORDINATE NEW CATAWK AS REQUIRED WITH EQUIPMENT LOCATIONS, TYPICAL.

TYPE V-B (IBC) AND V-III (NFPA) CONSTRUCTION
COMBUSTABLE CONSTRUCTION

EXISTING WALL TO REMAIN
PATCH AND REPAIR EXISTING WALL AS REQUIRED. INSTALL NEW 5/8" GWB
OVER EXISTING GWB SURFACES.

EXISTING EXTERIOR BEARING WALL TO REMAIN UPGRADE TO
ONE HOUR FIRE RATED WALL - DESIGN NO. U356
INSTALL NEW 5/8" FIRECODE C CORE PANEL OVER EXISTING GWB SURFACES.
SEE WALL SECTIONS.
SEE 6 / A - 0.1 SIMILAR

NEW ONE HOUR FIRE RATED WALL - DESIGN NO: U 937
8" CMU - FURRED OUT
SEE 8 / A - 0.1

EXISTING WALL TO REMAIN UPGRADE AS REQUIRED TO -
ONE HOUR FIRE RATED
REMOVE EXISTING GWB. CLOSE ALL OPENINGS, SEAL AROUND ALL PIPE AND
CONDUIT PENETRATIONS AND PROVIDE NEW FIRE DAMPERS ON DUCT
PENETRATIONS AS REQUIRED TO MAINTAIN ONE HOUR FIRE RATING. INSTALL
NEW 5/8" FIRECODE C CORE PANEL.
SEE 1 / A - 0.1 SIMILAR

NEW ONE HOUR FIRE RATED WALL DESIGN NO: U305
2 x 4 STUDS AT 16" O.C. - FIRE STOPPED WITH 5/8" FIRECODE C CORE GYPSUM
PANELS EACH SIDE WITH 3 1/2" MINERAL WOOL BATT INSULATION FULL HEIGHT TO
UNDERSIDE OF FLOOR OR ROOF DECK.
SEE 1 / A - 0.1

NEW EXTERIOR BEARING WALL ONE HOUR FIRE RATED WALL -
DESIGN NO. U356
INSTALL NEW 5/8" FIRECODE C CORE PANEL OVER EXISTING GWB SURFACES.
SEE WALL SECTIONS.
SEE 6 / A - 0.1

FULL HEIGHT SOUND PARTITION
2 x 4 STUDS AT 16" O.C. WITH 5/8" GYPSUM WALLBOARD EACH SIDE FULL HEIGHT TO
UNDERSIDE OF FLOOR OR ROOF DECK WITH 3 1/2" SOUND BATT INSULATION.
SEE 2 / A - 0.1

CEILING HEIGHT SOUND PARTITION
2 x 4 STUDS AT 16" O.C. WITH 5/8" GYPSUM WALLBOARD EACH SIDE TO 6" ABOVE
CEILING WITH 3 1/2" SOUND BATT INSULATION.
SEE 3 / A - 0.1

MISCELLANEOUS PARTITION
2 x 4 STUDS AT 16" O.C. WITH "TYPE X" GYPSUM WALLBOARD EACH SIDE TO CEILING
SEE 4 / A - 0.1

NEW ONE HOUR FIRE RATED SHEAR WALL DESIGN NO: U344
2 x 4 STUDS AT 16" O.C. - FIRE STOPPED WITH 5/8" FIRE CODE C CORE GYPSUM
PANELS EACH SIDE WITH 1/2" APA RATED SHEATHING 32/16, EXPOSURE 1 PLYWOOD
SEE STRUCTURAL DRAWINGS WITH 3 1/2" FOIL FACED BATT INSULATION FILL
HEIGHT TO UNDERSIDE OF FLOOR OR ROOF DECK.
SEE 7 / A - 0.1

NOTES:
1 AT WET LOCATIONS PROVIDE MOISTURE RESISTANT 5/8"
GYPSUM WALLBOARD TYPICAL

1	GO TO COORDINATE ALL STRUCTURAL AND FINISHED DIMENSIONS WITH THE MOVABLE PARTITION MANUFACTURER PRIOR TO STUD INSTALLATION FOR ACCURATE WALL AND GWB CEILING LOCATION AND SIZE. HOLD GWB SOFFIT FLUSH IF POSSIBLE
2	PROVIDE PLYWOOD BLOCKING AS REQUIRED TO MOUNT LCD MONITORS. THE SIZE OF THE BACKER BOARD TO MATCH THE SIZE OF THE LCD SCREEN. INSTALL BEHIND GWB, BEHIND WALL, AND LOCAL LOCATION TO BE COORDINATED WITH BUILDING OWNER TO COORDINATE TO LCD SCREEN SPECIFICATIONS. COORDINATE WITH THE INTERIORS FURNITURE, POWER AND DATA PLANS
3	PROVIDE 4" X 8" PLYWOOD AS REQUIRED FOR BUILDING OWNER SERVER RACK EQUIPMENT FINISH AS REQUIRED TO MATCH THE FINISH ON WHICH IT APPEARS. HEIGHT AND LOCAL LOCATION TO BE COORDINATED WITH BUILDING OWNER
4	PROVIDE FULLY-RECESSED FIRE EXTINGUISHER CABINET (FIRE-RATED WHERE REQUIRED) FOR A 10B ABC FIRE EXTINGUISHER EXTINGUISHER AS MANUFACTURED BY ACTVATOR, INC., SERIES: EMBASSY - TRIMLESS, #56141010 FULLY RECESSED, STYLE: VERTICAL DOW, RECESSED HANDLE WITH SAF-T-LO COLOR. FACTORY PAINTED TO MATCH WALL ON WHICH IT APPEARS. APPROX. ROUGH OPENING SIZE: 28" H X 5" 7/8" D X 11 1/2"W. INCREASE WALL THICKNESS AS REQUIRED. MOUNT AS REQUIRED TO MEET CODE REQUIREMENTS. INSTALL AS RECOMMENDED BY THE MANUFACTURER OR APPROVED EQUAL
5	INDICATES CODE COMPLIANT/ADAAG COMPLIANT TACTILE SIGNAGE TO BE PROVIDED BY THE BUILDING OWNER SIGNAGE VENDOR
6	PROVIDE WALL MOUNTED CHILLED COIL CODE COMPLIANT HIGH/LOW DRINKING FOUNTAIN WITHOUT FILTER OPTION WITH REMOTE CHILLER. FINISH: TDB. INSTALL AS REQUIRED TO BE VANDAL RESISTANT AND BARRIER FREE.
7	NUMBER NOT USED
8	SEE CIVIL DRAWINGS FOR EXTERIOR IMPROVEMENTS
9	INDICATES NEW STAFF LOCKERS. SEE FURNITURE DRAWINGS FOR SPECIFICATIONS AND DETAILS
10	INDICATES ELECTRIC FIREPLACE. SEE ID DRAWINGS FOR POWER & APPEARANCE DETAILS.
11	REWORK EXISTING EXTERIOR AND GRADING AS REQUIRED TO PROVIDE THE ENTRANCE AS REQUIRED BY NEW LAYOUT
12	NUMBER NOT USED
13	NUMBER NOT USED
14	REMOVE EXISTING COLUMN AND REWORK STRUCTURE AS REQUIRED BY NEW LAYOUT. SEE STRUCTURAL DRAWINGS
15	HATCHED AREA: SEE STRUCTURAL DRAWINGS FOR NEW FOOTING, FOUNDATION, SLAB, WALL, AND ROOF RAFTERS AS REQUIRED BY NEW LAYOUT
16	MILLWORK, PLUMBING AND EQUIPMENT DETAILS. SEE INTERIOR DESIGN DRAWINGS
17	SERVERY, PLUMBING AND EQUIPMENT DETAILS. SEE INTERIOR DESIGN DRAWINGS
18	LOW WALL SEE 5/4.0.1 PARTITION TYPE STANDARD LOW WALL HEIGHT TO BE 7'-0" AFF
19	NUMBER NOT USE
20	NUMBER NOT USED
21	ALIGN FOR A SMOOTH TRANSITION AS REQUIRED
22	PROVIDE MELAMINE SHELVING AND COAT ROD OR (5) FIVE ADJUSTABLE MELAMINE SHELVING WITH HEAVY DUTY HARDWARE AS REQD

23	PROVIDE SHELF MOUNTED PERSONAL SAFE FOR EACH PATIENT IN THEIR RESPECTIVE BEDROOM CLOSET OR WARDROBE UNIT
24	PROVIDE A DOOR IN THE FOLDING PARTITION PANEL.
25	HOLD PARTITION WALLS TO A MINIMUM DEPTH AND LENGTH TO CAPTURE THE STACKING PANELS. COORDINATE WITH MOVEABLE PARTITION VENDOR
26	REMOVE NEW WINDOWS. SEE EXTERIOR AND INTERIOR ELEVATIONS.
27	PROVIDE BLOCKING FOR FUTURE GRAB BARS IN TYPE "B" UNITS AND ROLL IN SHOWER UNITS FOR FUTURE SEAT. SEE ELEVATIONS FOR REFERENCE.
28	NUMBER NOT USED
29	NUMBER NOT USED
30	NUMBER NOT USED
31	NUMBER NOT USED
32	PROVIDE NEW 330A HYDRAULIC ELEVATOR. 3500 LB. FRONT OPENING 150 FPM 480V-3P. 9'-0" CEILING / CAB HEIGHT AND UPGRADED FINISHES AS MANUFACTURED BY SCHINDLER ELEVATOR CORPORATION.
33	30"x36" ATTIC ACCESS PANEL AS REQUIRED

Recovery Centers of America

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602

EH
ARCHITECTS

Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning

THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

- ☐ Design Phase
- ☐ Not For Construction
- ☒ For Pricing
- ☐ For Permit
- ☒ Revision
- ☒ For Construction

No.	Date	Description
10	06/03/2016	REVISION #10
11	07/07/2016	REVISION #11
12	07/27/2016	REVISION #12
13	09/16/2016	REVISION #13
14	01/06/2017	REVISION #14
14	02/03/2017	ADDENDUM #1

Job No: 6142.00
 Drawn By:
 Checked By: TEH
 Date: 17 FEB 03
 Scale: AS NOTED
 Drawing Title:

ARCH. PLAN BLDG.
1 & 2, 1ST FLOOR

Sheet No

A-1.0

BILLINGSLEY BUILDINGS 1&2


Copyright © by Thomas E. Hall & Associates, Inc., Wayne, PA 19087, Phone number (610) 293-9900. All rights reserved

ARCHITECTURAL LEGEND	
	FULLY RECESSED FIRE EXTINGUISHER CABINET FOR ONE 10# ABC FIRE EXTINGUISHER (MP SERIES). PROVIDE FIRE RATED CABINET AS REQUIRED.
	FULLY ACCESSIBLE PATIENT ROOM AND BATH
	NEW CONSTRUCTION
	INFILL IN PLACE CONCRETE SLAB @ HIGHER ELEVATION TO ALIGN WITH EXISTING CONCRETE FLOOR TO BE SMOOTH AND READY TO RECEIVE NEW FLOOR FINISH. SEE STRUCTURAL DRAWINGS

ARCHITECTURAL GENERAL NOTES	
1.	GC TO REMOVE EXISTING WALL AND ROOF SHEATHING AS REQUIRED. GC TO VERIFY THE CONDITION OF THE EXISTING FRAMING IS FREE OF, MOLD, DRY ROT, WATER DAMAGE, INSECT DAMAGE, STRUCTURAL DAMAGE, ETC. AND IS SUITABLE FOR INSTALLATION OF NEW WALL AND ROOF SHEATHING PRIOR TO INSTALLATION OF ANY NEW EXTERIOR SHEATHING, TYPICAL.
2.	INSTALL NEW ROOFING SYSTEMS AND ALL OF THEIR COMPONENTS PER THE ROOFING MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY.
3.	INSTALL ALL WINDOWS, DOORS AND ALL OF THEIR COMPONENTS PER MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY, TYPICAL.
4.	G.C. TO VERIFY EXISTING CATWALK LOCATIONS IN ATTIC AND COORDINATE NEW CATWALKS AS REQUIRED WITH EQUIPMENT LOCATIONS, TYPICAL.

WALL LEGEND	
TYPE V-B (IBC) AND V-II (NFPA) CONSTRUCTION COMBUSTABLE CONSTRUCTION	
	EXISTING WALL TO REMAIN PATCH AND REPAIR EXISTING WALL AS REQUIRED. INSTALL NEW 5/8" GWB OVER EXISTING GWB SURFACES.
	EXISTING EXTERIOR BEARING WALL TO REMAIN UPGRADE TO ONE HOUR FIRE RATED WALL - DESIGN NO. U356 INSTALL NEW 5/8" FIRECODE C CORE PANEL OVER EXISTING GWB SURFACES. SEE WALL SECTIONS. SEE 6 / A - 0.1 SIMILAR
	NEW ONE HOUR FIRE RATED WALL - DESIGN NO: U 937 8" CMU - FURRED OUT SEE 8 / A - 0.1
	EXISTING WALL TO REMAIN UPGRADE AS REQUIRED TO - ONE HOUR FIRE RATED REMOVE EXISTING GWB. CLOSE ALL OPENINGS, SEAL AROUND ALL PIPE AND CONDUIT PENETRATIONS AND PROVIDE NEW FIRE DAMPERS ON DUCT PENETRATIONS AS REQUIRED TO MAINTAIN ONE HOUR FIRE RATING. INSTALL NEW 5/8" FIRECODE C CORE PANEL. SEE 1 / A - 0.1 SIMILAR
	NEW ONE HOUR FIRE RATED WALL DESIGN NO: U305 2 x 4 STUDS AT 16" O.C. - FIRE STOPPED WITH 5/8" FIRECODE C CORE GYPSUM PANELS EACH SIDE WITH 3 1/2" MINERAL WOOL BATT INSULATION FULL HEIGHT TO UNDERSIDE OF FLOOR OR ROOF DECK. SEE 1 / A - 0.1
	NEW EXTERIOR BEARING WALL ONE HOUR FIRE RATED WALL - DESIGN NO. U356 INSTALL NEW 5/8" FIRECODE C CORE PANEL OVER EXISTING GWB SURFACES. SEE WALL SECTIONS. SEE 6 / A - 0.1
	FULL HEIGHT SOUND PARTITION 2 x 4 STUDS AT 16" O.C. WITH 5/8" GYPSUM WALLBOARD EACH SIDE FULL HEIGHT TO UNDERSIDE OF FLOOR OR ROOF DECK WITH 3 1/2" SOUND BATT INSULATION. SEE 2 / A - 0.1
	CEILING HEIGHT SOUND PARTITION 2 x 4 STUDS AT 16" O.C. WITH 5/8" GYPSUM WALLBOARD EACH SIDE TO 6" ABOVE CEILING WITH 3 1/2" SOUND BATT INSULATION. SEE 3 / A - 0.1
	MISCELLANEOUS PARTITION 2 x 4 STUDS AT 16" O.C. WITH "TYPE X" GYPSUM WALLBOARD EACH SIDE TO CEILING. SEE 4 / A - 0.1
	NEW ONE HOUR FIRE RATED SHEAR WALL DESIGN NO: U344 2 x 4 STUDS AT 16" O.C. - FIRE STOPPED WITH 5/8" FIRECODE C CORE GYPSUM PANELS EACH SIDE WITH 1/2" APA RATED SHEATHING 3216. EXPOSURE 1 PLYWOOD. SEE STRUCTURAL DRAWINGS WITH 3 1/2" FOIL FACED BATT INSULATION FULL HEIGHT TO UNDERSIDE OF FLOOR OR ROOF DECK. SEE 7 / A - 0.1
NOTES: 1 AT WET LOCATIONS PROVIDE MOISTURE RESISTANT 5/8" GYPSUM WALLBOARD TYPICAL	

ARCHITECTURAL KEYNOTES	
1	GC TO COORDINATE ALL STRUCTURAL AND FINISHED DIMENSIONS WITH THE MOVEABLE PARTITION MANUFACTURER PRIOR TO STUD INSTALLATION FOR ACCURATE WALL AND GWB CEILING LOCATION AND SIZE. HOLD GWB SOFFIT FLUSH IF POSSIBLE
2	PROVIDE PLYWOOD BLOCKING AS REQUIRED TO MOUNT LCD MONITORS. THE SIZE OF THE BACKER BOARD TO MATCH THE SIZE OF THE LCD SCREEN. INSTALL BEHIND GWB. HEIGHT AND FINAL LOCATION TO BE COORDINATED WITH BUILDING OWNER. REPRESENTATIVE PRIOR TO INSTALLATION. BUILDING OWNER TO COORDINATE TO LCD SCREEN SPECIFICATIONS. COORDINATE WITH THE INTERIORS FURNITURE, POWER AND DATA PLANS
3	PROVIDE 4' X 8' PLYWOOD AS REQUIRED FOR BUILDING OWNER SERVER ROOM EQUIPMENT. FINISH AS REQUIRED TO MATCH THE FINISH ON WHICH IT APPEARS. HEIGHT AND FINAL LOCATION TO BE COORDINATED WITH BUILDING OWNER
4	PROVIDE FULLY-RECESSED FIRE EXTINGUISHER CABINET(FIRE-RATED WHERE REQUIRED) FOR A 10# ABC FIRE EXTINGUISHER EXTINGUISHER AS MANUFACTURED BY: ACTIVAR, INC. SERIES: EMBASSY - TRIMLESS, #5614W10, FULLY RECESSED, STYLE: VERTICAL DUO, RECESSED HANDLE WITH SAF-T-LOCK, COLOR: FACTORY PAINTED TO MATCH WALL ON WHICH IT APPEARS, APPROX. ROUGH OPENING SIZE: 25" H X 5 7/8" D X 1 1/2" W - INCREASE WALL THICKNESS AS REQUIRED, MOUNT AS REQUIRED TO MEET CODE REQUIREMENTS. INSTALL AS RECOMMENDED BY THE MANUFACTURER OR APPROVED EQUAL
5	INDICATES CODE COMPLIANT/ADAAG COMPLIANT TACTILE SIGNAGE TO BE PROVIDED BY THE BUILDING OWNER SIGNAGE VENDOR
6	PROVIDE WALL MOUNTED CHILLED CODE COMPLIANT HIGH-LOW DRINKING FOUNTAIN WITHOUT FILLER OPTION WITH REMOTE CHILLER. FINISH: TDB. INSTALL AS REQUIRED TO BE VANDAL RESISTANT AND BARRIER FREE
7	NUMBER NOT USED
8	SEE CIVIL DRAWINGS FOR EXTERIOR IMPROVEMENTS
9	INDICATES NEW STAFF LOCKERS. SEE FURNITURE DRAWINGS FOR SPECIFICATIONS AND DETAILS
10	INDICATES ELECTRIC FIREPLACE. SEE ID DRAWINGS FOR POWER & MOUNTING DETAILS
11	REWORK EXISTING EXTERIOR AND GRADING AS REQUIRED TO PROVIDE THE ENTRANCE AS REQUIRED BY NEW LAYOUT
12	NUMBER NOT USED
13	NUMBER NOT USED
14	REMOVE EXISTING COLUMN AND REWORK STRUCTURE AS REQUIRED BY NEW LAYOUT. SEE STRUCTURAL DRAWINGS
15	HATCHED AREA: SEE STRUCTURAL DRAWINGS FOR NEW FOOTING, FOUNDATION, SLAB, WALL, AND ROOF FRAMING AS REQUIRED BY NEW LAYOUT
16	MILLWORK, PLUMBING AND EQUIPMENT DETAILS. SEE INTERIOR DESIGN DRAWINGS
17	SERVERY, PLUMBING AND EQUIPMENT DETAILS. SEE INTERIOR DESIGN DRAWINGS
18	LOW WALL SEE 5/A-0.1 PARTITION TYPE STANDARD LOW WALL HEIGHT TO BE 7'-0" AFF
19	NUMBER NOT USE
20	NUMBER NOT USED
21	ALIGN FOR A SMOOTH TRANSITION AS REQUIRED
22	PROVIDE MELAMINE SHELVING AND COAT ROD OR (5) FIVE ADJUSTABLE MELAMINE SHELVING WITH HEAVY DUTY HARDWARE AS REQ'D
23	PROVIDE SHELF MOUNTED PERSONAL SAFE FOR EACH PATIENT IN THEIR RESPECTIVE BEDROOM CLOSET OR WARDROBE UNIT
24	PROVIDE A DOOR IN THE FOLDING PARTITION PANEL
25	HOLD PARTITION WALLS TO A MINIMUM DEPTH AND LENGTH TO CAPTURE THE STACKING PANELS. COORDINATE WITH MOVEABLE PARTITION VENDOR
26	PROVIDE NEW WINDOWS. SEE EXTERIOR AND INTERIOR ELEVATIONS.
27	PROVIDE BLOCKING FOR FUTURE GRAB BARS IN TYPE "B" UNITS AND ROLL IN SHOWER UNITS FOR FUTURE SEAT. SEE ELEVATIONS FOR REFERENCE.
28	NUMBER NOT USED
29	NUMBER NOT USED
30	NUMBER NOT USED
31	NUMBER NOT USED
32	PROVIDE NEW 330A HYDRAULIC ELEVATOR, 3500 LB. FRONT OPENING 150 FPM, 480V-3P, 8'-0" CEILING / CAB HEIGHT AND UPGRADED FINISHES AS MANUFACTURED BY SCHINDLER ELEVATOR CORPORATION.
33	30"x36" ATTIC ACCESS PANEL AS REQUIRED

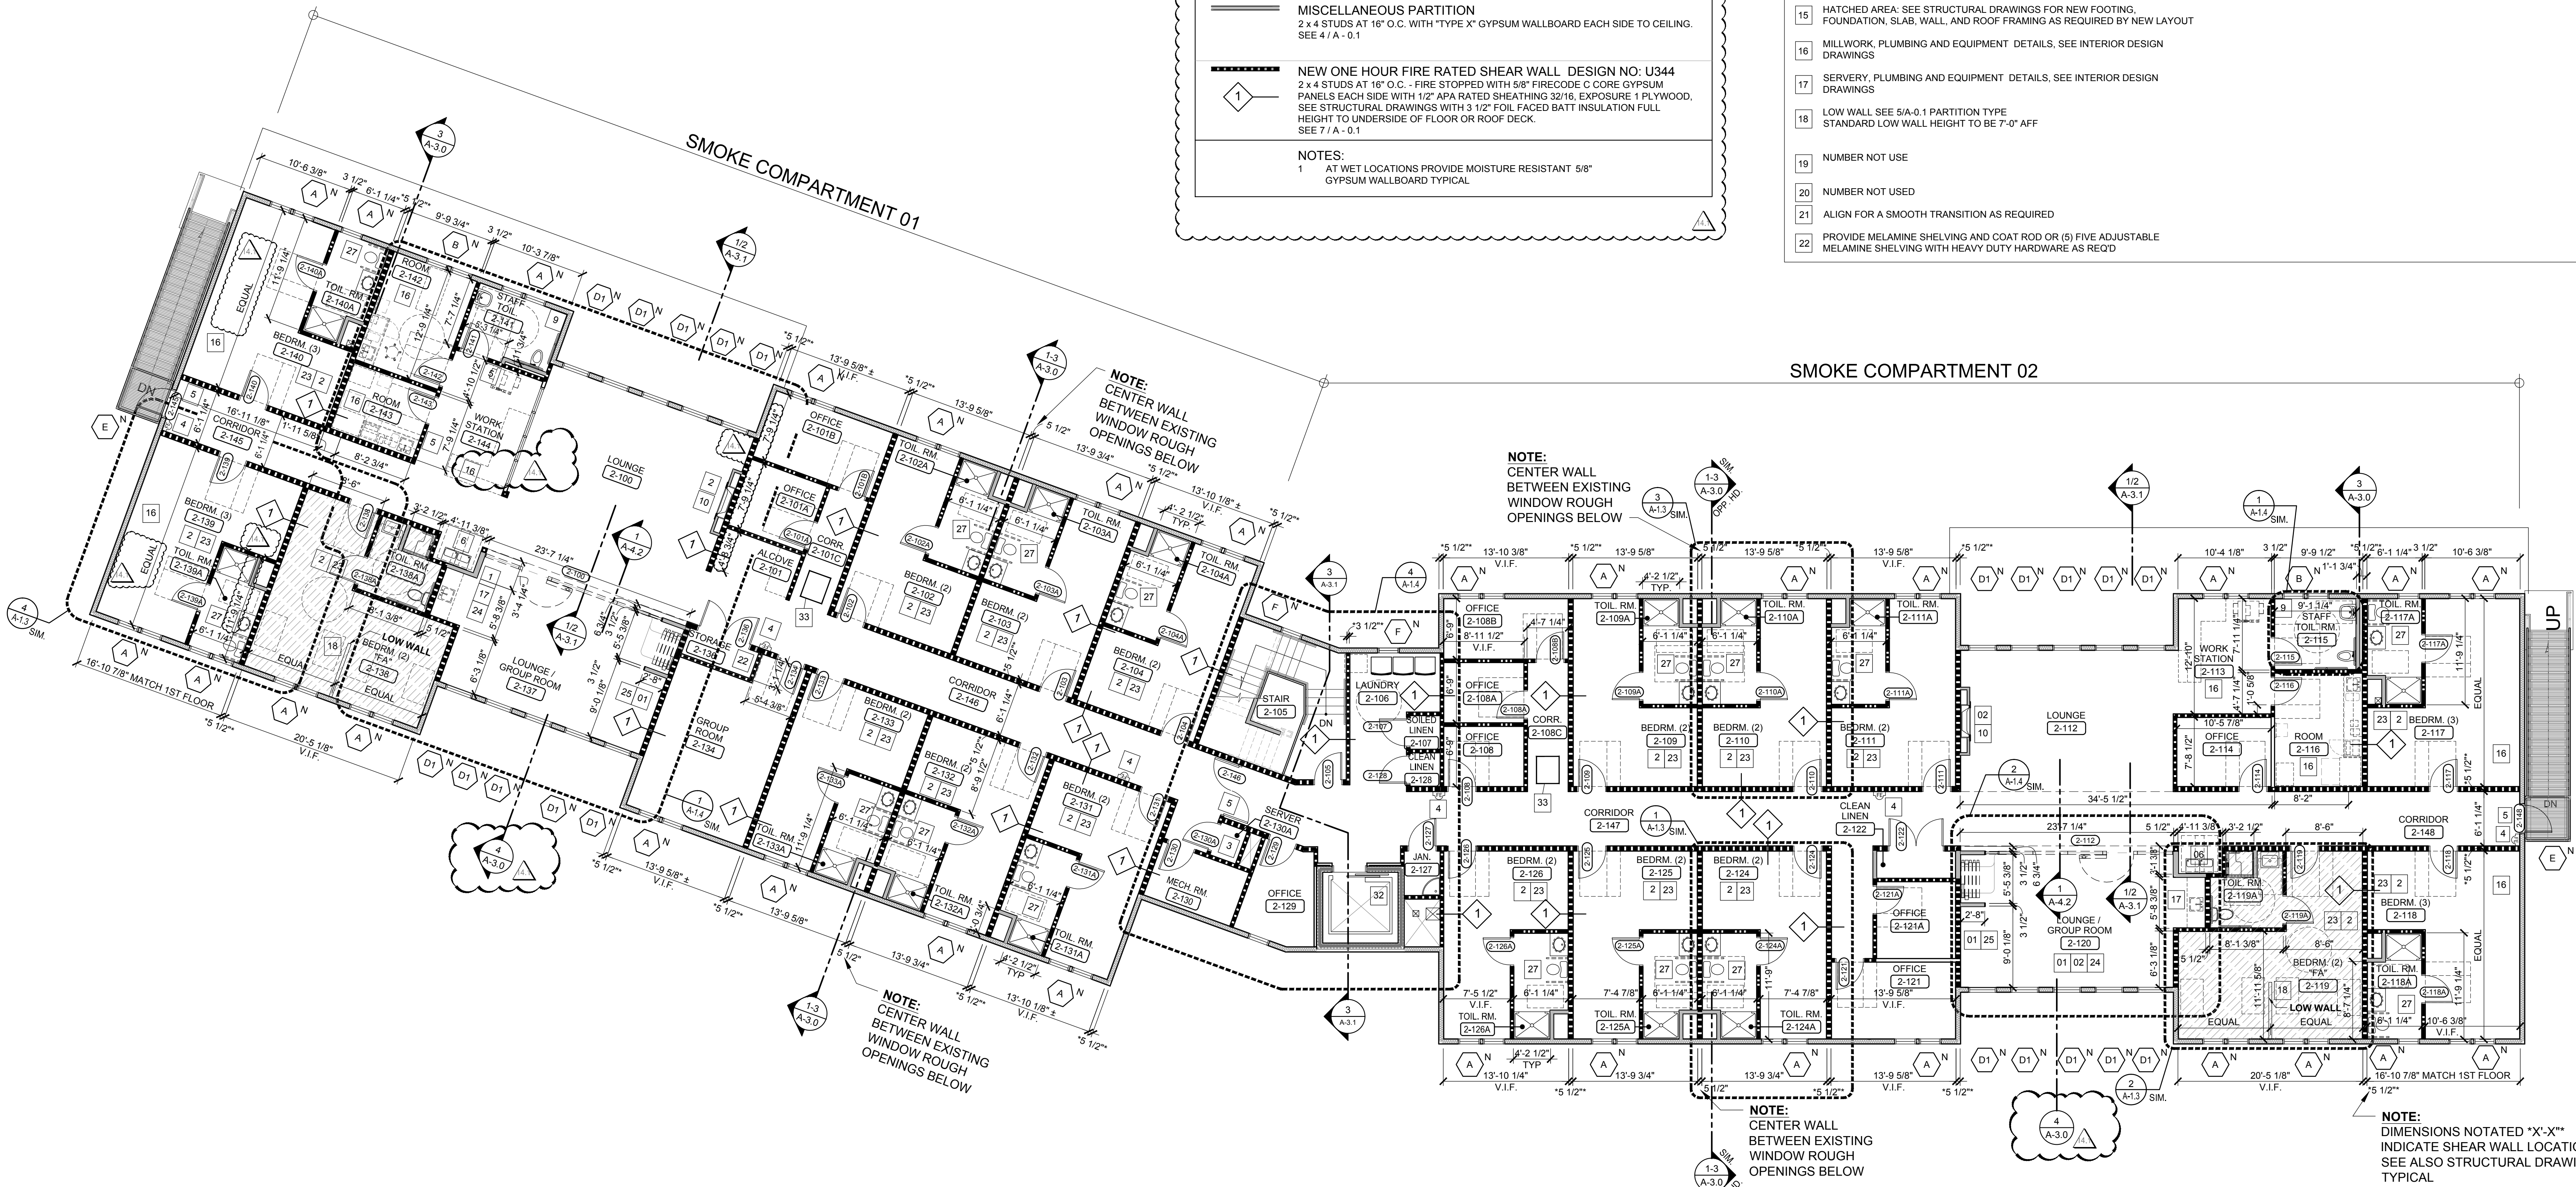

2 SECOND FLOOR PLAN BUILDING'S NO. 1 & 2
A-1.1 SCALE: 1/8" = 1'-0"



Recovery Centers of America

Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

Consultant

Key Plan

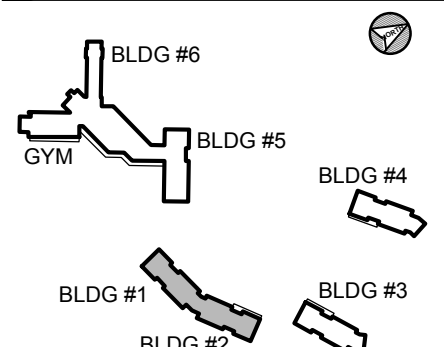

Project Type

- ☐ Alteration
- ☒ Remodel
- ☐ New Addition
- ☐ New Construction

Drawing Status

- ☐ Design Phase
- ☐ Not For Construction
- ☐ For Pricing
- ☐ For Permit
- ☒ Revision
- ☐ For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

ARCH. PLAN BLDG.
1 & 2, 2ND FLOOR

Sheet No:

A-1.1

ARCHITECTURAL ROOF PLAN KEY NOTES

1

GC TO VERIFY ALL EXISTING ROOF SLOPES, TYPICAL

2

GC TO VERIFY ALL EXISTING ROOF DRAINS AND LOCATIONS, TYPICAL

3

GC TO VERIFY ALL EXISTING EQUIPMENT CURBS & LOCATIONS TYPICAL

4

FULLY ADHERED SINGLE PLY TPO ROOFING OVER TWO 2" LAYERS OF POLYISO RIGID ROOF INSULATION WITH ALL JOINTS STAGGERED INSTALL PER MANUFACTURERS SPECIFICATIONS

5

ASPHALT SHINGLE ROOFING 30 YEAR MINIMUM WARRANTY INSTALL PER MANUFACTURERS SPECIFICATIONS

6

ROOF TOP EQUIPMENT LOCATION SEE MECHANICAL DRAWINGS INSTALL PER MANUFACTURERS SPECIFICATIONS TYPICAL

7

INSTALL NEW ROOF FRAMING, SHEATHING, INSULATION & ROOFING AT INFILL ADDITION AREAS SEE STRUCTURAL DRAWINGS

8

AT DEMOED SKYLIGHT LOCATIONS INSTALL NEW ROOF STRUCTURE, METAL DECKING, INSULATION & ROOFING - SEE STRUCTURAL DRAWINGS

9

GC TO VERIFY IF EXISTING VENT ON ROOF IS IN SATISFACTORY WORKING ORDER AND GOOD CONDITION. SEE MECHANICAL DRAWINGS.

10

FIELD VERIFY EXISTING ATTIC DOOR SIZE AND LOCATION, TYP

11

THRU WALL SCUPPER LOCATION. INSTALL FLASHING AT HEAD, JAMBS AND SILL OF OPENING TYPICAL

12

PARAPET WALL WITH CAP FLASHING TYPICAL

13

ATTIC DRAFTSTOPPING LOCATION - FULL HEIGHT AND WIDTH - ALIGN WITH SMOKE COMPARTMENT WALLS AS INDICATED, DRAFTSTOPPING TO BE 5/8" GWB OR 1/2" PLYWOOD PER NFPA 101 SECTION 8.6.11

14

ATTIC ACCESS DOOR WITH 12" CURB TO FLAT ROOF. FLASH AND SEAL ACCORDINGLY, REFERENCE ROOFING MANUFACTURERS REQUIRED SPECS

15

GC TO COORDINATE ACCESS DOOR LOCATION WITH EXISTING ROOF TRUSS FRAMING MEMBERS, TYPICAL

ARCHITECTURAL GENERAL NOTES

1.

GC TO REMOVE EXISTING WALL AND ROOF SHEATHING AS REQUIRED. GC TO VERIFY THE CONDITION OF THE EXISTING FRAMING IS FREE OF: MOLD, DRY ROT, WATER DAMAGE, INSECT DAMAGE, STRUCTURAL DAMAGE, ETC. AND IS SUITABLE FOR INSTALLATION OF NEW WALL AND ROOF SHEATHING PRIOR TO INSTALLATION OF ANY NEW EXTERIOR SHEATHING, TYPICAL.

2.

INSTALL NEW ROOFING SYSTEMS AND ALL OF THEIR COMPONENTS PER THE ROOFING MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY.

3.

INSTALL ALL WINDOWS, DOORS AND ALL OF THEIR COMPONENTS PER MANUFACTURERS SPECIFICATIONS REQUIREMENTS FOR INSTALLATION AND WARRANTY, TYPICAL

4.

G.C. TO VERIFY EXISTING CATWALK LOCATIONS IN ATTIC AND COORDINATE NEW CATWALKS AS REQUIRED WITH EQUIPMENT LOCATIONS, TYPICAL

R

G

A

A

Recovery Centers of America

Project

BILLINGSLEY FACILITY
BUILDINGS 1&2
11,100 BILLINGSLEY ROAD WALDORF, MARYLAND 220602

TH ARCHITECTS

Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal

BOARD OF ARCHITECTS
10352

THOMAS EDWIN HALL
STATE OF MARYLAND

THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNSUPPORTED DISCREPANCIES.


Consultant

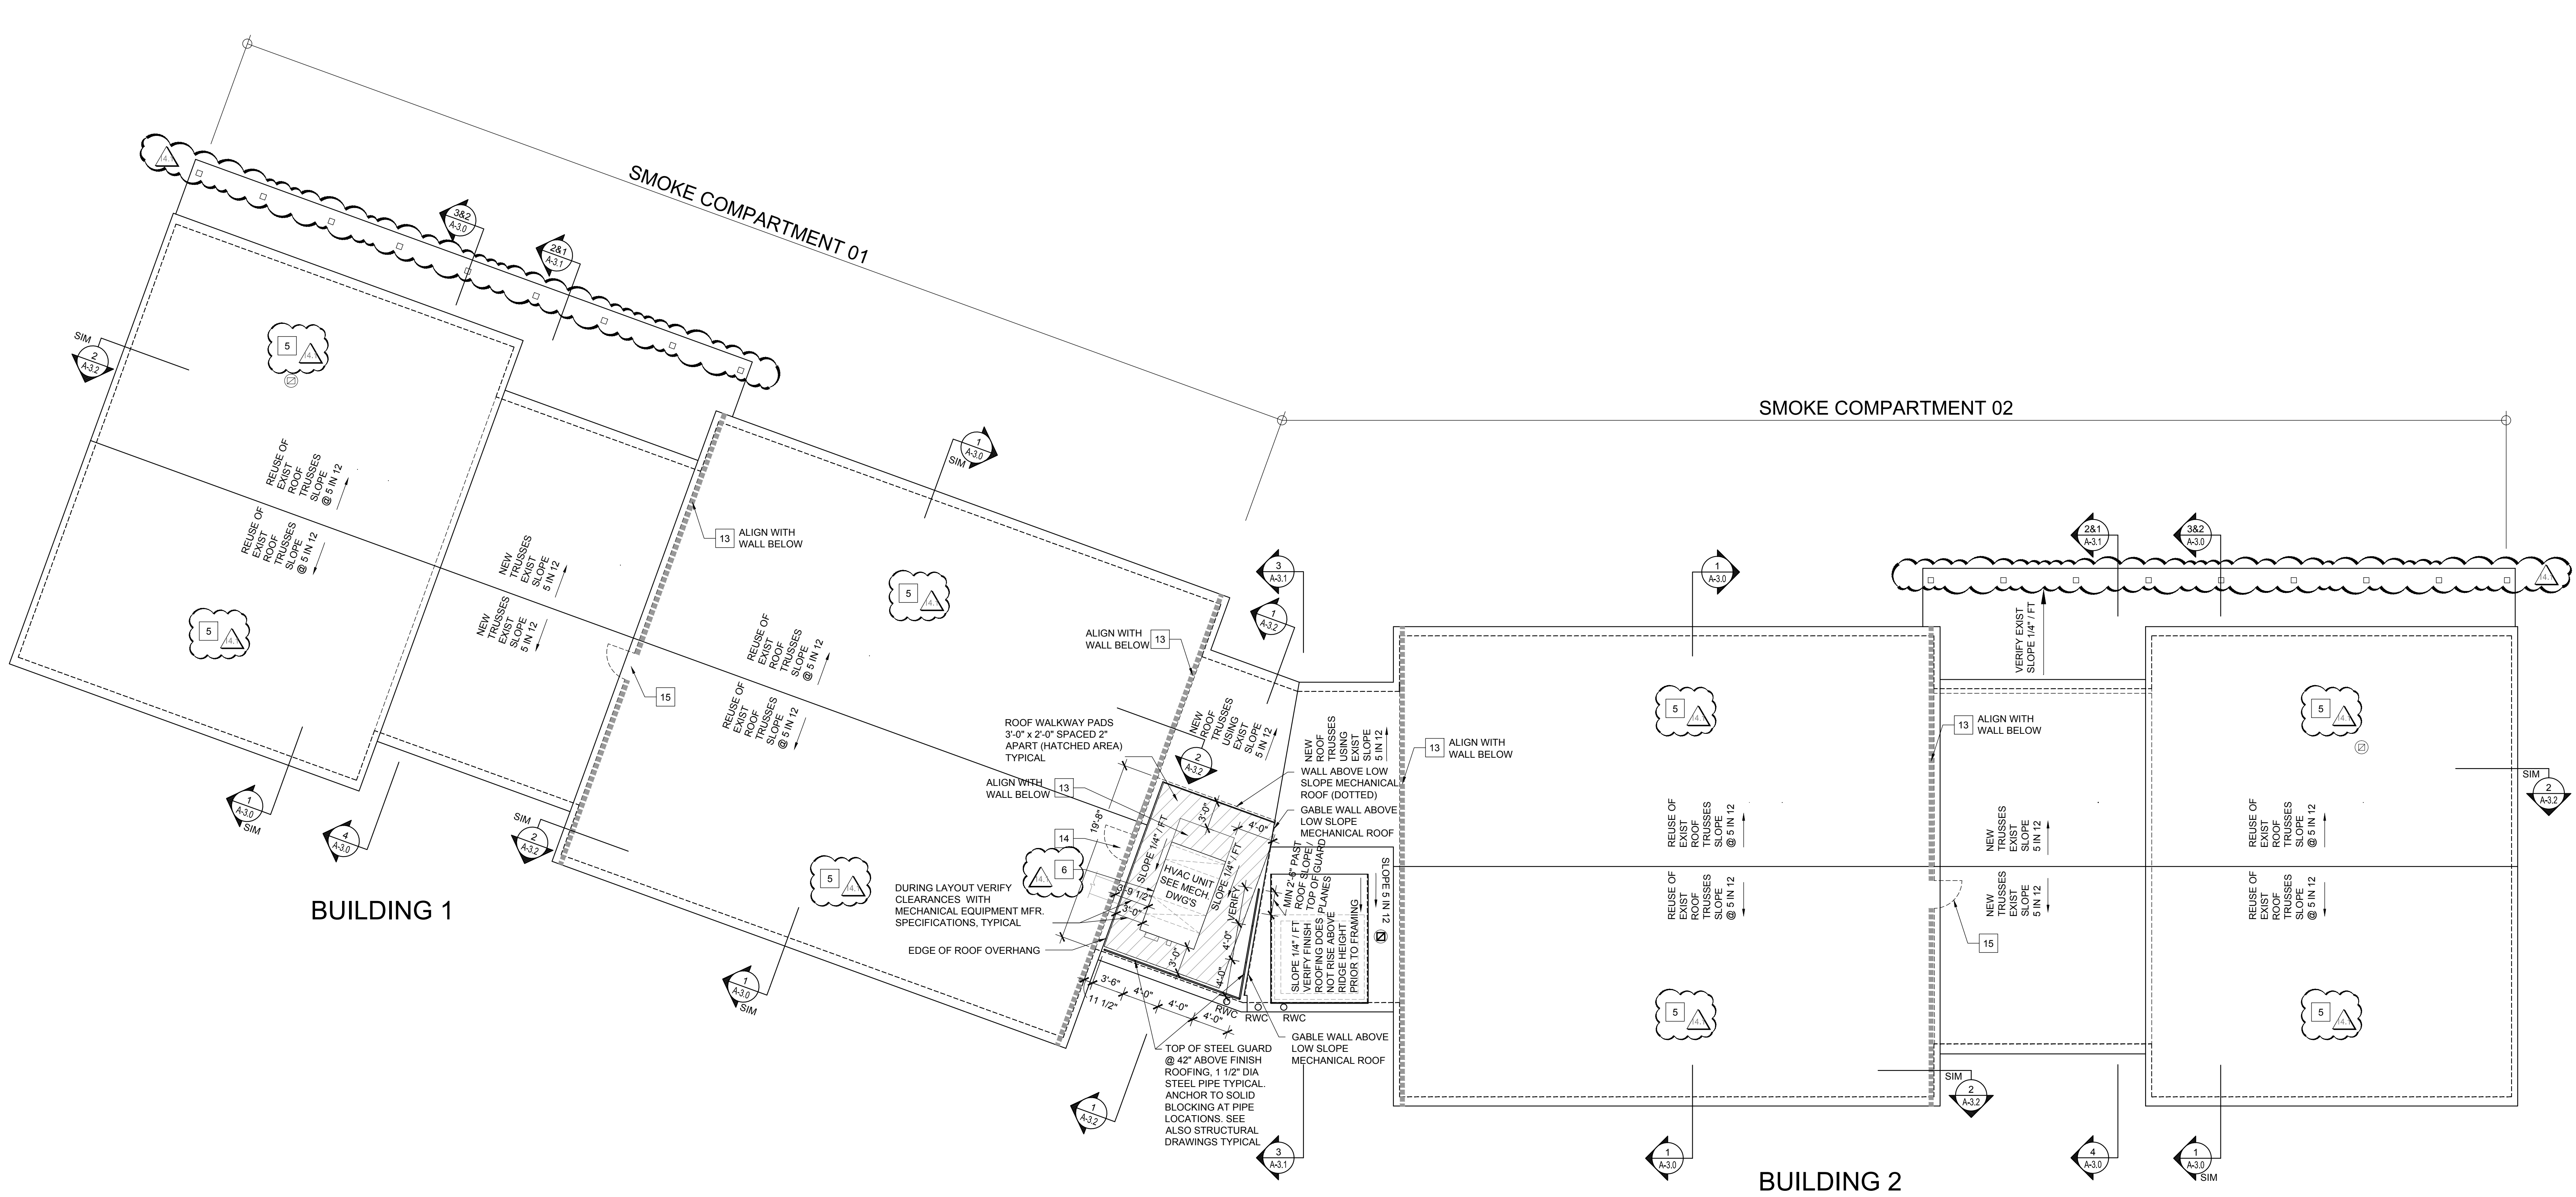

1

BUILDING 1 & 2 - ROOF PLAN

SCALE: 1/8" = 1'-0"

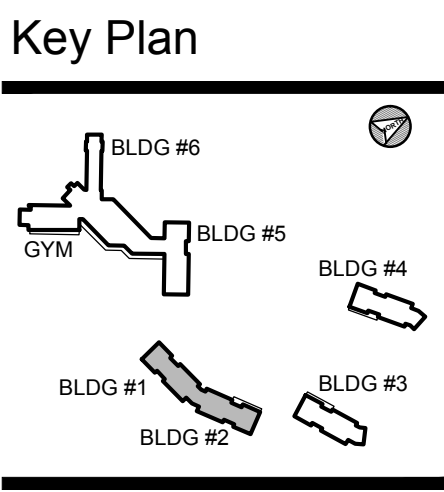

Project Type

☐ Alteration

☒ Remodel

☒ New Addition

☐ New Construction

Drawing Status

☐ Design Phase

☐ Not For Construction

☐ For Pricing

☐ For Permit

☒ Revision

☒ For Construction

Revisions		
No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1
Job No: 6142.00		
Drawn By:		
Checked By: TEH		
Date: 17 FEB 03		
Scale: AS NOTED		
Drawing Title: 1/16"=1'-0"		

ARCH. ROOF PLAN

BLDG. 1 & 2

Sheet No:

A-1.2

GENERAL NOTES

- COORDINATE WITH INTERIOR DESIGN DRAWINGS FOR ALL FUTURE, ACCESSORIES, FINISHES AND SPECIFICATIONS.
- INSTALL BLOCKING AS REQUIRED FOR FUTURE INSTALLATION OF GRAB BARS IN ALL TYPE "B" TOILET ROOMS.
- WATER CLOSETS AND URINALS SHALL BE VITREOUS CERAMIC CHINA TYPICAL.
- TOILET ACCESSORIES TO BE POLISHED CHROME.
- SHOWERS - ALL SHOWERS TO RECEIVE TILED WALLS, SEE INTERIOR DESIGN DRAWINGS FOR SPECIFICATIONS.
- ALL ACCESSORIES TO BE COORDINATED FOR CLEARANCES AROUND TOILET PARTITION DOORS AND DOOR SWINGS.
- MOUNT / INSTALL ALL OF THE EQUIPMENT AS REQUIRED TO BE ADAAG / ANSI 117.1 COMPLIANT.
- PROVIDE ALL COMMON AREA TOILETS WITH WALL MOUNTED WATER CLOSET WITH HANDS FREE FLUSH VALVE TOILET PUSH BUTTON HIGH EFFICIENCY FLUSHOMETER VALVE.

LARGE SCALE PLAN & ELEVATION NOTES

1. THE DIMENSIONS INDICATED ON THESE LARGE SCALE PLANS AND ELEVATIONS ARE FROM FINISH FACE OF GWB TO FINISH FACE OF GWB, UNLESS NOTED OTHERWISE.

TOILET ROOM EQUIPMENT LIST

- WALL MOUNTED ADAAG / ANSI 117.1 COMPLIANT WATER CLOSET WITH HANDS FREE FLUSH VALVE
- FLOOR MOUNTED WATER CLOSET ADAAG / ANSI 117.1 CODE COMPLIANT WITH LEFT OR RIGHT TRIP LEVER
- WALL MOUNTED ADAAG / ANSI 117.1 COMPLIANT URINAL WITH HANDS FREE FLUSH VALVE
- WALL MOUNTED URINAL WITH HANDS FREE FLUSH VALVE
- PAINTED METAL FLOOR MOUNTED TOILET PARTITIONS AND DOORS
- PAINTED METAL WALL MOUNTED URINAL SCREEN
- RECESSED TOILET SEAT COVER DISPENSER
- HORIZONTAL WALL MOUNTED 48" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS
- HORIZONTAL WALL MOUNTED 42" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PUBLIC TOILET ROOMS)
- HORIZONTAL WALL MOUNTED 42" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET ROOMS)
- HORIZONTAL WALL MOUNTED 36" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET ROOMS)
- HORIZONTAL WALL MOUNTED 36" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET ROOMS)
- HORIZONTAL WALL MOUNTED 18 - 21" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PUBLIC TOILET AND PUBLIC SHOWER)
- VERTICAL WALL MOUNTED 18" ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET AND SHOWER)
- VERTICAL WALL MOUNTED 18" ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET AND SHOWER)
- (1) ONE CONTINUOUS HORIZONTAL WALL MOUNTED GRAB BAR LH / RH SEE PLAN AT TRANSFER SHOWER AS REQUIRED ADAAG / ANSI 117.1 COMPLIANT.
- COAT HOOK ON BACK OF ALL TOILET PARTITION DOORS (ONE PER STALL). SEE INTERIOR DRAWINGS FOR DETAILS.
- PATIENT TOILET ROOMS/SINGLE PUBLIC TOILET ROOM COAT HOOKS. SEE INTERIOR DRAWINGS FOR MOUNTING LOCATIONS.
- SURFACE MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PUBLIC GANG TOILETS
- RECESSED MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PUBLIC TOILET ROOMS
- SURFACE MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PRIVATE TOILET ROOMS
- NOT USED
- SURFACE MOUNTED SANITARY NAPKIN DISPOSAL FOR WOMEN'S STALLS AND WOMEN'S AND UNISEX TOILET ROOMS ONLY
- RECESSED NAPKIN / TAMPON VENDOR FOR WOMEN'S GANG TOILET ROOMS ONLY
- WALL MOUNTED FIXED POSITION 2" FRAMED MIRROR - CODE COMPLIANT MIRROR THEFT PROOF INSTALLATION - SEE INTERIOR DRAWINGS FOR DETAILS
- GRANITE / MARBLE / QUARTZ SURFACE / SOLID SURFACE COUNTER WITH APRON TO USE WITH AN UNDERMOUNT BOWL. INCLUDE GRID DRAIN AND P-TRAP. PROVIDE REMOVABLE CABINET FOR ACCESSIBILITY AT ALL TYPICAL BATHROOMS.
- GRANITE / MARBLE / QUARTZ SURFACE / SOLID SURFACE COUNTER WITH SEMI - COUNTERTOP SINK WITH FAUCET, INCLUDE GRID DRAIN AND P-TRAP
- WALL MOUNTED LAVATORY WITH FAUCET, KNEE CONTACT GUARD, INCLUDE GRID DRAIN AND P-TRAP
- HANDS FREE CONTROL LAVATORY FAUCET MODEL
- SINGLE LEVER SINK FAUCET - CODE COMPLIANT
- HANDS FREE COUNTER TOP SOAP DISPENSER
- RECESSED WALLDECK MOUNTED SOAP DISPENSER WITH SOAP VESSEL
- RECESSED PAPER TOWEL DISPENSER AND DISPOSAL - ADAAG / ANSI 117.1 CODE COMPLIANT
- RECESSED PAPER TOWEL DISPENSER AND DISPOSAL
- WALL MOUNTED TOWEL BAR - CODE COMPLIANT - INSTALL ONE PER PATIENT BATHROOM TYPICAL
- SHOWER RECEPTOR BARRIER FREE MOULDED FIBERGLASS, 2" PNC NON CAULK DRAIN LH / RH TO BE DETERMINED. G.C. TO VERIFY RECEPTOR COMPLIES WITH CODE FOR "FA", ROLL-IN SHOWERS, TRANSFER SHOWERS AND TYPE "B" UNITS.
- ADULT FOLDING SHOWER SEAT - ADAAG / ANSI 117.1 CODE COMPLIANT - BARRIER FREE - SEE PLAN FOR LH / RH
- SHOWER - HAND SHOWER SYSTEM WITH SLIDE BAR PROVIDE ALL COMPONENTS AS REQUIRED. MOUNT AS REQUIRED TO BE ADAAG / ANSI 117.1 CODE COMPLIANT
- RECESSED SOAP/SHAMPOO/CONDITIONER DISPENSERS - ADAAG / ANSI 117.1 CODE COMPLIANT
- SERVICE SINK
- SERVICE SINK FAUCET & SERVICE SINK FITTINGS
- PROVIDE BLOCKING FOR FUTURE (2) TWO SWING - UP GRAB BARS WALL MOUNTED MINIMUM 29" LONG ADAAG / ANSI 117.1 COMPLIANT GRAB BARS PROVIDE ONE SWING UP GRAB BAR WITH INTEGRAL TOILET PAPER HOLDER
- HORIZONTAL RECESSED MOUNTED BABY CHANGING STATION - ADAAG / ANSI 117.1 CODE COMPLIANT
- WALL MOUNTED FIXED POSITION 2" FRAMED FULL WIDTH MIRROR - CODE COMPLIANT MIRROR - THEFT PROOF INSTALLATION - SEE INTERIOR DRAWINGS FOR DETAILS
- TYPICAL SHOWER HEAD - OPTION RAIN SHOWER
- TYPICAL DIVERTER

ANCILLARY SINKS & FAUCETS EQMT. LIST

- SINGLE LEVER FAUCET AT LOUNGE / CAFE ADAAG / ANSI 117.1 CODE COMPLIANT
- SINGLE LEVER FAUCET OTHER COMMON AREA ROOMS
- NOT USED
- UNDERMOUNT SINGLE BOWL SINK ADAAG / ANSI 117.1 CODE COMPLIANT AT GROUP ROOM LOUNGE/COFFEE BAR
- UNDERMOUNT SINGLE BOWL STAINLESS STEEL BAR SINK ADAAG / ANSI 117.1 CODE COMPLIANT AT OTHER COMMON AREA ROOMS

MISCELLANEOUS EQUIPMENT LIST

- FRONT ELECTRIC LOADING WASHER
- ELECTRIC DRYER
- STACKABLE ELECTRIC FRONT LOADING WASHER AND DRYER
- WALL MOUNTED TOUCHLESS ADA COMPLIANT BOTTLE FILLER STATION WITH HI/LO - FILTERED COOLER, VANDAL RESISTANT & BARRIER FREE



Recovery Centers of America


Project

BILLINGSLEY FACILITY BUILDINGS 1&2
11,100 BILLINGSLEY ROAD WALDORF, MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal

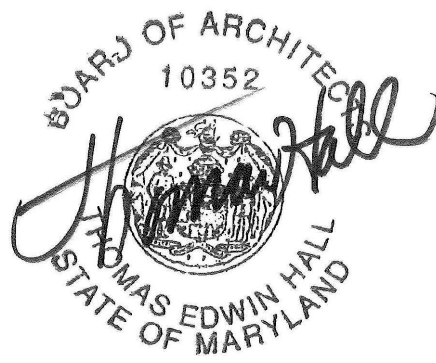

THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

Consultant

Key Plan

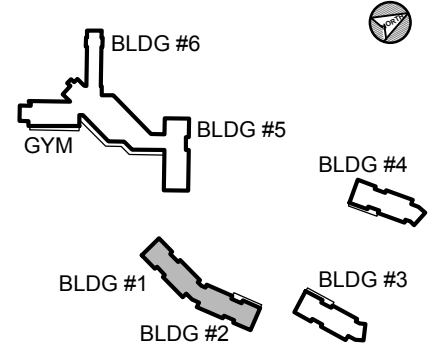

Project Type

- Alteration
- Remodel
- New Addition
- New Construction

Drawing Status

- Design Phase
- Not For Construction
- For Pricing
- For Permit
- Revision
- For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title: 1/4"=1'-0"


TYP. BEDRM. PLAN/
ELEV. BLDG. 1 & 2

Sheet No:

A-1.3


7 TYPICAL TYPE "FA" TOILET ROOM - ROLL IN SHOWER

A-1.3 SCALE: 1/4" = 1'-0"

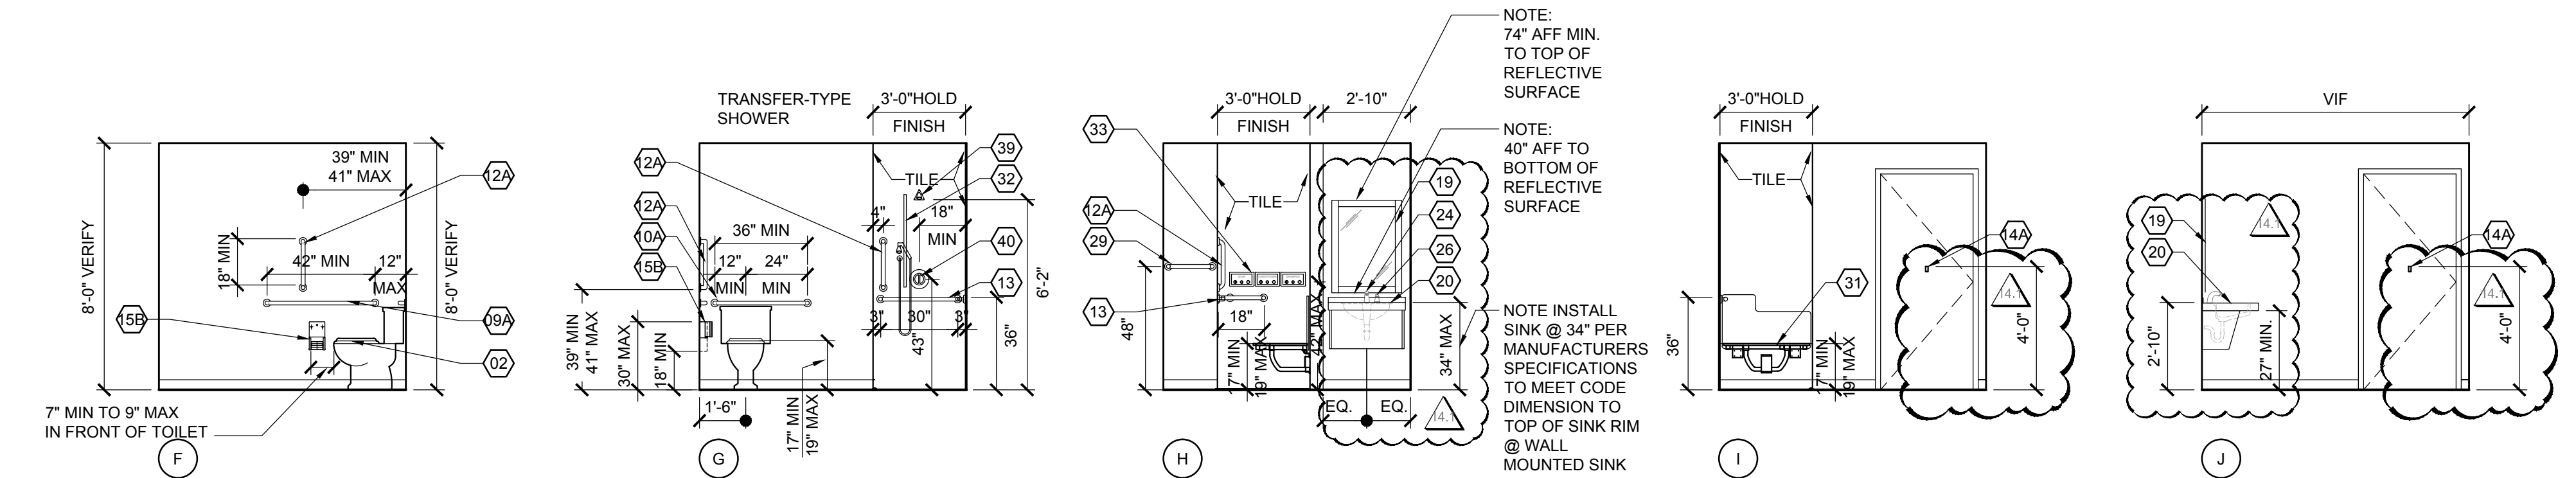


6 TYPICAL TYPE "FA" TOILET ROOM

A-1.3 SCALE: 1/4" = 1'-0"

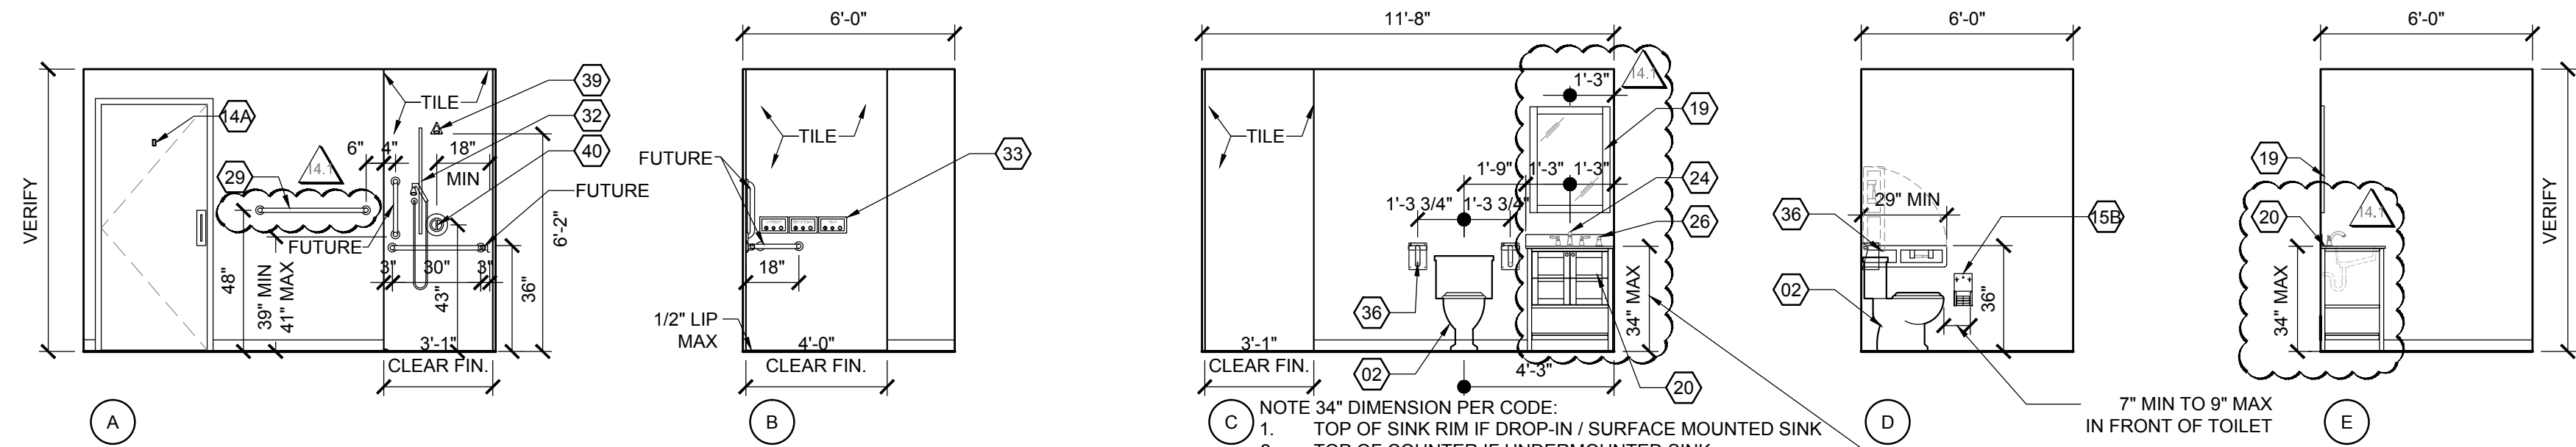

5 TYPICAL TYPE "B" TOILET ROOM

A-1.3 SCALE: 1/4" = 1'-0"

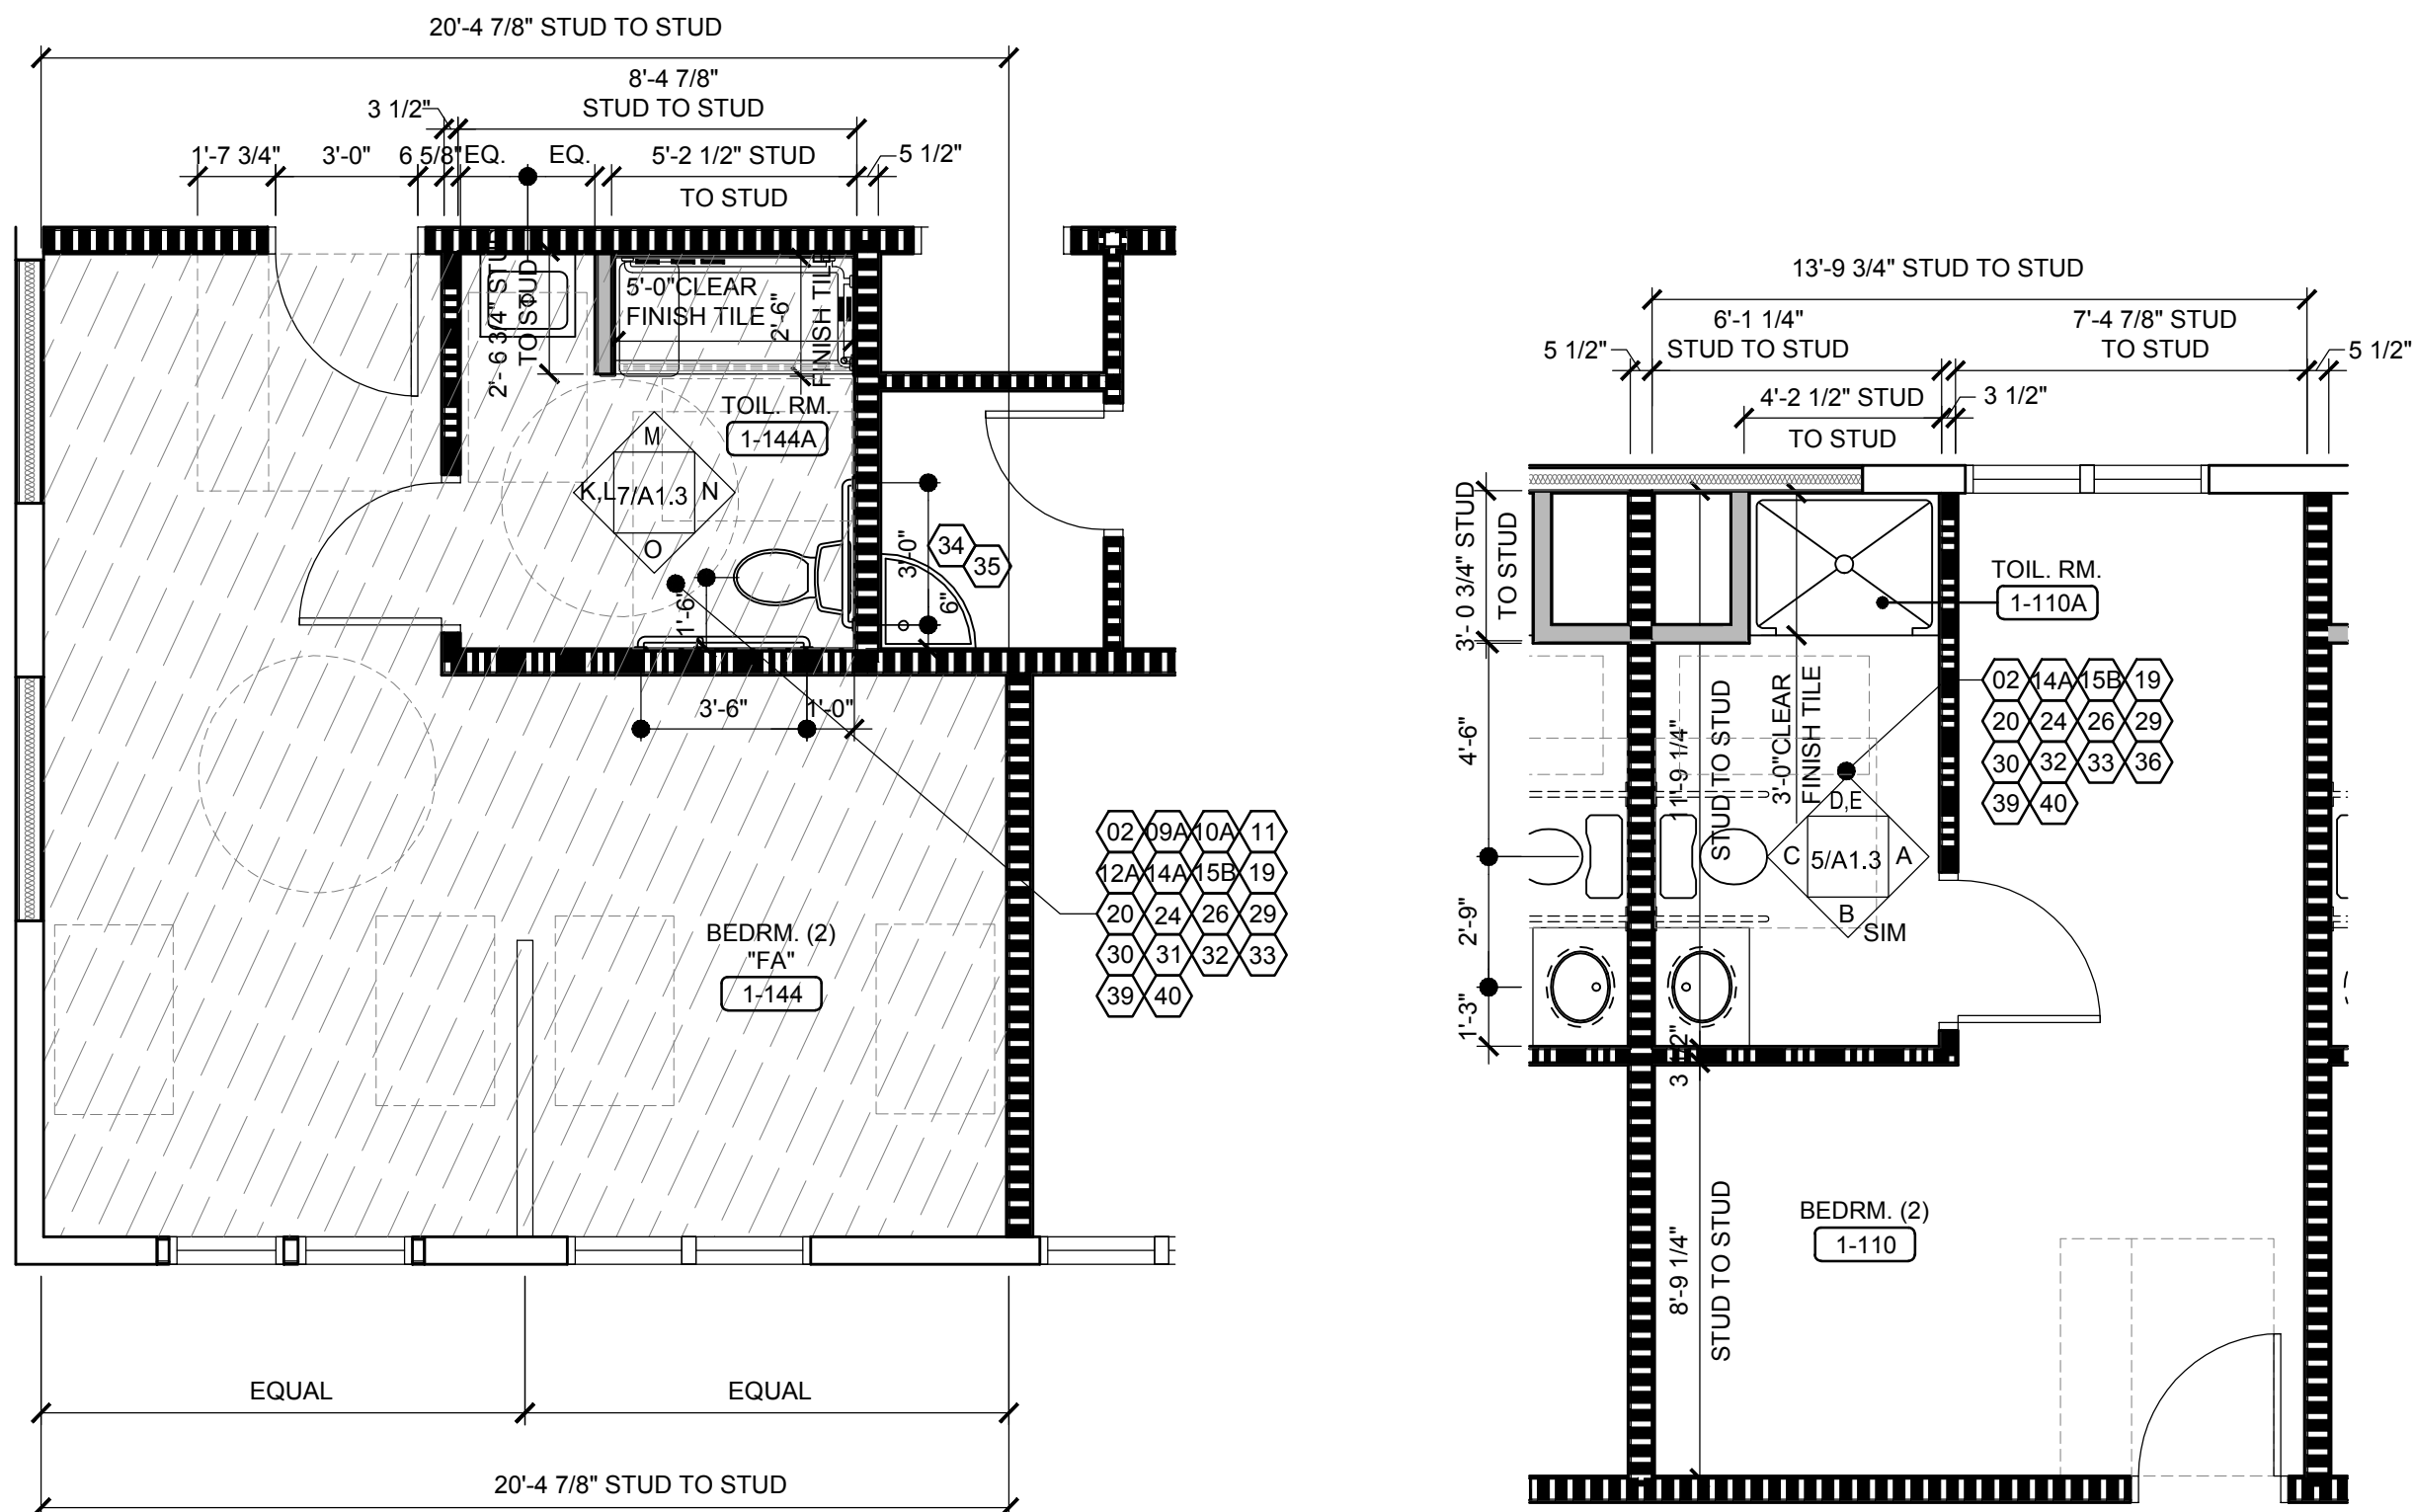

4 TYPICAL ACCESSIBLE BEDROOM

A-1.3 SCALE: 1/4" = 1'-0"

3 TYPICAL BEDROOM










A-1.3 SCALE: 1/4" = 1'-0"

2 TYPICAL ACCESSIBLE BEDROOM

A-1.3 SCALE: 1/4" = 1'-0"

1 TYPICAL BEDROOM

A-1.3 SCALE: 1/4" = 1'-0"

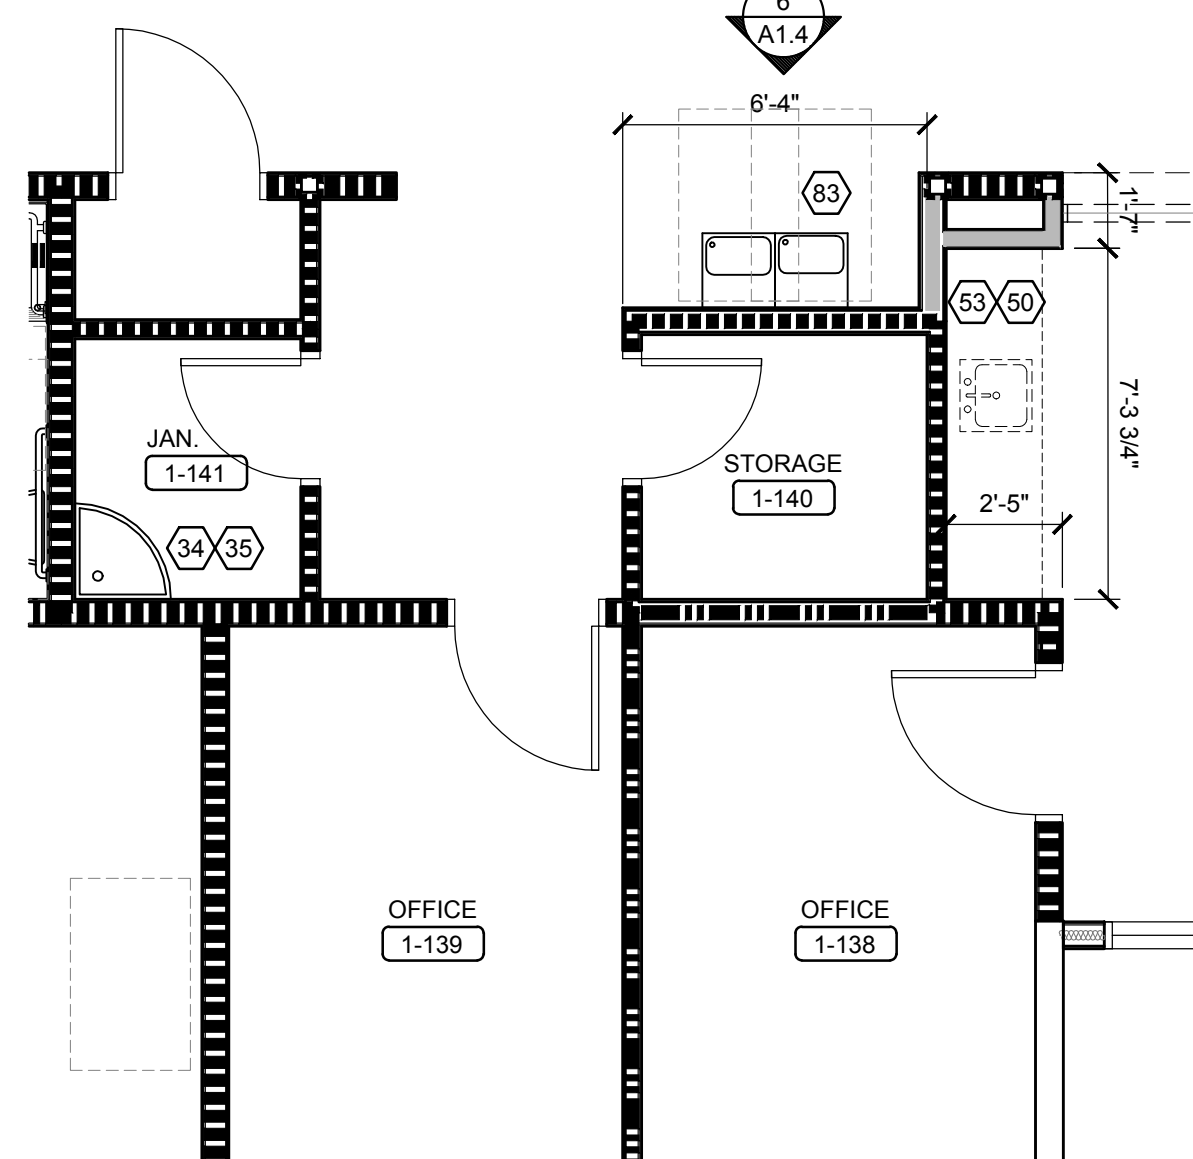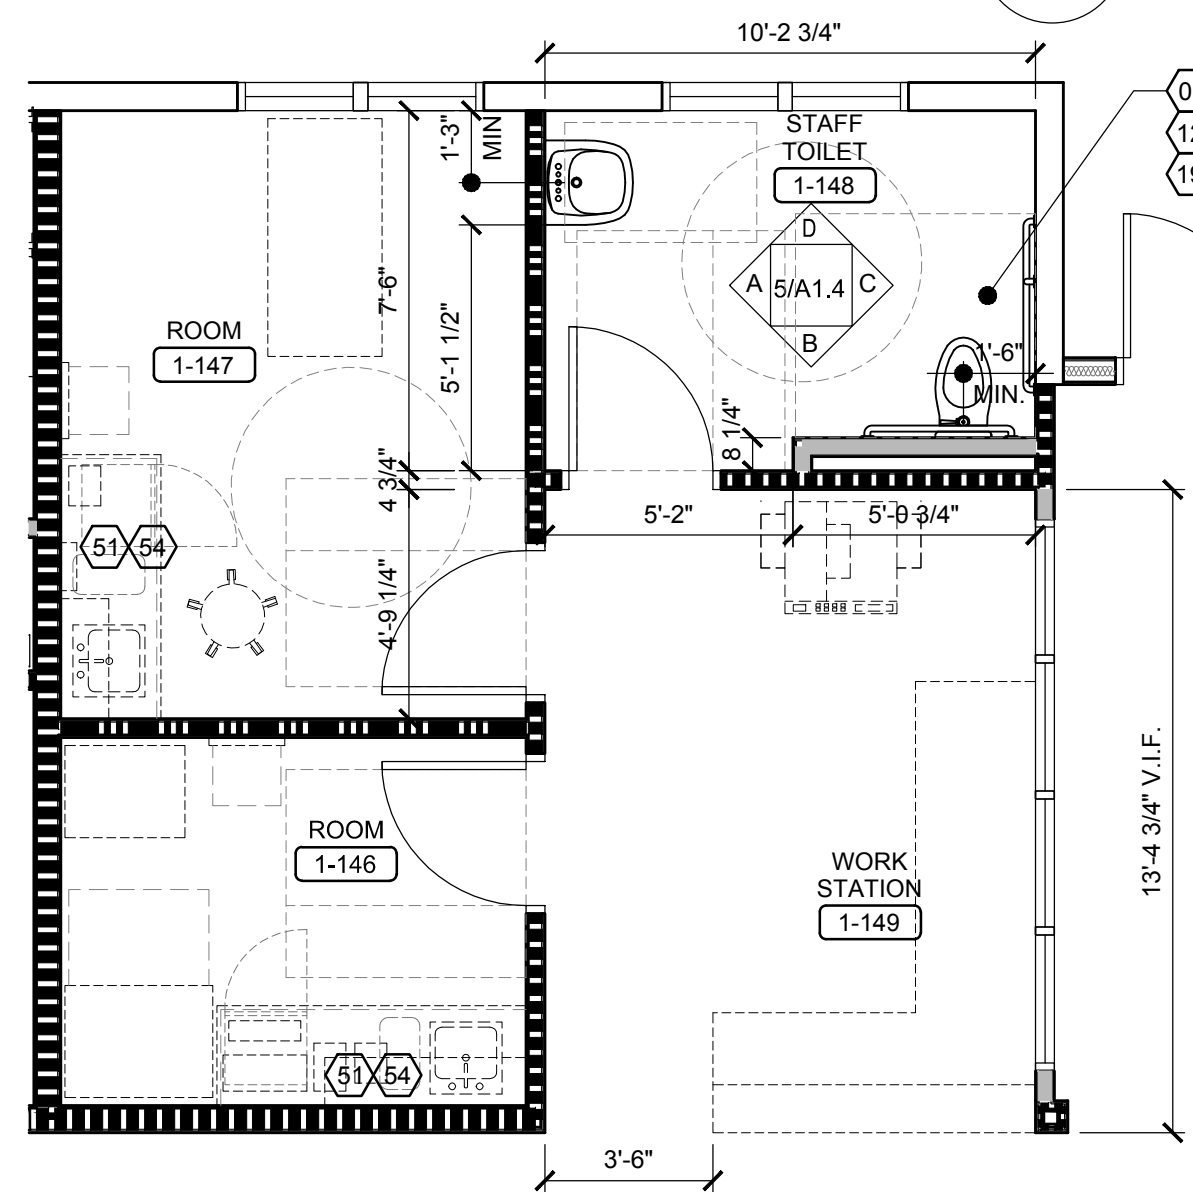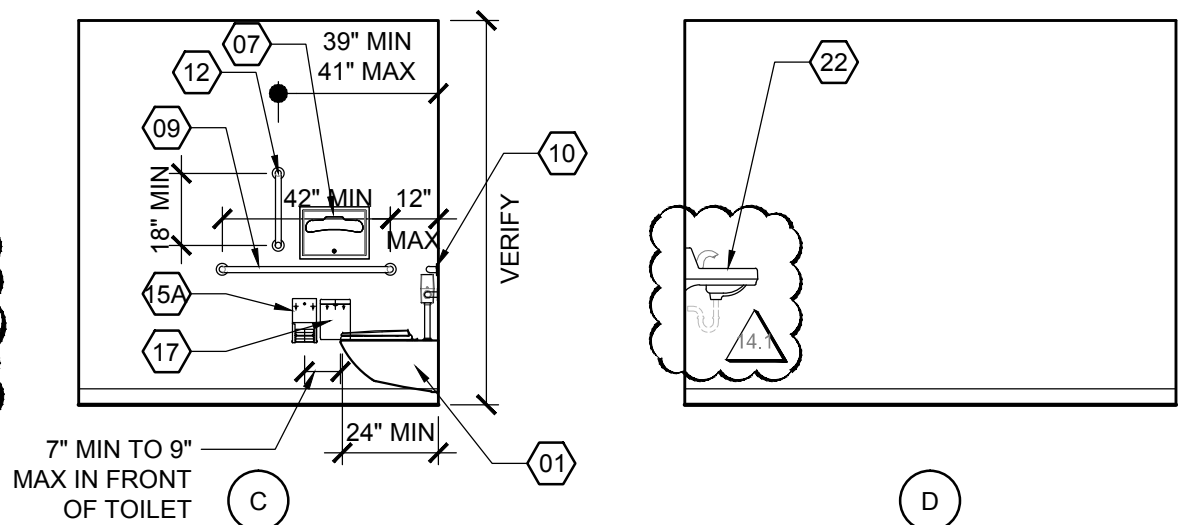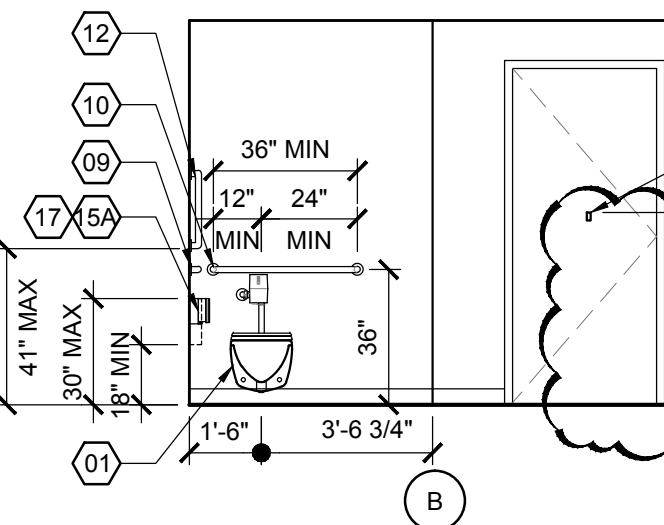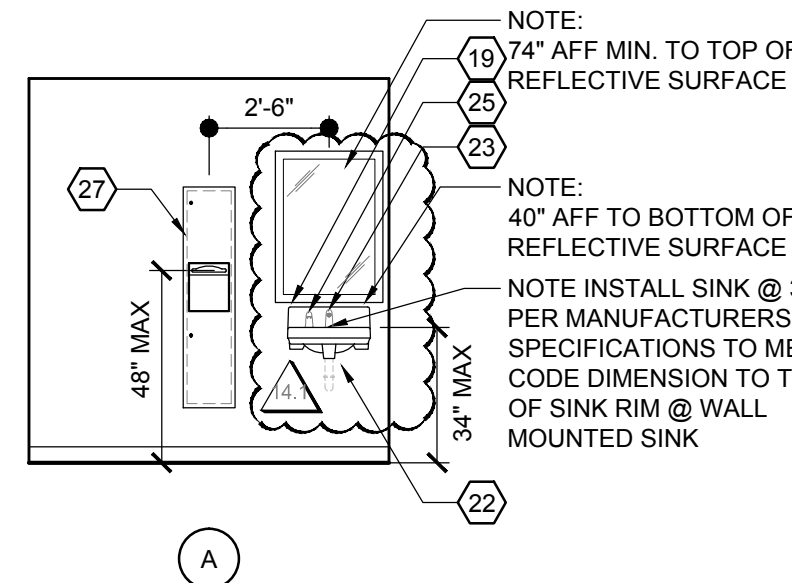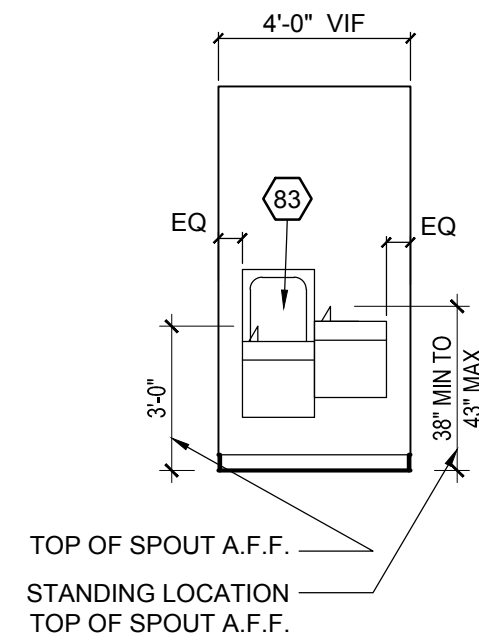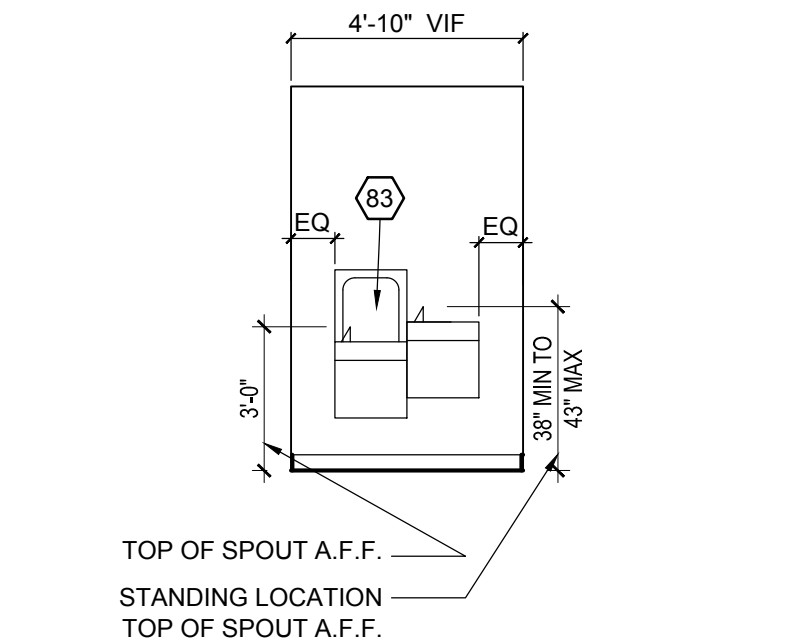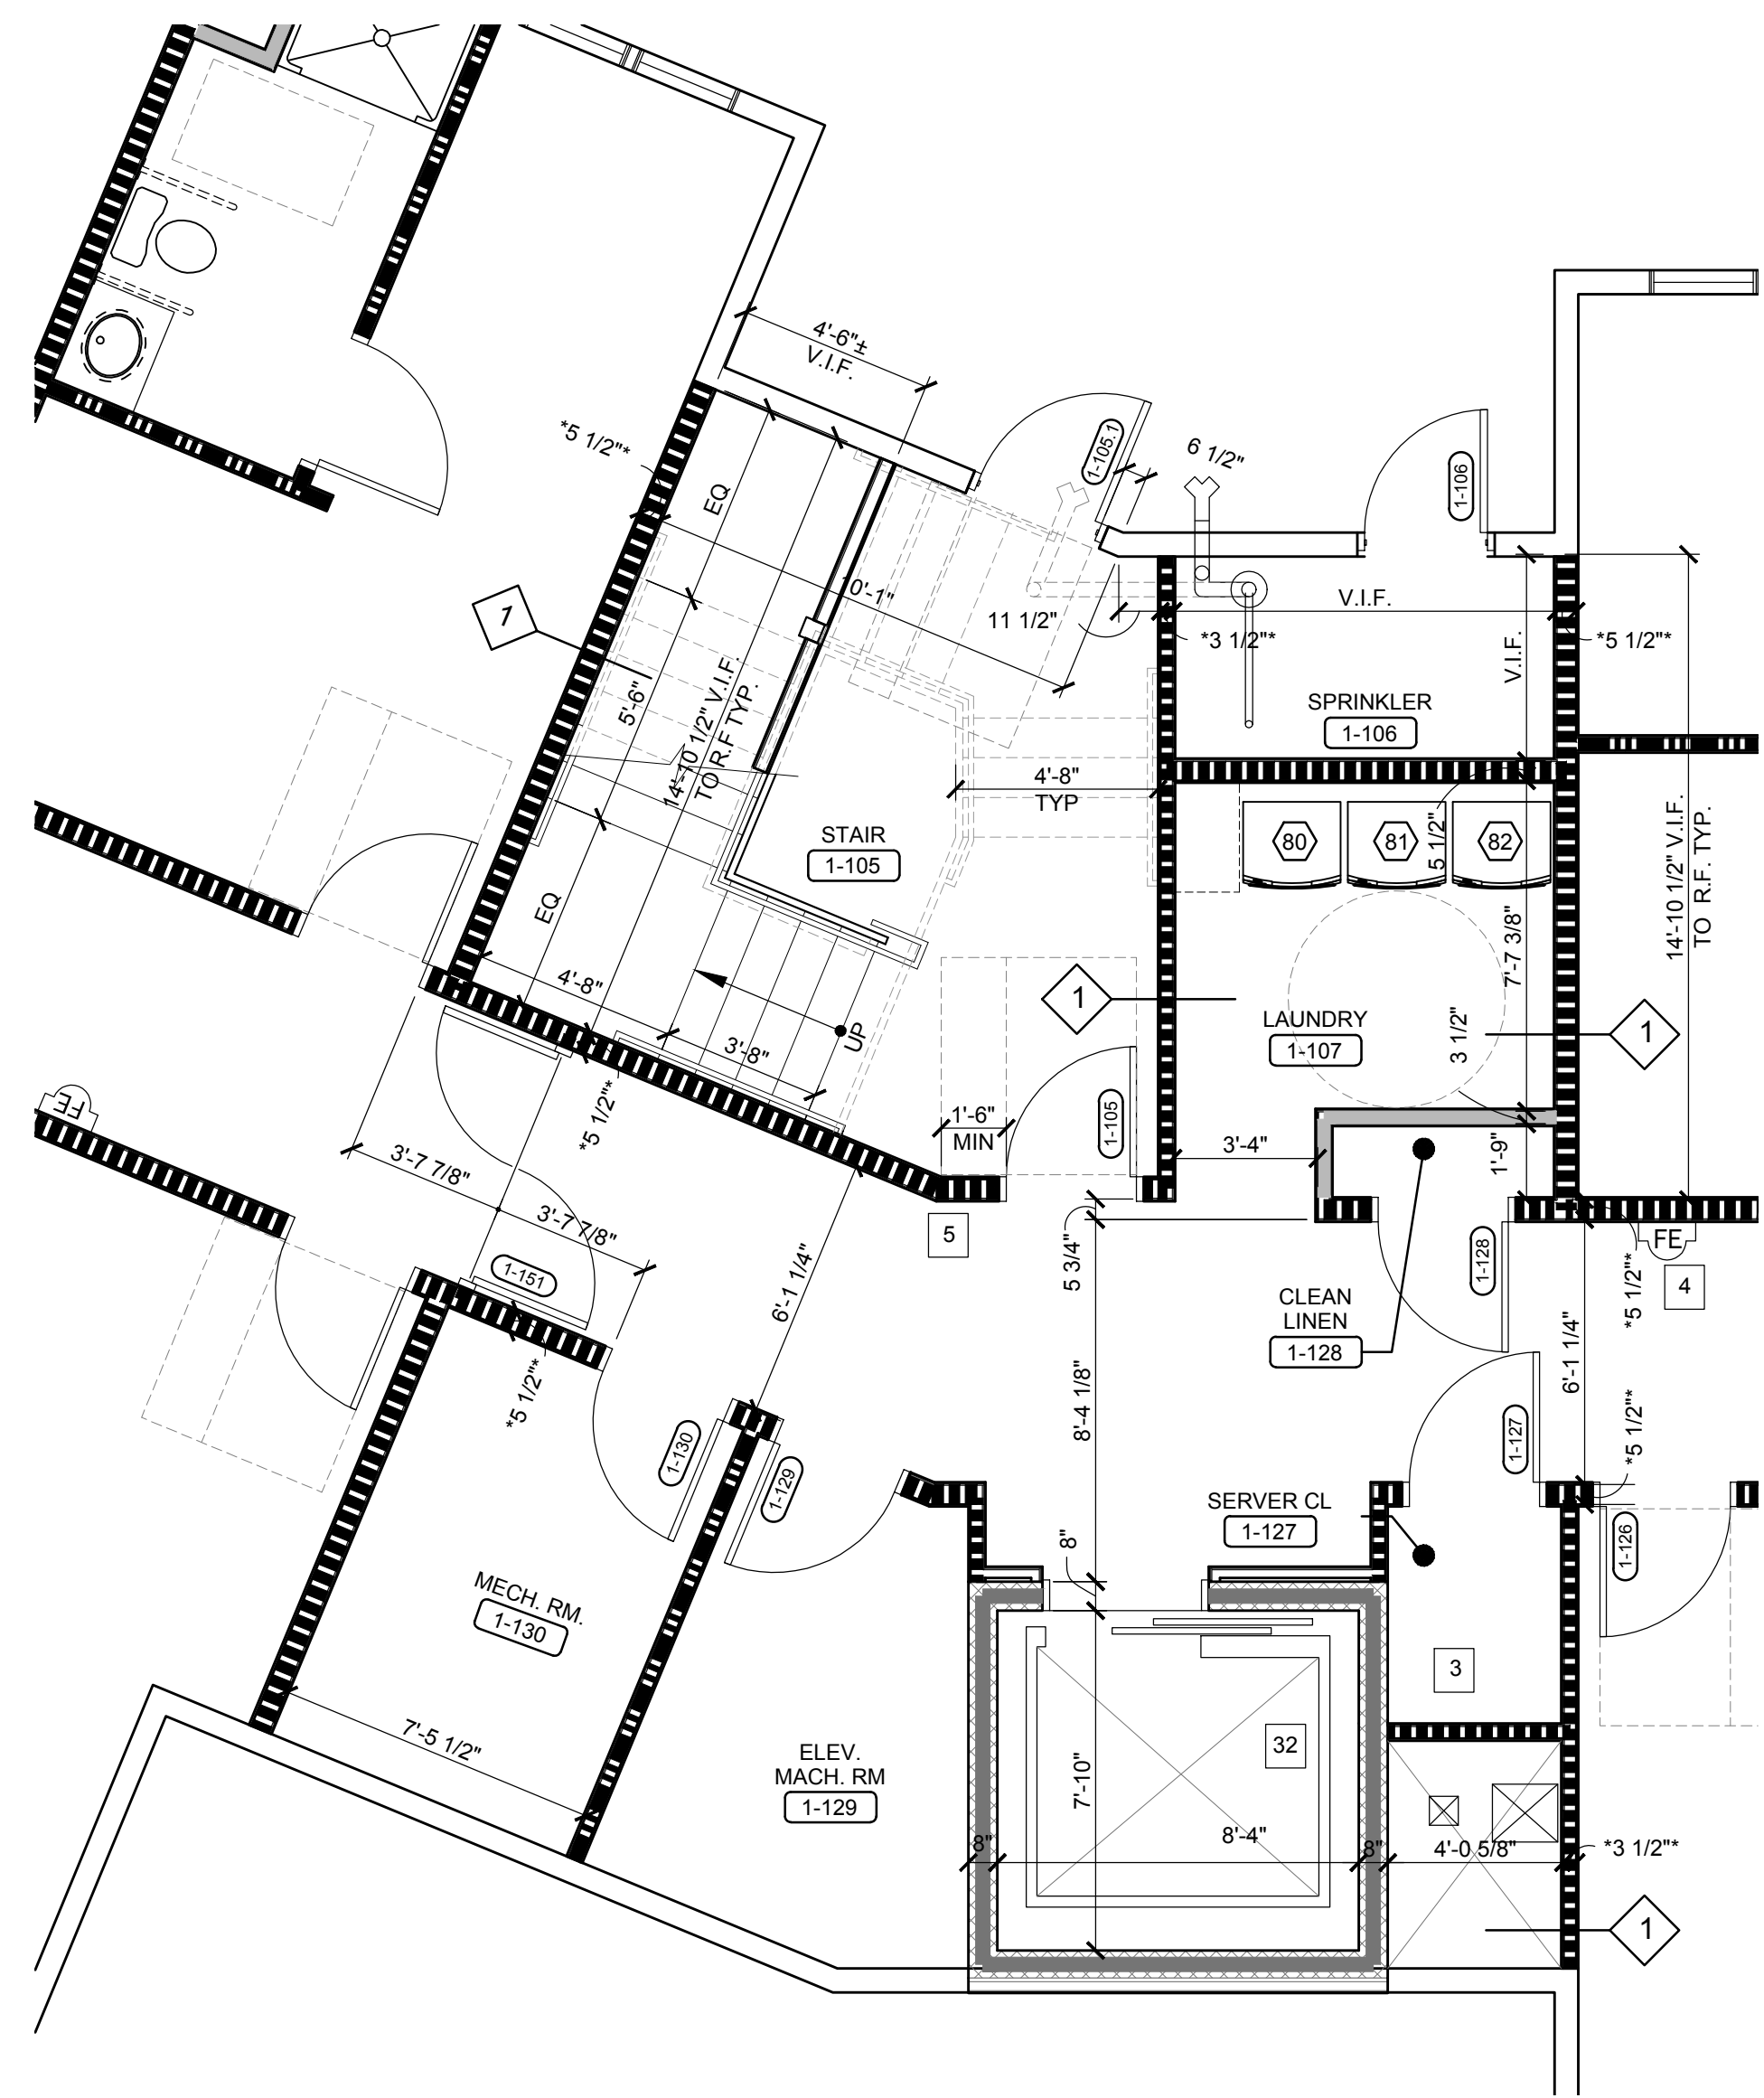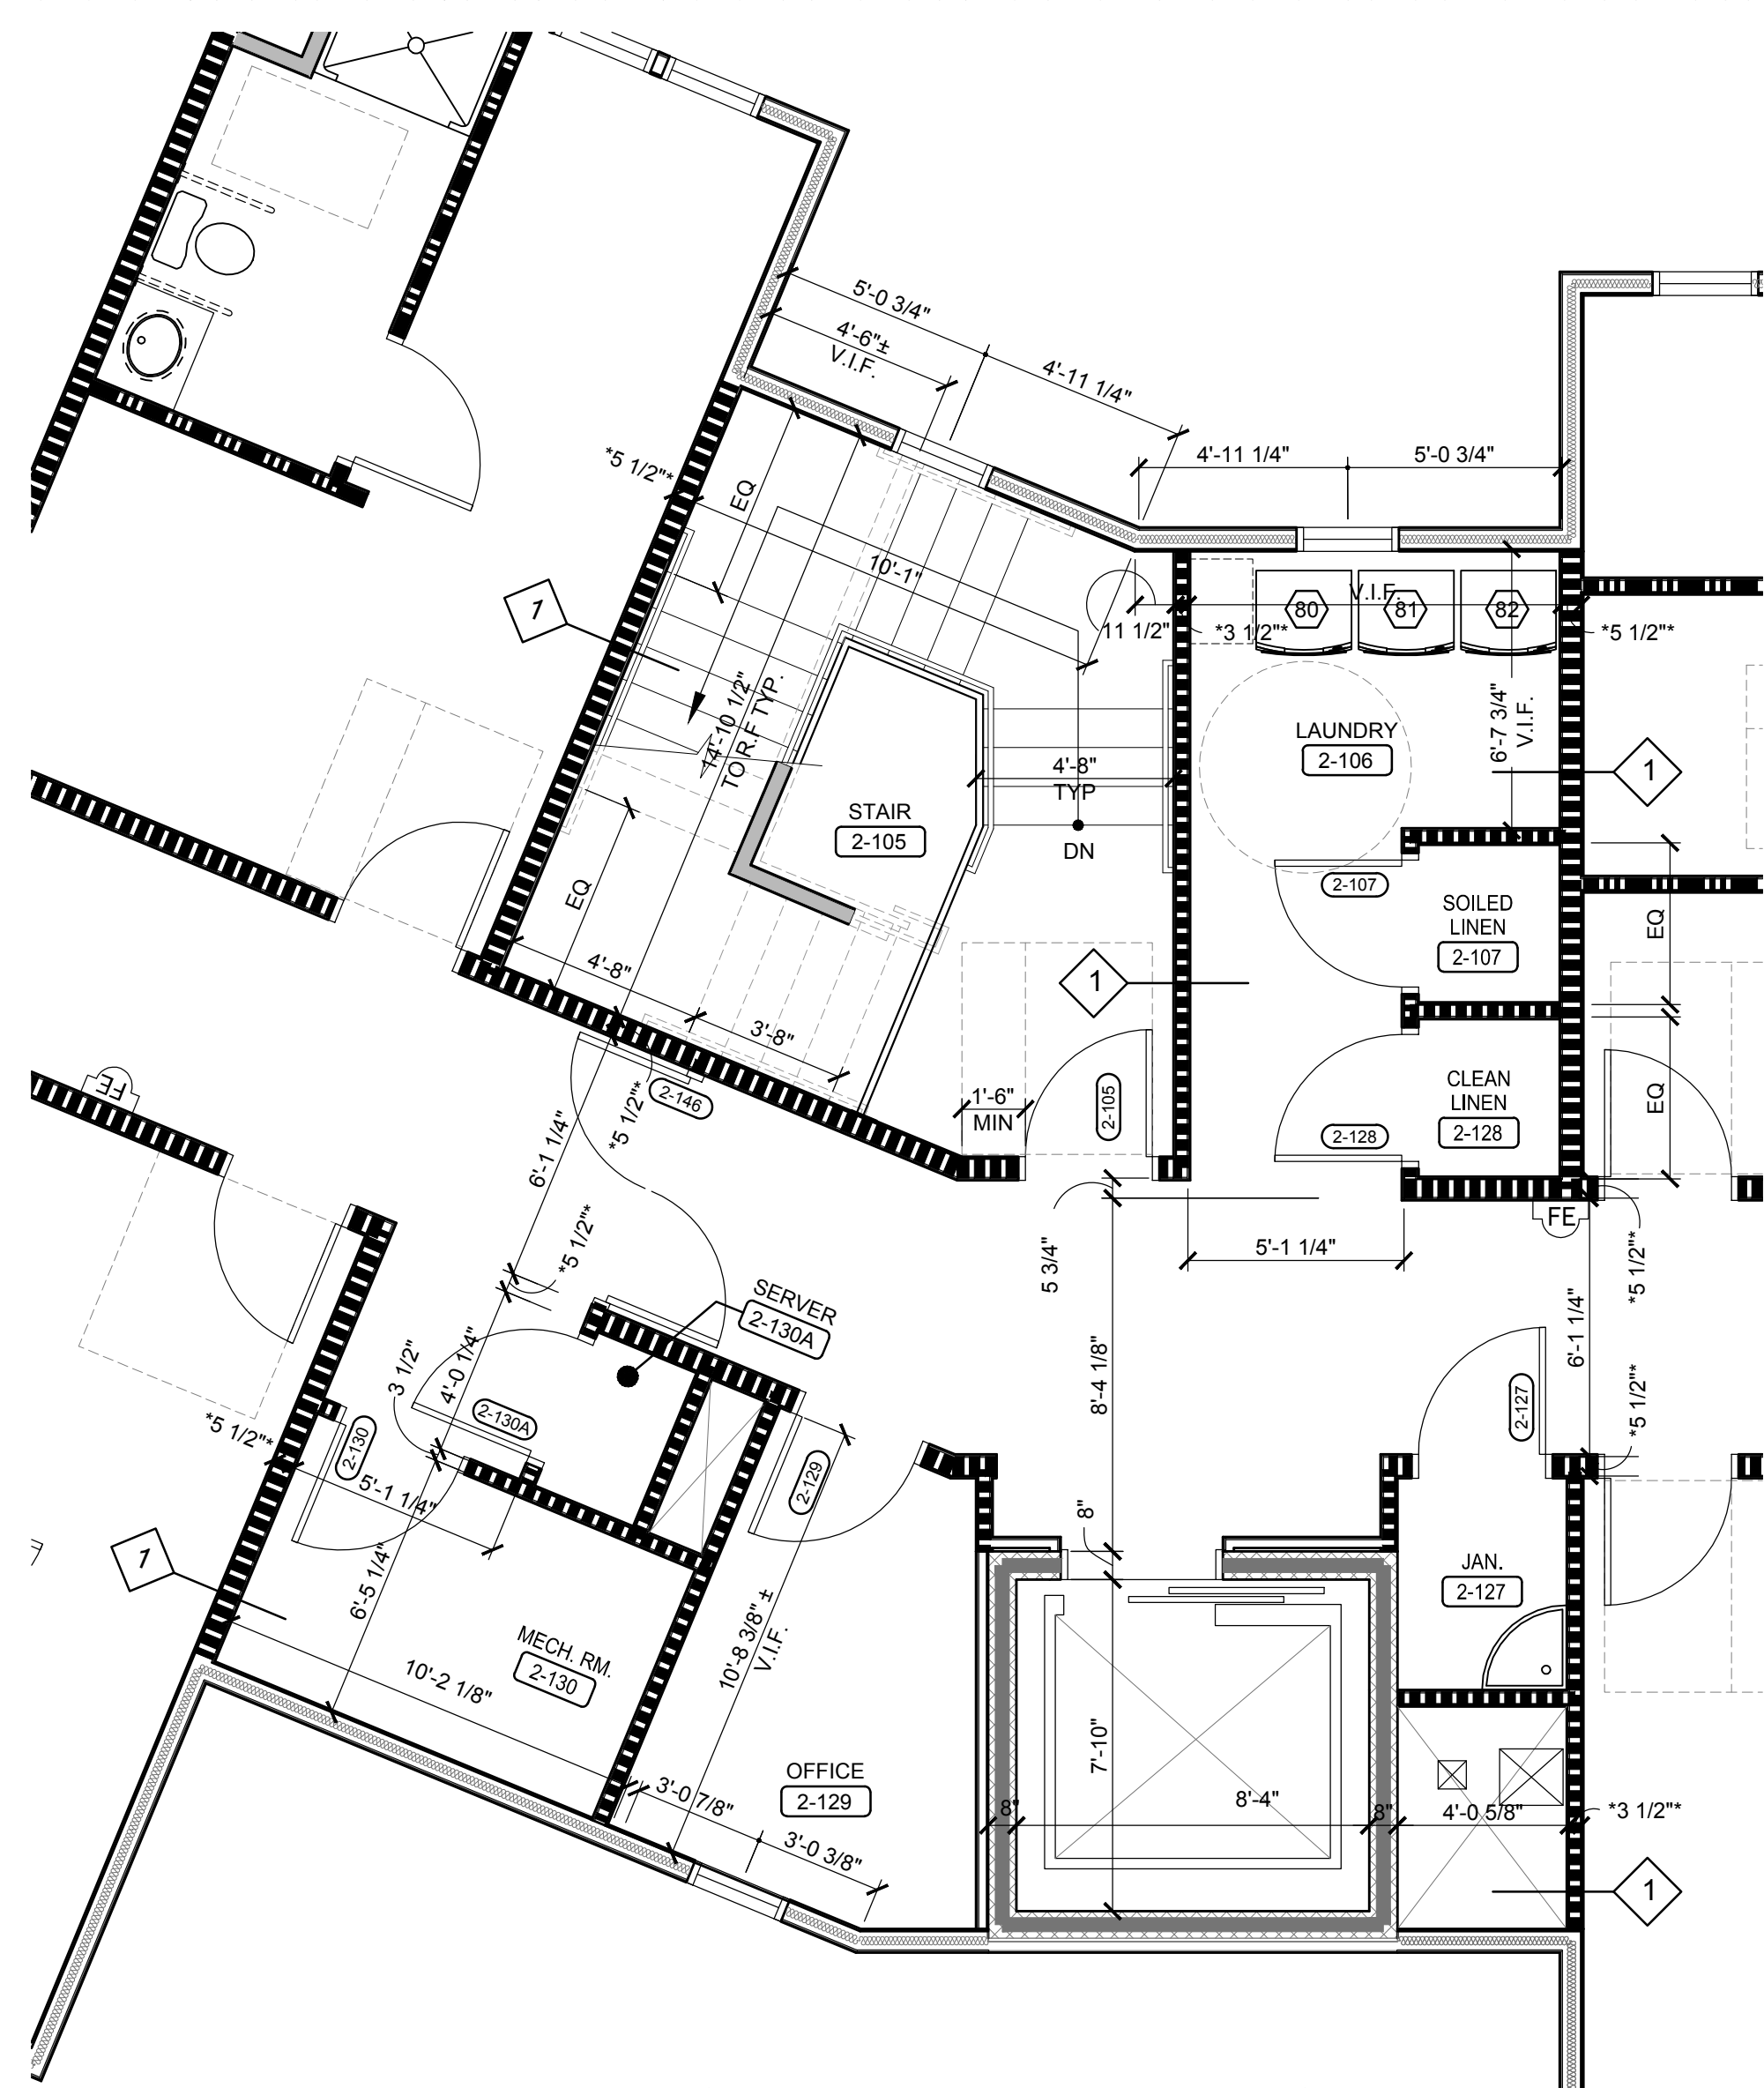

- ## GENERAL NOTES
1. COORDINATE WITH INTERIOR DESIGN DRAWINGS FOR ALL FIXTURE'S, ACCESSORIES, FINISHES AND SPECIFICATIONS.
 2. INSTALL BLYKING AS REQUIRED FOR FUTURE INSTALLATION OF GRAB BARS IN ALL TYPE "B" TOILET ROOMS.
 3. WATER CLOSETS AND URINALS SHALL BE VITREOUS CERAMIC CHINA TYPICAL.
 4. TOILET ACCESSORIES TO BE POLISHED CHROME.
 5. SHOWERS - ALL SHOWERS TO RECEIVE TILED WALLS, SEE INTERIOR DESIGN DRAWINGS FOR SPECIFICATIONS.
 6. ALL ACCESSORIES TO BE COORDINATED FOR CLEARANCES AROUND TOILET PARTITION DOORS AND DOOR SWINGS.
 7. MOUNT / INSTALL ALL OF THE EQUIPMENT AS REQUIRED TO BE ADAAG / ANSI 117.1 COMPLIANT.
 8. PROVIDE ALL COMMON AREA TOILETS WITH WALL MOUNTED WATER CLOSET WITH HAND FREE FLUSH VALVE TOILET PUSH BUTTON HIGH EFFICIENCY FLUSHMETER VALVE.

- ## LARGE SCALE PLAN & ELEVATION NOTES
1. THE DIMENSIONS INDICATED ON THESE LARGE SCALE PLANS AND ELEVATIONS ARE FROM FINISH FACE OF GWB TO FINISH FACE OF GWB. UNLESS NOTED OTHERWISE.

- | TOILET ROOM EQUIPMENT LIST | |
|----------------------------|--|
| 01 | WALL MOUNTED ADAAG / ANSI 117.1 COMPLIANT WATER CLOSET WITH HANDS FREE FLUSH VALVE |
| 02 | FLOOR MOUNTED WATER CLOSET ADAAG / ANSI 117.1 CODE COMPLIANT WITH LEFT OR RIGHT TRIP LEVER |
| 03 | WALL MOUNTED ADAAG / ANSI 117.1 COMPLIANT URINAL WITH HANDS FREE FLUSH VALVE |
| 04 | WALL MOUNTED URINAL WITH HANDS FREE FLUSH VALVE |
| 05 | PAINTED METAL FLOOR MOUNTED TOILET PARTITIONS AND DOORS |
| 06 | PAINTED METAL WALL MOUNTED URINAL SCREEN |
| 07 | RECESSED TOILET SEAT COVER DISPENSER |
| 08 | HORIZONTAL WALL MOUNTED 48" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS |
| 09 | HORIZONTAL WALL MOUNTED 42" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PUBLIC TOILET ROOMS) |
| 09A | HORIZONTAL WALL MOUNTED 42" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET ROOMS) |
| 10 | HORIZONTAL WALL MOUNTED 36" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PUBLIC TOILET ROOMS) |
| 09A | HORIZONTAL WALL MOUNTED 36" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET ROOMS) |
| 11 | HORIZONTAL WALL MOUNTED 18 - 21" ADAAG / ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE ROLL IN SHOWER) |
| 12 | VERTICAL WALL MOUNTED 18" ANSI 117.1 COMPLIANT GRAB BARS (PUBLIC TOILET AND PUBLIC SHOWER) |
| 12A | VERTICAL WALL MOUNTED 18" ANSI 117.1 COMPLIANT GRAB BARS (PRIVATE TOILET AND SHOWER) |
| 13 | (1) ONE CONTINUOUS HORIZONTAL WALL MOUNTED GRAB BAR LH / RH SEE PLAN AT TRANSFER SHOWER, AS REQUIRED ADAAG / ANSI 117.1 COMPLIANT. |
| 14 | COAT HOOK ON BACK OF ALL TOILET PARTITION DOORS (ONE PER STALL). SEE INTERIOR DRAWINGS FOR DETAILS. |
| 14A | PATIENT TOILET ROOMS/SINGLE PUBLIC TOILET ROOM COAT HOOKS. SEE INTERIOR DRAWINGS FOR MOUNTING LOCATIONS. |
| 15 | SURFACE MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PUBLIC GANG TOILETS |
| 15A | RECESSED MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PUBLIC TOILET ROOMS |
| 15B | SURFACE MOUNTED ADAAG / ANSI 117.1 COMPLIANT DOUBLE TOILET PAPER DISPENSER FOR PRIVATE TOILET ROOMS |
| 16 | NOT USED  |
| 17 | SURFACE MOUNTED SANITARY NAPKIN DISPOSAL FOR WOMEN'S STALLS AND WOMEN'S AND UNISEX TOILET ROOMS ONLY |
| 18 | RECESSED NAPKIN / TAMPON VENDOR FOR WOMEN'S GANG TOILET ROOMS ONLY |
| 19 | WALL MOUNTED FIXED POSITION 2" FRAMED MIRROR - CODE COMPLIANT MIRROR THEFT PROOF INSTALLATION - SEE INTERIOR DRAWINGS FOR DETAILS |
| 20 | GRANITE / MARBLE / QUARTZ SURFACE / SOLID SURFACE COUNTER WITH APRON TO USE WITH AN UNDERMOUNT BOWL. INCLUDE GRID DRAIN AND P-TRAP. PROVIDE REMOVABLE CABINET FOR ACCESSIBILITY AT ALL TYPICAL BATHROOMS. |
| 21 | GRANITE / MARBLE / QUARTZ SURFACE / SOLID SURFACE COUNTER WITH SEMI - COUNTERTOP SINK WITH FAUCET, INCLUDE GRID DRAIN AND P-TRAP |
| 22 | WALL MOUNTED LAVATORY WITH FAUCET, KNEE CONTACT GUARD, INCLUDE GRID DRAIN AND P-TRAP |
| 23 | HANDS FREE CONTROL LAVATORY FAUCET MODEL |
| 24 | SINGLE LEVER SINK FAUCET - CODE COMPLIANT |
| 25 | HANDS FREE COUNTER TOP SOAP DISPENSER |
| 26 | RECESSED WALL/DECK MOUNTED SOAP DISPENSER WITH SOAP VESSEL |
| 27 | RECESSED PAPER TOWEL DISPENSER AND DISPOSAL - ADAAG / ANSI 117.1 CODE COMPLIANT |
| 28 | RECESSED PAPER TOWEL DISPENSER AND DISPOSAL |
| 29 | WALL MOUNTED TOWEL BAR - CODE COMPLIANT - INSTALL ONE PER PATIENT BATHROOM TYPICAL |
| 30 | SHOWER RECEPTOR BARRIER FREE MOLDED FIBERGLASS, 2" PNC NON CAULK DRAIN, LH / RH TO BE DETERMINED, G.C. TO VERIFY RECEPTOR COMPLIES WITH CODE FOR "PA", ROLL-IN SHOWERS, TRANSFER SHOWERS AND TYPE "B" UNITS. |
| 31 | ADULT FOLDING SHOWER SEAT - ADAAG / ANSI 117.1 CODE COMPLIANT - BARRIER FREE - SEE PLAN FOR LH / RH |
| 32 | SHOWER - HAND SHOWER SYSTEM WITH SLIDE BAR PROVIDE ALL COMPONENTS AS REQUIRED, MOUNT AS REQUIRED TO BE ADAAG / ANSI 117.1 CODE COMPLIANT |
| 33 | RECESSED SOAP/SHAMPOO/CONDITIONER DISPENSERS - ADAAG / ANSI 117.1 CODE COMPLIANT |
| 34 | SERVICE SINK |
| 35 | SERVICE SINK FAUCET & SERVICE SINK FITTINGS |
| 36 | PROVIDE BLOCKING FOR FUTURE (2) TWO SWING - UP GRAB BARS WALL MOUNTED MINIMUM 29" LONG ADAAG / ANSI 117.1 COMPLIANT GRAB BARS PROVIDE ONE SWING UP GRAB BAR WITH INTEGRAL TOILET PAPER HOLDER |
| 37 | HORIZONTAL RECESSED MOUNTED BABY CHANGING STATION - ADAAG / ANSI 117.1 CODE COMPLIANT |
| 38 | WALL MOUNTED FIXED POSITION 2" FRAMED FULL WIDTH MIRROR - CODE COMPLIANT MIRROR - THEFT PROOF INSTALLATION - SEE INTERIOR DRAWINGS FOR DETAILS |
| 39 | TYPICAL SHOWER HEAD - OPTION RAIN SHOWER |
| 40 | TYPICAL DIVERTER |

- ## ANCILLARY SINKS & FAUCETS EQMT. LIST

- ## MISCELLANEOUS EQUIPMENT LIST
- | | |
|----|--|
| 80 | FRONT ELECTRIC LOADING WASHER |
| 81 | ELECTRIC DRYER |
| 82 | STACKABLE ELECTRIC FRONT LOADING WASHER AND DRYER |
| 83 | HILL MOUNTED TOUCHLESS ADA COMPLIANT BOTTLE FILLER STATION WITH
W/LO - FILTERED COOLER, VANDAL RESISTANT & BARRIER FREE |



Recovery Centers of America

Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL UNTIL SIGNED AND SEALED.
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

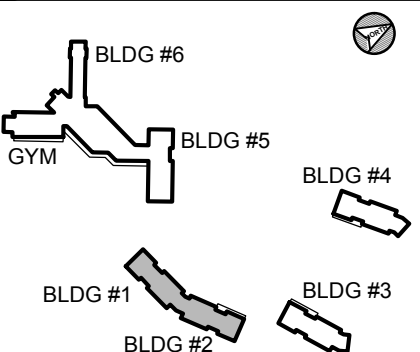

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title: 1/8"=1'-0"

RCP CLNG. HEIGHTS
BLDG.1&2 FLRS 1&2

Sheet No:

A-1.5

BILLINGSLEY BUILDINGS 1&2

REFLECTED CEILING PLAN LEGEND

- INDICATES EXTERIOR LIGHT FIXTURE
• SEE ELECTRICAL LIGHTING PLAN FOR FIXTURE TYPE
- INDICATES / CEILING IS 1 HOUR RATED
- PROVIDE GWS FIRE RATED CEILING ASSEMBLY WITH NON-RATED
ACOUSTICAL DROP CEILING WITH RECESSED LIGHT FIXTURES. SEE
INTERIOR DESIGN DRAWINGS. VERIFY FINISH CEILING HEIGHT WITH
INTERIOR DESIGN DRAWINGS RECESSED LIGHT FIXTURE
HOUSING, TYPICAL.
- SYMBOL INDICATES THE APPROXIMATE DIMENSION FROM FLOOR TO FINISH
CEILING. ALL DIMENSIONS TO FIELD VERIFIED, TYPICAL.


REFLECTED CEILING PLAN GENERAL NOTES

- SEE INTERIOR DESIGN DRAWINGS FOR CEILING FINISHES, SOFFITS, DETAILS, SECTIONS,
ETC.
- CEILING PLAN SHALL BE USED FOR FIRE RATINGS AND CEILING HEIGHTS ONLY. REFER
TO THE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE INFORMATION.
- FINAL FIXTURE SELECTION BY OWNER / INTERIOR DESIGNER.
- FINAL COLOR / FINISH SELECTION BY OWNER / INTERIOR DESIGNER.
- ALL BEARING WALLS, COLUMNS, CORRIDOR CEILINGS AND BETWEEN FLOORS SHALL BE
ONE HOUR FIRE RATED
TYPICAL CEILING / ROOF: UL DESIGN NO: P 5 2 2
TYPICAL CEILING / FLOOR: UL DESIGN NO: L 5 1 2
TYPICAL CEILING / FLOOR TRUSS: UL DESIGN NO: L 5 2 3
TYPICAL ACT CEILING / FLOOR: UL DESIGN NO: L 2 0 6
TYPICAL EXTERIOR WALL: UL DESIGN NO: U 3 2 6
TYPICAL INTERIOR WALL: UL DESIGN NO: U 3 3 3
TYPICAL COLUMNS: UL DESIGN NO: X 5 2 8
- UL DETAILS SHOWN ARE FOR REFERENCE ONLY PLEASE CONSULT THE UL DESIGN
DIRECTORY FOR COMPLETE LISTING OF MANUFACTURERS AND PROPER ASSEMBLY.
- ALL FIXTURES IN ONE HOUR FIRE RATED CEILING LOCATIONS TO BE ONE HOUR FIRE
RATED FIXTURES, TYPICAL COORDINATE LAMPING AS REQUIRED, TYPICAL.
- ALL LIGHTING, SPEAKERS, CAMERAS, DUCTWORK AND SPRINKLER HEADS SHOWN ARE
FOR REFERENCE ONLY. SEE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE
INFORMATION.




1 RCP FIRST FLOOR BUILDING'S NO. 1 & 2
A-1.5 SCALE: 1/8" = 1'-0"

- NOTE:
1. ALL LIGHTING, SPEAKERS, CAMERAS, DUCTWORK AND SPRINKLER HEADS
SHOWN ARE FOR REFERENCE ONLY.
2. SEE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE INFORMATION.

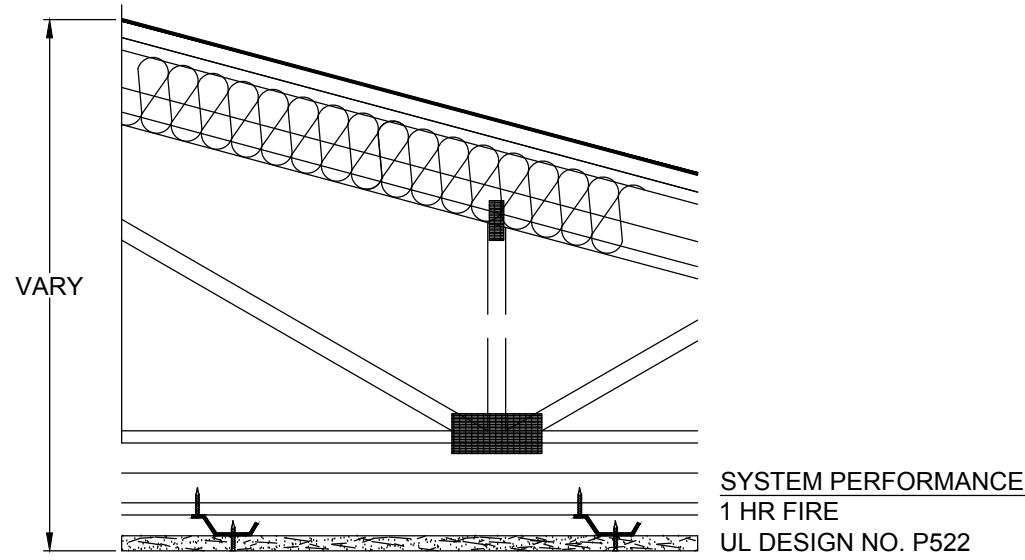


SYSTEM DESCRIPTION
ROOF CEILING ASSEMBLY
- ROOF SYSTEM OVER 15/32" PLYWOOD SHEATHING
- PITCHED OR PARALLEL CHORD WOOD TRUSSES @ 48" O.C. MAX
- OPTIONAL BATTS AND BLANKETS INSULATION
- AIR DUCT
- CEILING DAMPER
- RC-1 CHANNEL OR EQUIVALENT, 16" O.C. WITHOUT INSULATION, 12" O.C. WITH INSULATION
- INSULATION OPTIONAL IN CONCEALED SPACE DIRECTLY OVER GYPSUM CEILING MEMBRANE
USG DGL DRYWALL SUSPENSION SYSTEM
- 5/8" SHEETROCK BRAND FIRECODE "C" OR "X" CORE GYPSUM PANELS

2 DETAIL - UL DESIGN P522
A-1.6 SCALE: 1-1/2" = 1'-0" 1-HR RATING

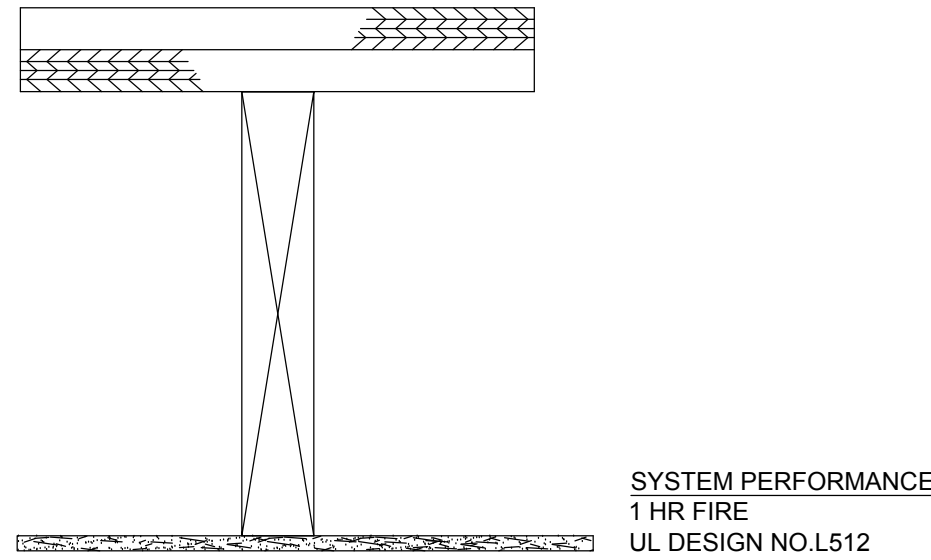


SYSTEM DESCRIPTION
DIMENSIONAL LUMBER
- FLOOR CEILING ASSEMBLY
- 23/32" NOMINAL WOOD T&G C-D SUB-FLOOR
- 3/4" GYPSUM LEVELROCK FLOOR TOPPING MIXTURE (MIN. 1800 PSI COMPRESSIVE STRENGTH)
- MIN. 2" x 10" WOOD JOIST 16" O.C.
- 5/8" SHEETROCK BRAND GYPSUM PANEL, FIRECODE "C" OR "X" CORE
ESTIMATED CEILING WEIGHT - 3 LB/SF

3 DETAIL - UL DESIGN L512
A-1.6 SCALE: 1-1/2" = 1'-0" 1-HR RATING

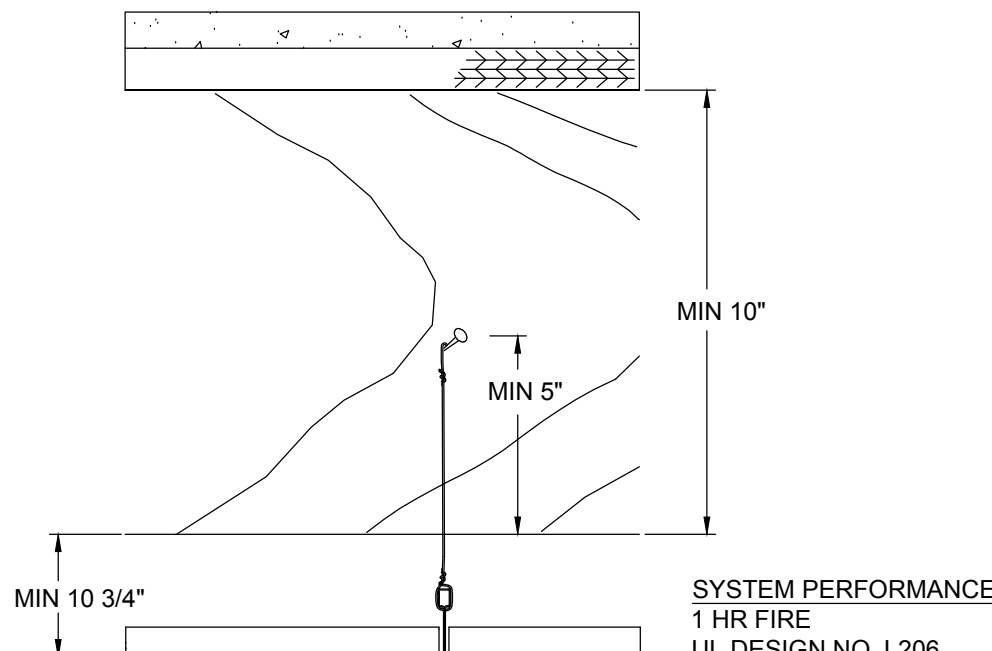


SYSTEM DESCRIPTION
DIMENSIONAL LUMBER
- 3/4" LEVELROCK BRAND FLOOR UNDERLAYMENT
- 19/32" T&G WOOD SUBFLOOR
- 2X10 WOOD JOISTS 16" O.C.
- DXL, DXLA, DXL2, DXL3A, SDXL OR SDXLA EXPOSED GRID
- 5/8" FR-83 OR 3/4" FR-X1 ACOUSTICAL CEILING PANELS OR 1/2" FC-CB GYPSUM LAY-IN PANELS

4 DETAIL - UL DESIGN L206
A-1.6 SCALE: 1-1/2" = 1'-0" 1-HR RATING

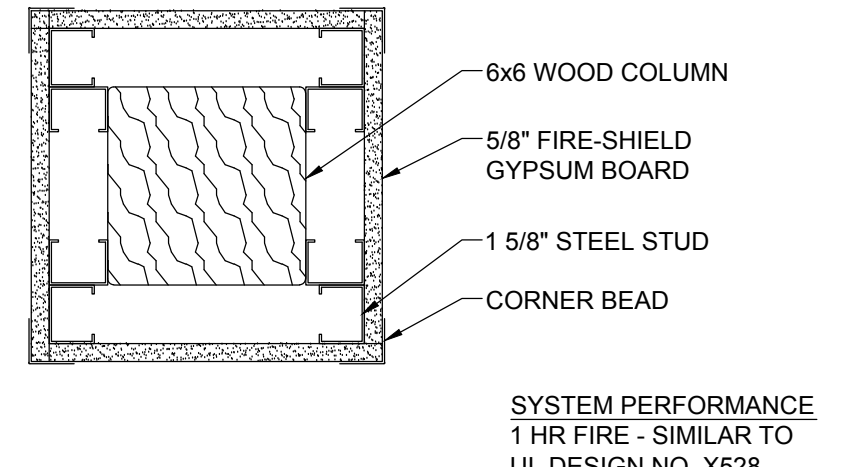

SYSTEM DESCRIPTION
WOOD COLUMN
- WOOD COLUMN PER STRUCTURAL DESIGN
- 1 5/8" LIGHT GAUGE METAL STUDS (MIN. 162S125-18)
- LENGTH TO BE 1/2" LESS THAN THE ASSEMBLY HEIGHT
- 5/8" SHEETROCK BRAND GYPSUM PANEL, FIRECODE "C" OR "X" CORE
- DRYWALL 1 1/4" METAL CORNER BEADS (TYP OF 4)
- FINISH WITH JOINT COMPOUND TO A MIN. THICKNESS OF 1/16"

5 DETAIL - UL DESIGN X528
A-1.6 SCALE: 1-1/2" = 1'-0" 1-HR RATING

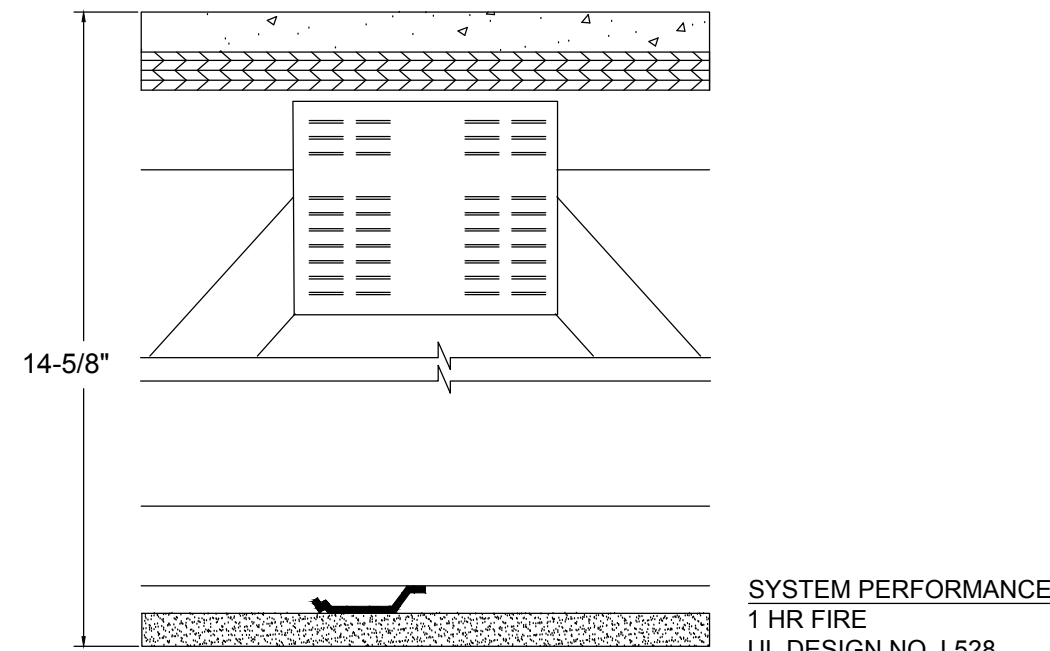

SYSTEM DESCRIPTION
FLOOR CEILING ASSEMBLY
- 3/4" LEVELROCK BRAND FLOOR UNDERLAYMENT
- 3/4" PLYWOOD FLOOR
- 12" WOOD TRUSS 24" O.C.
- RC-1 CHANNEL OR EQUIVALENT 24" O.C.
- 5/8" SHEETROCK BRAND FIRECODE C CORE GYPSUM PANELS
- JOINTS FINISHED
- OPTIONAL VENEER PLASTER

6 DETAIL - UL DESIGN L528
A-1.6 SCALE: 1-1/2" = 1'-0" 1-HR RATING

REFLECTED CEILING PLAN LEGEND

- INDICATES EXTERIOR LIGHT FIXTURE
• SEE ELECTRICAL LIGHTING PLAN FOR FIXTURE TYPE
- INDICATES / CEILING IS 1 HOUR RATED
• PROVIDE GWB FIRE RATED CEILING ASSEMBLY WITH NON-RATED ACOUSTICAL DROP CEILING WITH RECESSED LIGHT FIXTURES, SEE INTERIOR DESIGN DRAWINGS. VERIFY FINISH CEILING HEIGHT WITH INTERIOR DESIGN DRAWINGS RECESSED LIGHT FIXTURE HOUSING, TYPICAL.
- SYMBOL INDICATES THE APPROXIMATE DIMENSION FROM FLOOR TO FINISH CEILING. **ALL DIMENSIONS TO FIELD VERIFIED, TYPICAL.**

REFLECTED CEILING PLAN GENERAL NOTES

- SEE INTERIOR DESIGN DRAWINGS FOR CEILING FINISHES, SOFFITS, DETAILS, SECTIONS, ETC.
- CEILING PLAN SHALL BE USED FOR FIRE RATINGS AND CEILING HEIGHTS ONLY. REFER TO THE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE INFORMATION.
- FINAL FIXTURE SELECTION BY OWNER / INTERIOR DESIGNER.
- FINAL COLOR / FINISH SELECTION BY OWNER / INTERIOR DESIGNER.
- ALL BEARING WALLS, COLUMNS, CORRIDOR CEILINGS AND BETWEEN FLOORS SHALL BE ONE HOUR FIRE RATED
TYPICAL CEILING / ROOF: UL DESIGN NO. P 5 2 2
TYPICAL CEILING / FLOOR: UL DESIGN NO. L 5 1 2
TYPICAL CEILING / FLOOR TRUSS: UL DESIGN NO. L 5 2 8
TYPICAL ACT CEILING / FLOOR: UL DESIGN NO. L 2 0 6
TYPICAL EXTERIOR WALL: UL DESIGN NO. U 3 2 6
TYPICAL INTERIOR WALL: UL DESIGN NO. U 3 3 3
TYPICAL COLUMNS: UL DESIGN NO. X 5 2 8
UL DETAILS SHOWN ARE FOR REFERENCE ONLY PLEASE CONSULT THE UL DESIGN DIRECTORY FOR COMPLETE LISTING OF MANUFACTURERS AND PROPER ASSEMBLY.
- ALL FIXTURES IN ONE HOUR FIRE RATED CEILING LOCATIONS TO BE ONE HOUR FIRE RATED FIXTURES, TYPICAL COORDINATE LAMPING AS REQUIRED, TYPICAL.**
- ALL LIGHTING, SPEAKERS, CAMERAS, DUCTWORK AND SPRINKLER HEADS SHOWN ARE FOR REFERENCE ONLY. SEE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE INFORMATION.

1 RCP SECOND FLOOR BUILDING'S NO. 1 & 2
A-1.6 SCALE: 1/8" = 1'-0"

- NOTE:
- ALL LIGHTING, SPEAKERS, CAMERAS, DUCTWORK AND SPRINKLER HEADS SHOWN ARE FOR REFERENCE ONLY.
 - SEE APPROPRIATE DISCIPLINE DRAWINGS FOR MORE INFORMATION.



Recovery Centers of America

Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

Consultant

Key Plan

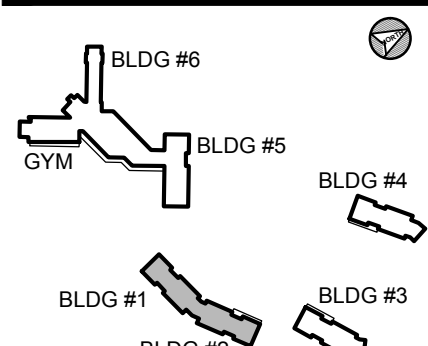

Project Type

- ☐ Alteration
- ☒ Remodel
- ☐ New Addition
- ☐ New Construction

Drawing Status

- ☐ Design Phase
- ☐ Not For Construction
- ☐ For Pricing
- ☐ For Permit
- ☒ Revision
- ☒ For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:

Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title: 1/8"=1'-0"

RCP CLNG. HEIGHTS
BLDG.1&2 FLRS 1&2

Sheet No:

A-1.6


Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal

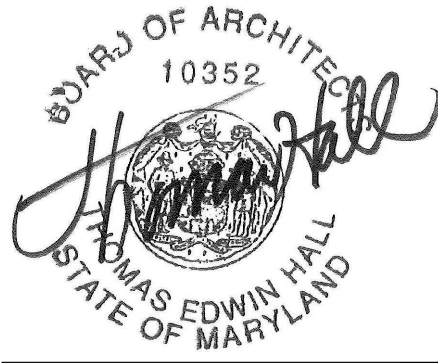

THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL. UNLESS SIGNED AND SEALED
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

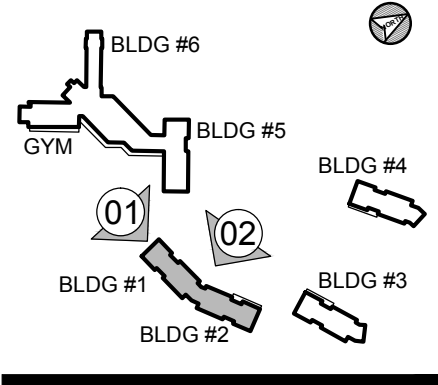

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1


Job No: 6142.00
Drawn By:

Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

BLDG. 1 & 2
ELEVATIONS

Sheet No:


A-2.0

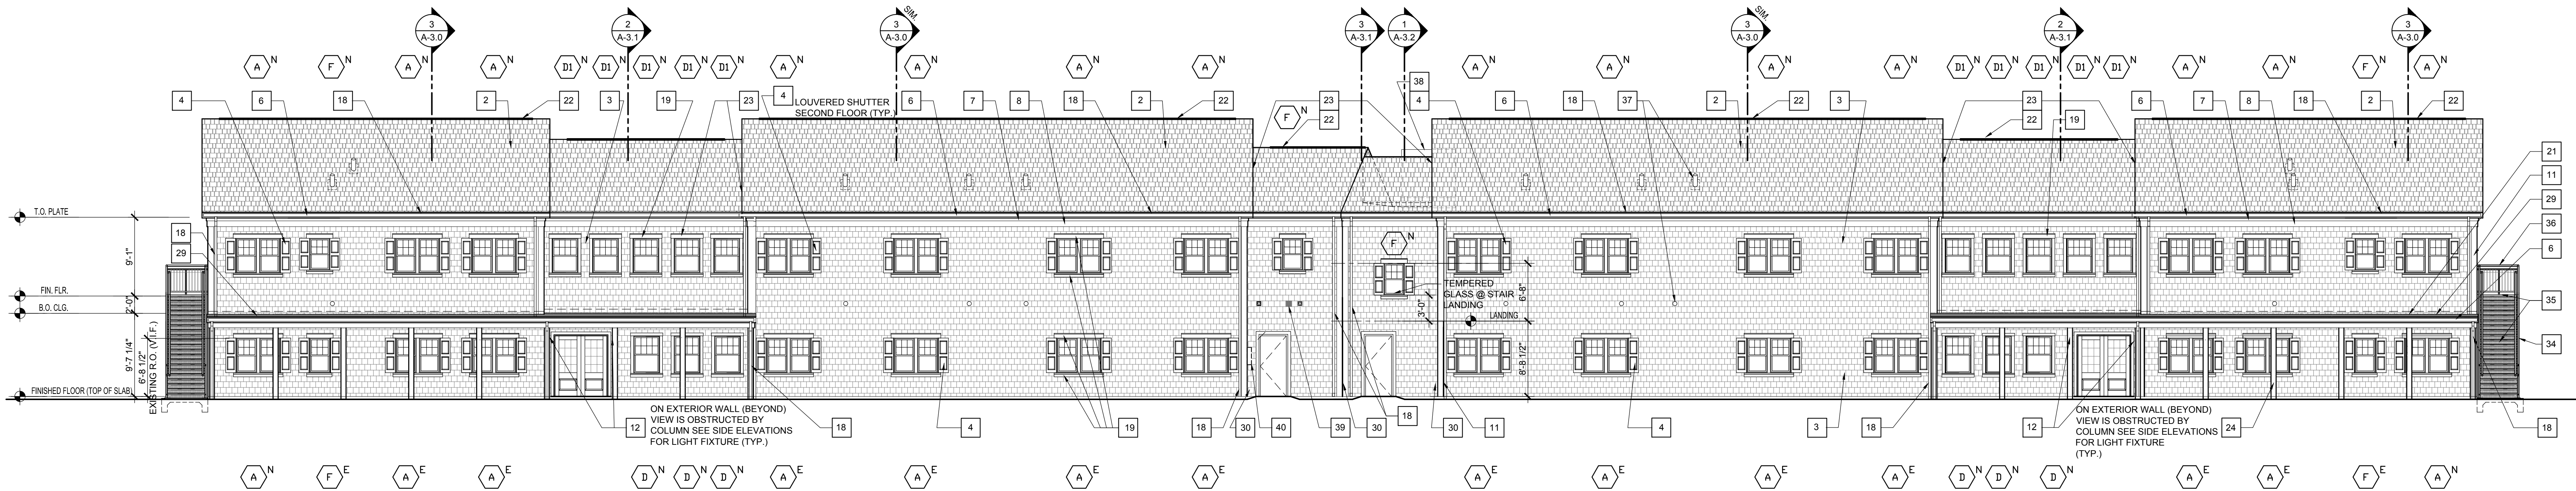


BUILDING #2

2 NEW FRONT ELEVATION (BUILDING'S 1&2)
A-2.0 SCALE: 1/8" = 1'-0"


BUILDING #1

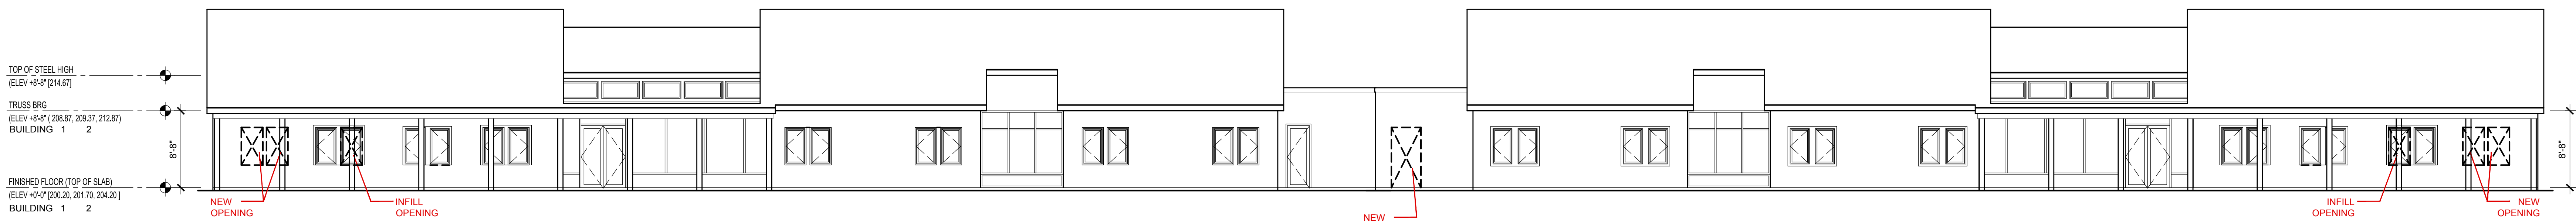

2E EXISTING FRONT ELEVATION (BUILDING'S 1&2)
A-2.0 SCALE: 1/8" = 1'-0"

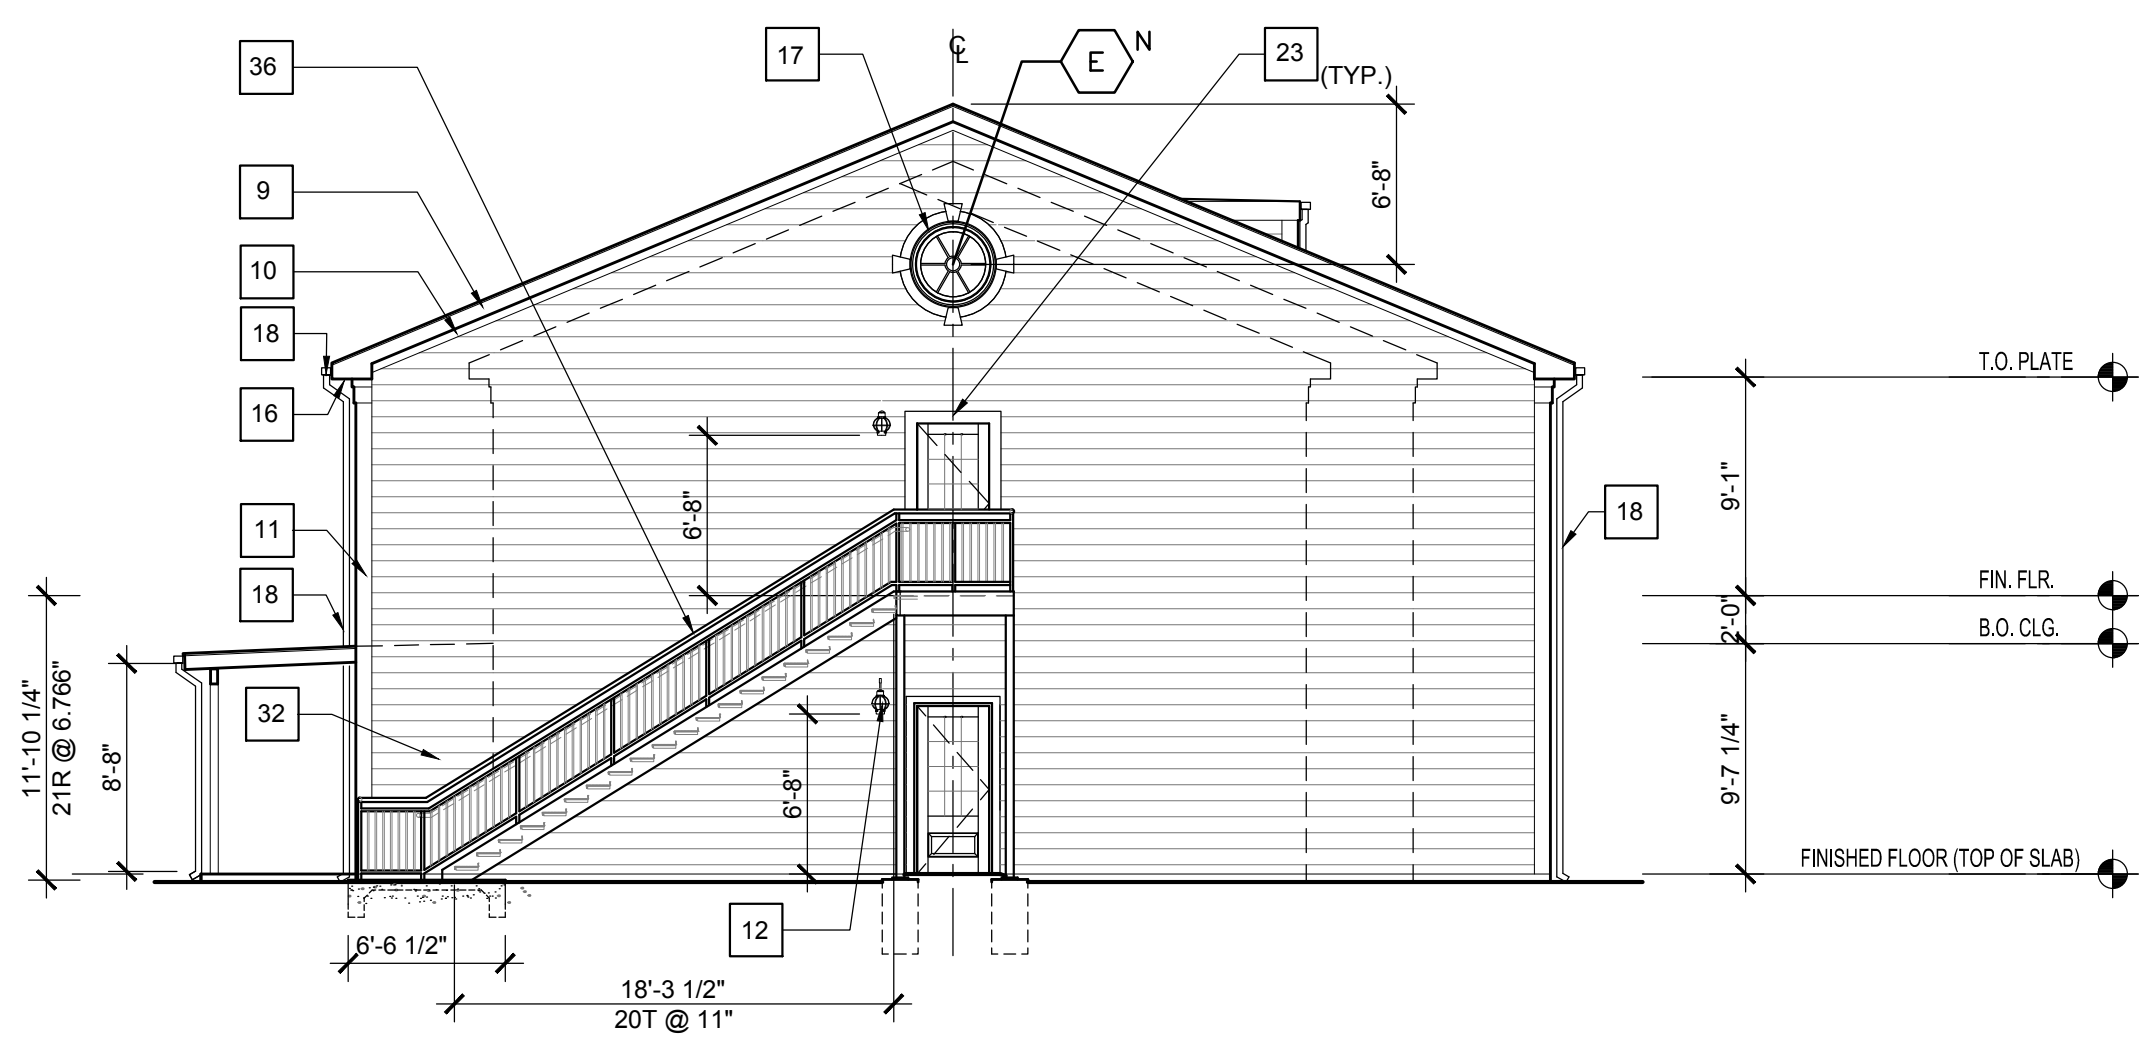

1 NEW SIDE ELEVATION (BUILDING'S 1&2)
A-2.0 SCALE: 1/8" = 1'-0"

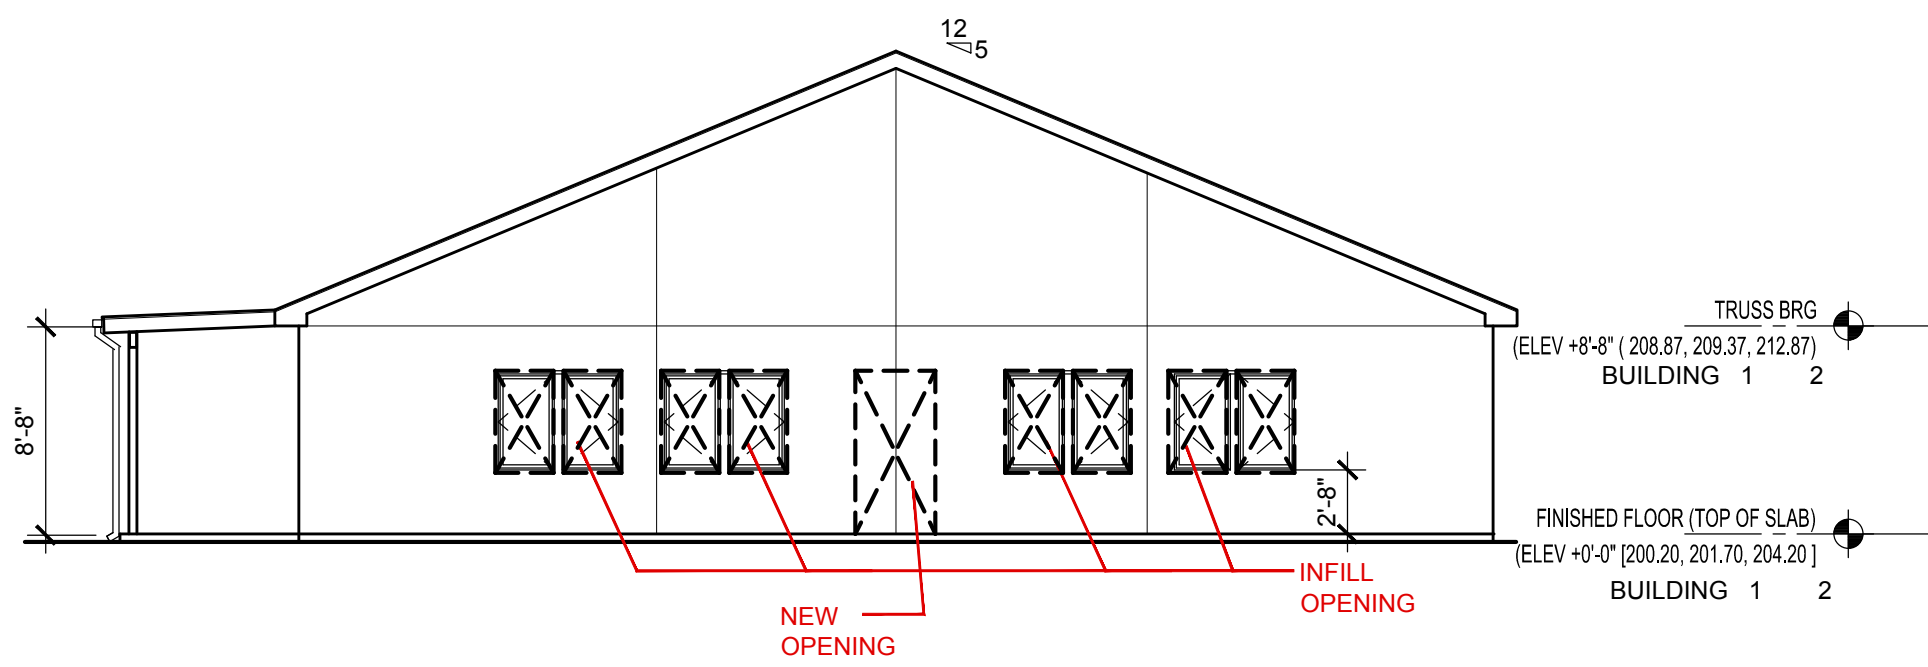

1E EXISTING SIDE ELEVATION (BUILDING'S 1&2)
A-2.0 SCALE: 1/8" = 1'-0"

WINDOW KEY LEGEND

- E EXISTING WINDOW OPENING, WITH NEW WINDOWS, G.C. TO FIELD
VERIFY EXISTING R.O. PRIOR TO ORDERING NEW WINDOWS.
N NEW WINDOW OPENING, WITH NEW WINDOWS, G.C. TO MATCH
NEW WINDOW R.O. WITH EXISTING, FIELD VERIFY EXISTING R.O.
PRIOR TO ORDERING NEW WINDOWS.
E = EXISTING ROUGH OPENING
N = NEW ROUGH OPENING

ELEVATION NOTES

- TOP OF STEEL GUARD 42" ABOVE FINISH ROOFING, 1 1/2" DIA STEEL PIPE TYPICAL, ANCHOR TO SOLID BLOCKING AT ALL PIPE LOCATIONS. STEEL TO BE PAINTED BY MANUFACTURER. SEE ALSO STRUCTURAL DRAWINGS.
- NATURAL SHADOW SHINGLES
- SHINGLE SIDING - (HARDIE PLANK) STRAIGHT EDGE PANEL 7" EXPOSURE OR EQUAL
- SHUTTERS - MID AMERICA OR EQUAL LOUVER SHUTTERS 14 1/2" WIDE PANELED SHUTTER FIRST AND SECOND FLOORS (COORDINATE SHUTTER HEIGHT WITH WINDOW HEIGHT)
- NOT USED
- FASCIA BOARD - 1 X 8 (AZEK OR EQUAL)
- SUB FASCIA BOARD - 1 X 4 (AZEK OR EQUAL)
- SUB FASCIA BOARD - 1 X 12 - 8" EXPOSURE (AZEK OR EQUAL)
- RAKE BOARD - 1 X 8 (AZEK OR EQUAL)
- SUB RAKE BOARD - 1 X 4 (AZEK OR EQUAL)
- CORNER TRIM - 5/4 X 8 (AZEK OR EQUAL)
- LIGHT FIXTURE - (VAXCEL LIGHTING/ OR EQUAL) OW21861BN NAUTICAL 7"
- NOT USED
- NOT USED
- CONTINUOUS 2" VENT W/ AZEK TRIM ON BOTH SIDES
- AZEK TRIM
- NEW GUTTER AND DOWNSPOUTS (USE SAME LOCATIONS OR AS NOTED OTHERWISE)
- WINDOW CASING TRIM 5/4 X 4 @ JAMB, 5/4 X 6 AT HEAD W/ DRIP CAP TRIM & HISTORIC SILL TRIM PROFILE W/ 5/4" X 4" APRON (AZEK OR EQUAL) SEE DETAILS 3/ A-6.0 AND 4/ A-6.0 NOT USED
- CONCEALED METAL FLASHING INSTALL AS PER SIDING MANUFACTURER SPECIFICATIONS
- NEW CONTINUOUS RIDGE VENT
- CONTINUOUS METAL FLASHING (OVER WINDOWS AND AS SHOWN ON ELEVATIONS)
- VERIFY EXISTING POST CONDITION IS REUSABLE PRIOR TO INSTALLING AZEK PER LATTICE DETAILS, SEE 1/A-4.2
- .050 ALUMINUM TWO PIECE PRE-FINISHED ALUMINUM ROOF EDGE
- REPLACE WITH NEW AZEK BOARD
- REPLACE SUBSTRATE AS REQUIRED
- AIR VENT (CLOSED)
- NOT USED
- VERIFY EXISTING SUBSTRATE & ROOF FRAMING IS IN GOOD CONDITION PRIOR TO INSTALLING TPO ROOFING INSTALL PER MFR. SPEC. & WARRANTY
- NEW POST INSTALL AZEK PER LATTICE DETAILS SEE: 3/A-4.2, 4/A-4.2, 5/A-4.2 TYPICAL
- NOT USED
- 8" HORIZONTAL SIDING W/ 8" CORNER TRIM (CERTAIN TEED CAROLINA BEADED VINYL SIDING OR EQUAL)
- NOT USED
- NEW STEEL EXIT STAIR TO GRADE W/ GUARDS & HANDRAILS PRIMED AND PAINTED IRON WORK BY MANUFACTURER TYP.
- OPEN GRATE LANDINGS AND TREADS 1/2" DIA. MAXIMUM SPACING. PERFORATED METAL SHEET CLOSED RISERS TYP.
- TOP OF GUARDRAIL @ 42" & TOP OF HANDRAILS @ 34" ABOVE LANDING AND NOSING TYPICAL
- BATHROOM EXHAUST VENT WALL/ROOF INSTALL PER CODE. SEE MECHANICAL DRAWINGS
- ROOF TOP EQUIPMENT SEE MECHANICAL AND STRUCTURAL DRAWINGS
- DRYER VENT, INSTALL PER CODE
- NEW GAS METER, PLUMBING CONTRACTOR TO COORDINATE, SEE PLUMBING DRAWINGS


Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602

TEH
ARCHITECTS

Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal

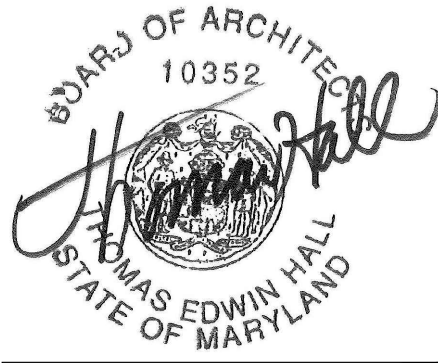

THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL. UNLESS SIGNED AND SEALED
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

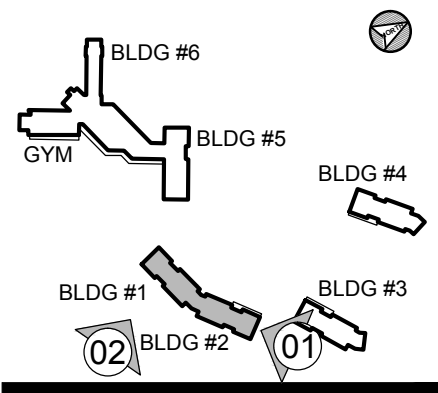

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
10	06/03/2016	REVISION #10
11	07/07/2016	REVISION #11
12	07/27/2016	REVISION #12
13	09/16/2016	REVISION #13
14	01/06/2017	REVISION #14
15	02/03/2017	ADDENDUM #1

Job No: 6142.00

Drawn By:

Checked By: TEH

Date: 17 FEB 03

Scale: AS NOTED


Drawing Title:

BLDG. 1 & 2

ELEVATIONS


Sheet No:

A-2.1

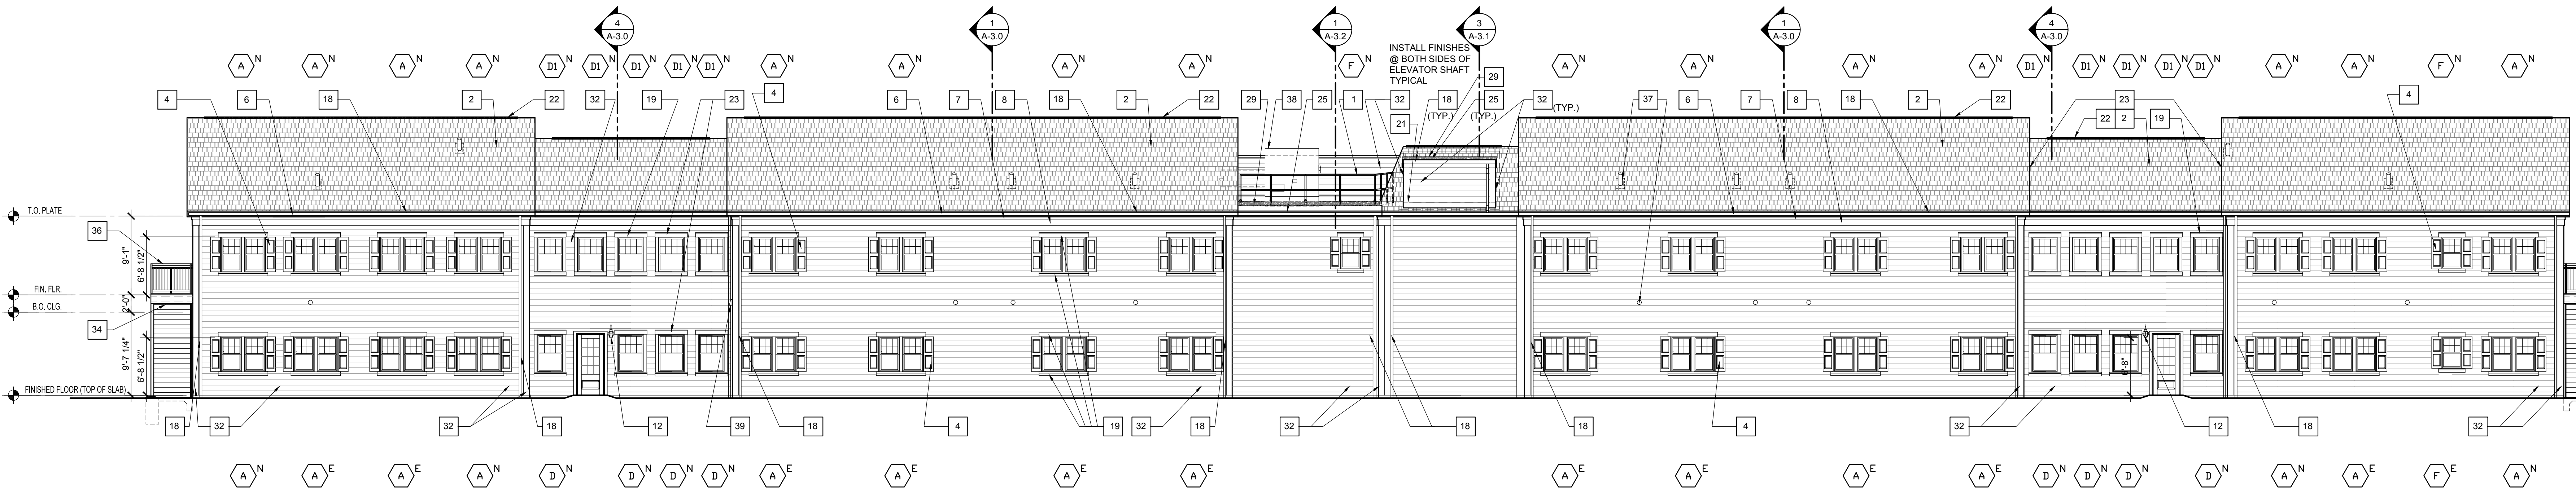


2 REAR ELEVATION (BUILDING'S 1&2)

A-2.1 SCALE: 1/8" = 1'-0"

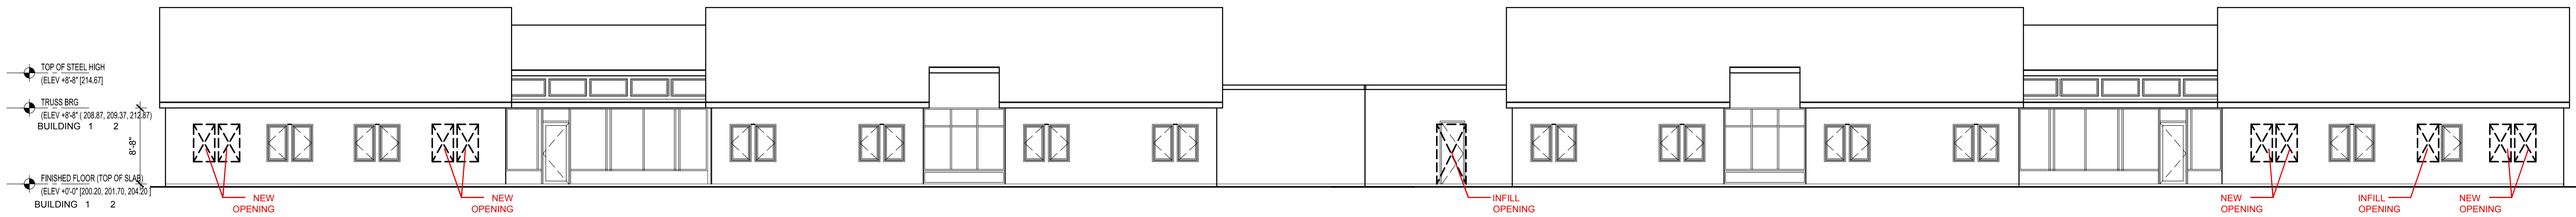


2E EXISTING REAR ELEVATION (BUILDING'S 1&2)

A-2.1 SCALE: 1/8" = 1'-0"

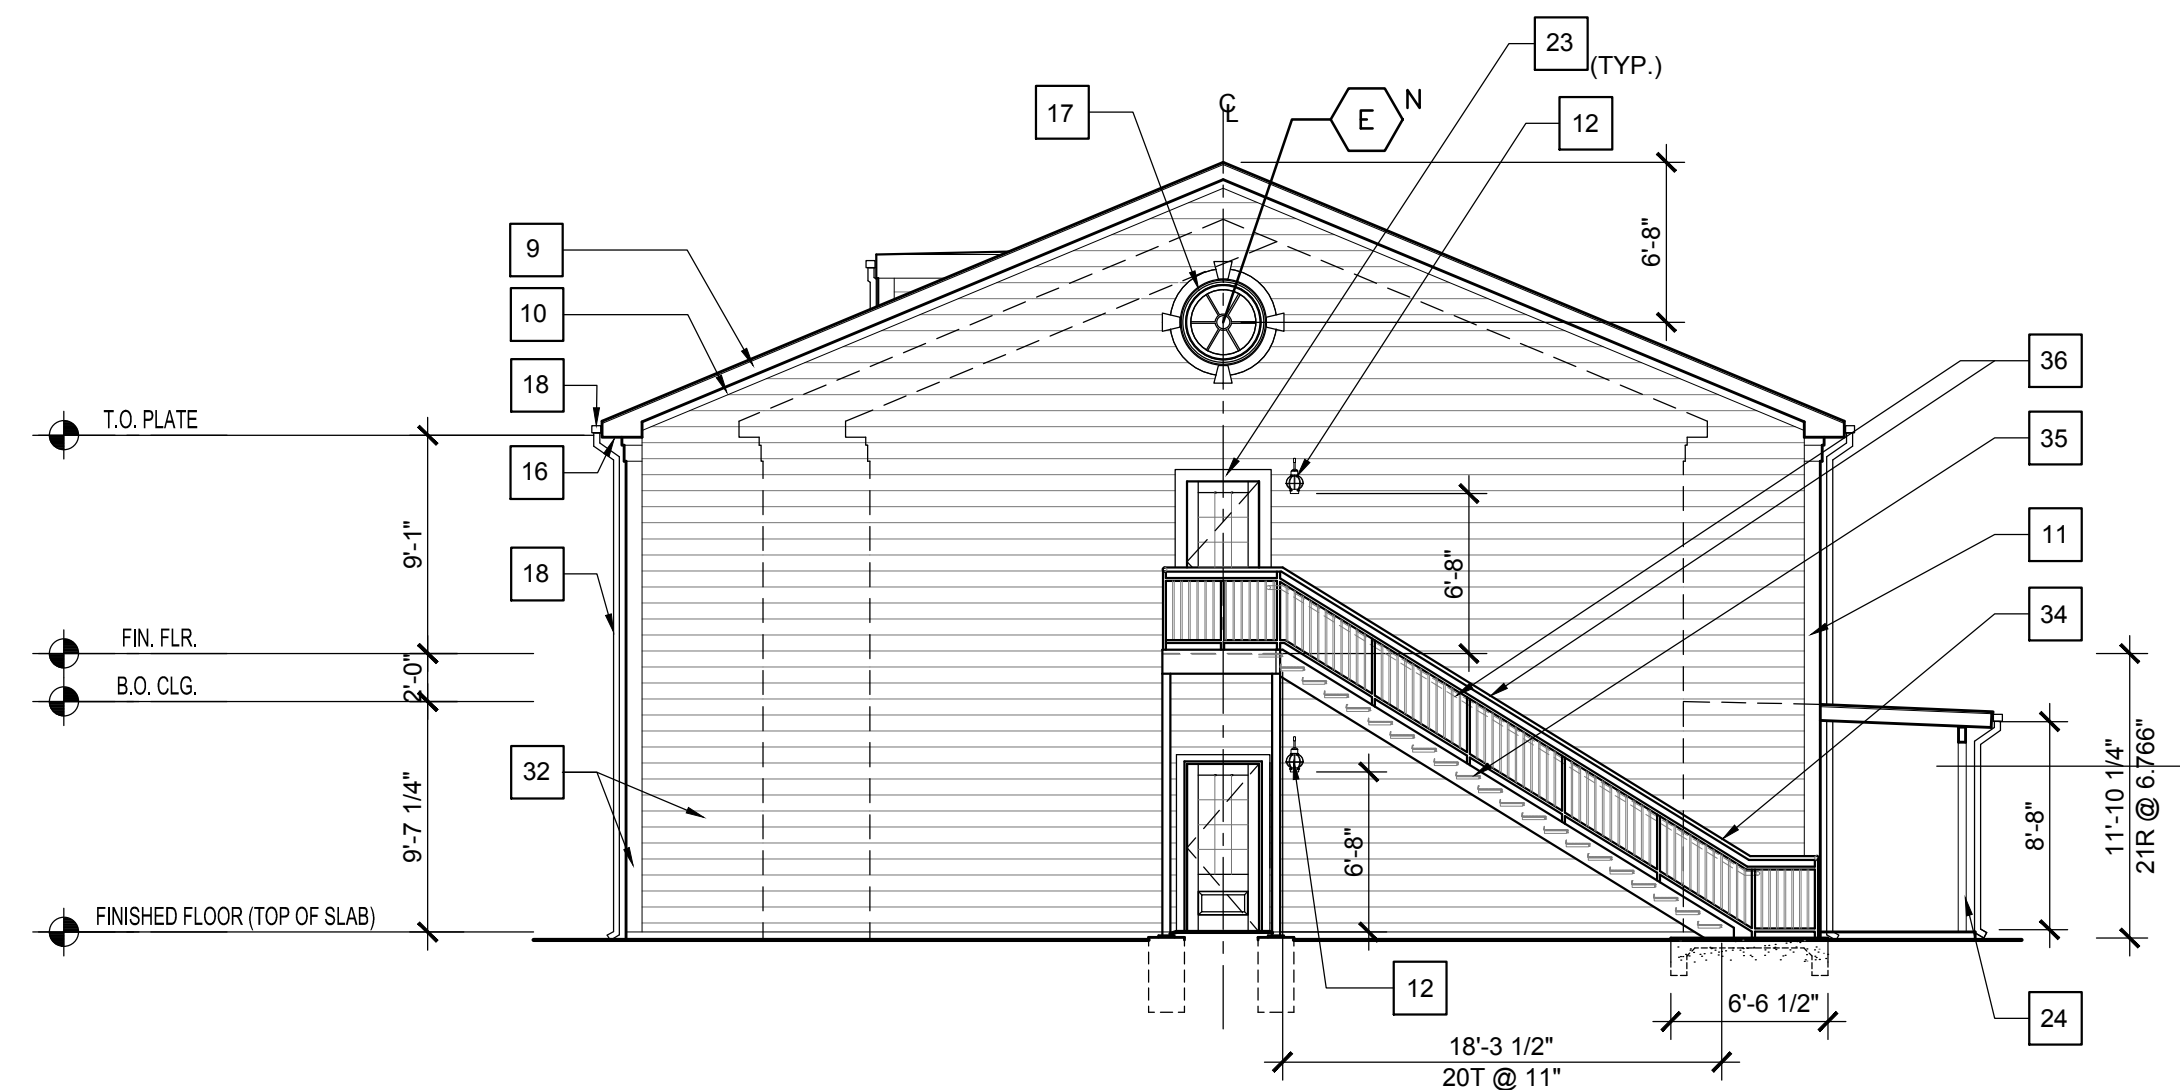

1 SIDE ELEVATION (BUILDING'S 1&2)

A-2.1 SCALE: 1/8" = 1'-0"

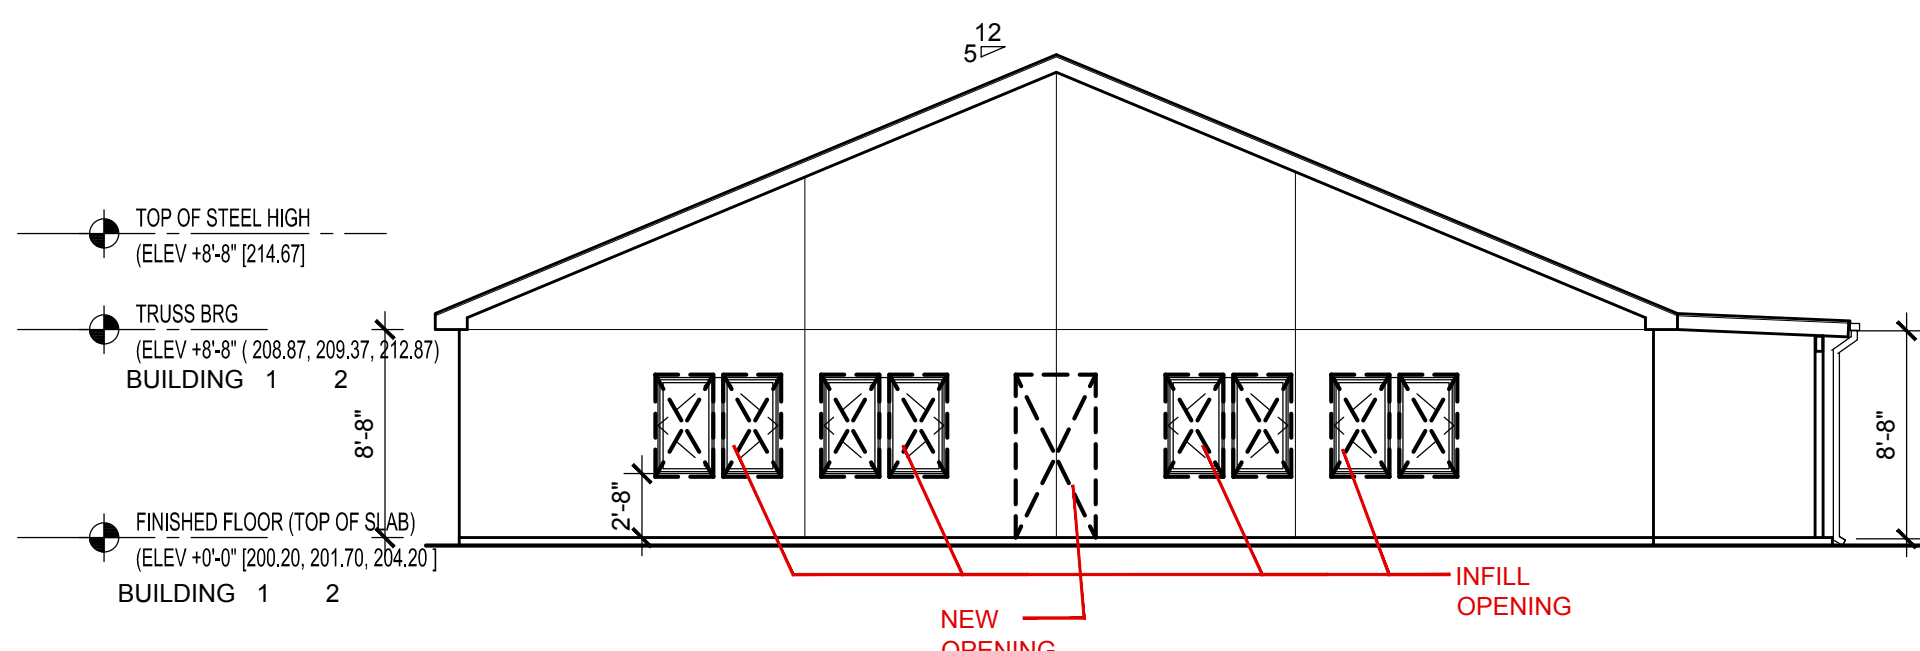

1E EXISTING SIDE ELEVATION (BUILDING'S 1&2)

A-2.1 SCALE: 1/8" = 1'-0"

WINDOW KEY LEGEND

- EXISTING WINDOW OPENING, WITH NEW WINDOWS. G.C. TO FIELD
VERIFY EXISTING R.O. PRIOR TO ORDERING NEW WINDOWS.
- NEW WINDOW OPENING, WITH NEW WINDOWS. G.C. TO MATCH
NEW WINDOW R.O. WITH EXISTING. FIELD VERIFY EXISTING R.O.
PRIOR TO ORDERING NEW WINDOWS.
- E = EXISTING ROUGH OPENING
N = NEW ROUGH OPENING

ELEVATION NOTES

- TOP OF STEEL GUARD 42" ABOVE FINISH ROOFING, 1 1/2" DIA STEEL PIPE TYPICAL. ANCHOR TO SOLID BLOCKING AT ALL PIPE LOCATIONS. STEEL TO BE PAINTED BY MANUFACTURER. SEE ALSO STRUCTURAL DRAWINGS.
- NATURAL SHADOW SHINGLES
- SHINGLE SIDING - (HARDIE PLANK) STRAIGHT EDGE PANEL 7" EXPOSURE OR EQUAL
- SHUTTERS - MID AMERICA OR EQUAL LOUVER SHUTTERS 14 1/2" WIDE PANELED SHUTTER FIRST AND SECOND FLOORS (COORDINATE SHUTTER HEIGHT WITH WINDOW HEIGHT)
- NOT USED
- FASCIA BOARD - 1 X 8 (AZEK OR EQUAL)
- SUB FASCIA BOARD - 1 X 4 (AZEK OR EQUAL)
- SUB FASCIA BOARD - 1 X 12 - 8" EXPOSURE (AZEK OR EQUAL)
- RAKE BOARD - 1 X 8 (AZEK OR EQUAL)
- SUB RAKE BOARD - 1 X 4 (AZEK OR EQUAL)
- CORNER TRIM - 5/4 X 8 (AZEK OR EQUAL)
- LIGHT FIXTURE - (VAXCEL LIGHTING) OR EQUAL) OW21861BN NAUTICAL 7"
- NOT USED
- NOT USED
- NOT USED
- CONTINUOUS 2" VENT W/ AZEK TRIM ON BOTH SIDES
- AZEK TRIM
- NEW GUTTER AND DOWNSPOUTS (USE SAME LOCATIONS OR AS NOTED OTHERWISE)
- WINDOW CASING TRIM 5/4 X 4 @ JAMB, 5/4 X 6 AT HEAD W/ DRIP CAP TRIM & HISTORIC SILL TRIM PROFILE W/ 5/4" X 4" APRON (AZEK OR EQUAL) SEE DETAILS 3/ A-6.0 AND 4/ A-6.0
- NOT USED
- CONCEALED METAL FLASHING INSTALL AS PER SIDING MANUFACTURER SPECIFICATIONS
- NEW CONTINUOUS RIDGE VENT
- CONTINUOUS METAL FLASHING (OVER WINDOWS AND AS SHOWN ON ELEVATIONS)
- VERIFY EXISTING POST CONDITION IS REUSABLE PRIOR TO INSTALLING AZEK PER LATTICE DETAILS. SEE 1/A-4.2
- .050 ALUMINUM TWO PIECE PRE-FINISHED ALUMINUM ROOF EDGE
- REPLACE WITH NEW AZEK BOARD
- REPLACE SUBSTRATE AS REQUIRED
- AIR VENT (CLOSED)
- NOT USED
- VERIFY EXISTING SUBSTRATE & ROOF FRAMING IS IN GOOD CONDITION PRIOR TO INSTALLING TPO ROOFING INSTALL PER MFR. SPEC. & WARRANTY
- NEW POST INSTALL AZEK PER LATTICE DETAILS
- NOT USED
- 8" HORIZONTAL SIDING W/ 8" CORNER TRIM (CERTAIN TEED CAROLINA BEADED VINYL SIDING OR EQUAL)
- NOT USED
- NEW STEEL EXIT STAIR TO GRADE W/ GUARDS & HANDRAILS PRIMED AND PAINTED IRON WORK BY MANUFACTURER TYP.
- OPEN GRATE LANDINGS AND TREADS 1/2" DIA. MAXIMUM SPACING. PERFORATED METAL SHEET CLOSED RISERS TYP.
- TOP OF GUARDRAIL @ 42" & TOP OF HANDRAILS @ 34" ABOVE LANDING AND NOSING TYPICAL
- BATHROOM EXHAUST VENT WALL/ROOF INSTALL PER CODE. SEE MECHANICAL DRAWINGS
- ROOF TOP EQUIPMENT SEE MECHANICAL AND STRUCTURAL DRAWINGS
- DRYER VENT, INSTALL PER CODE
- NEW GAS METER. PLUMBING CONTRACTOR TO COORDINATE. SEE PLUMBING DRAWINGS



Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL UNTIL SIGNED AND SEALED.
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

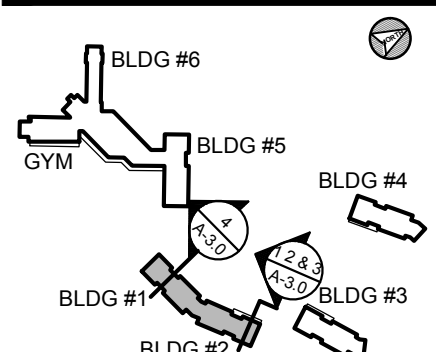

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions


No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By: FJF
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

ARCHITECTURAL
SECTIONS


Sheet No:

A-3.0

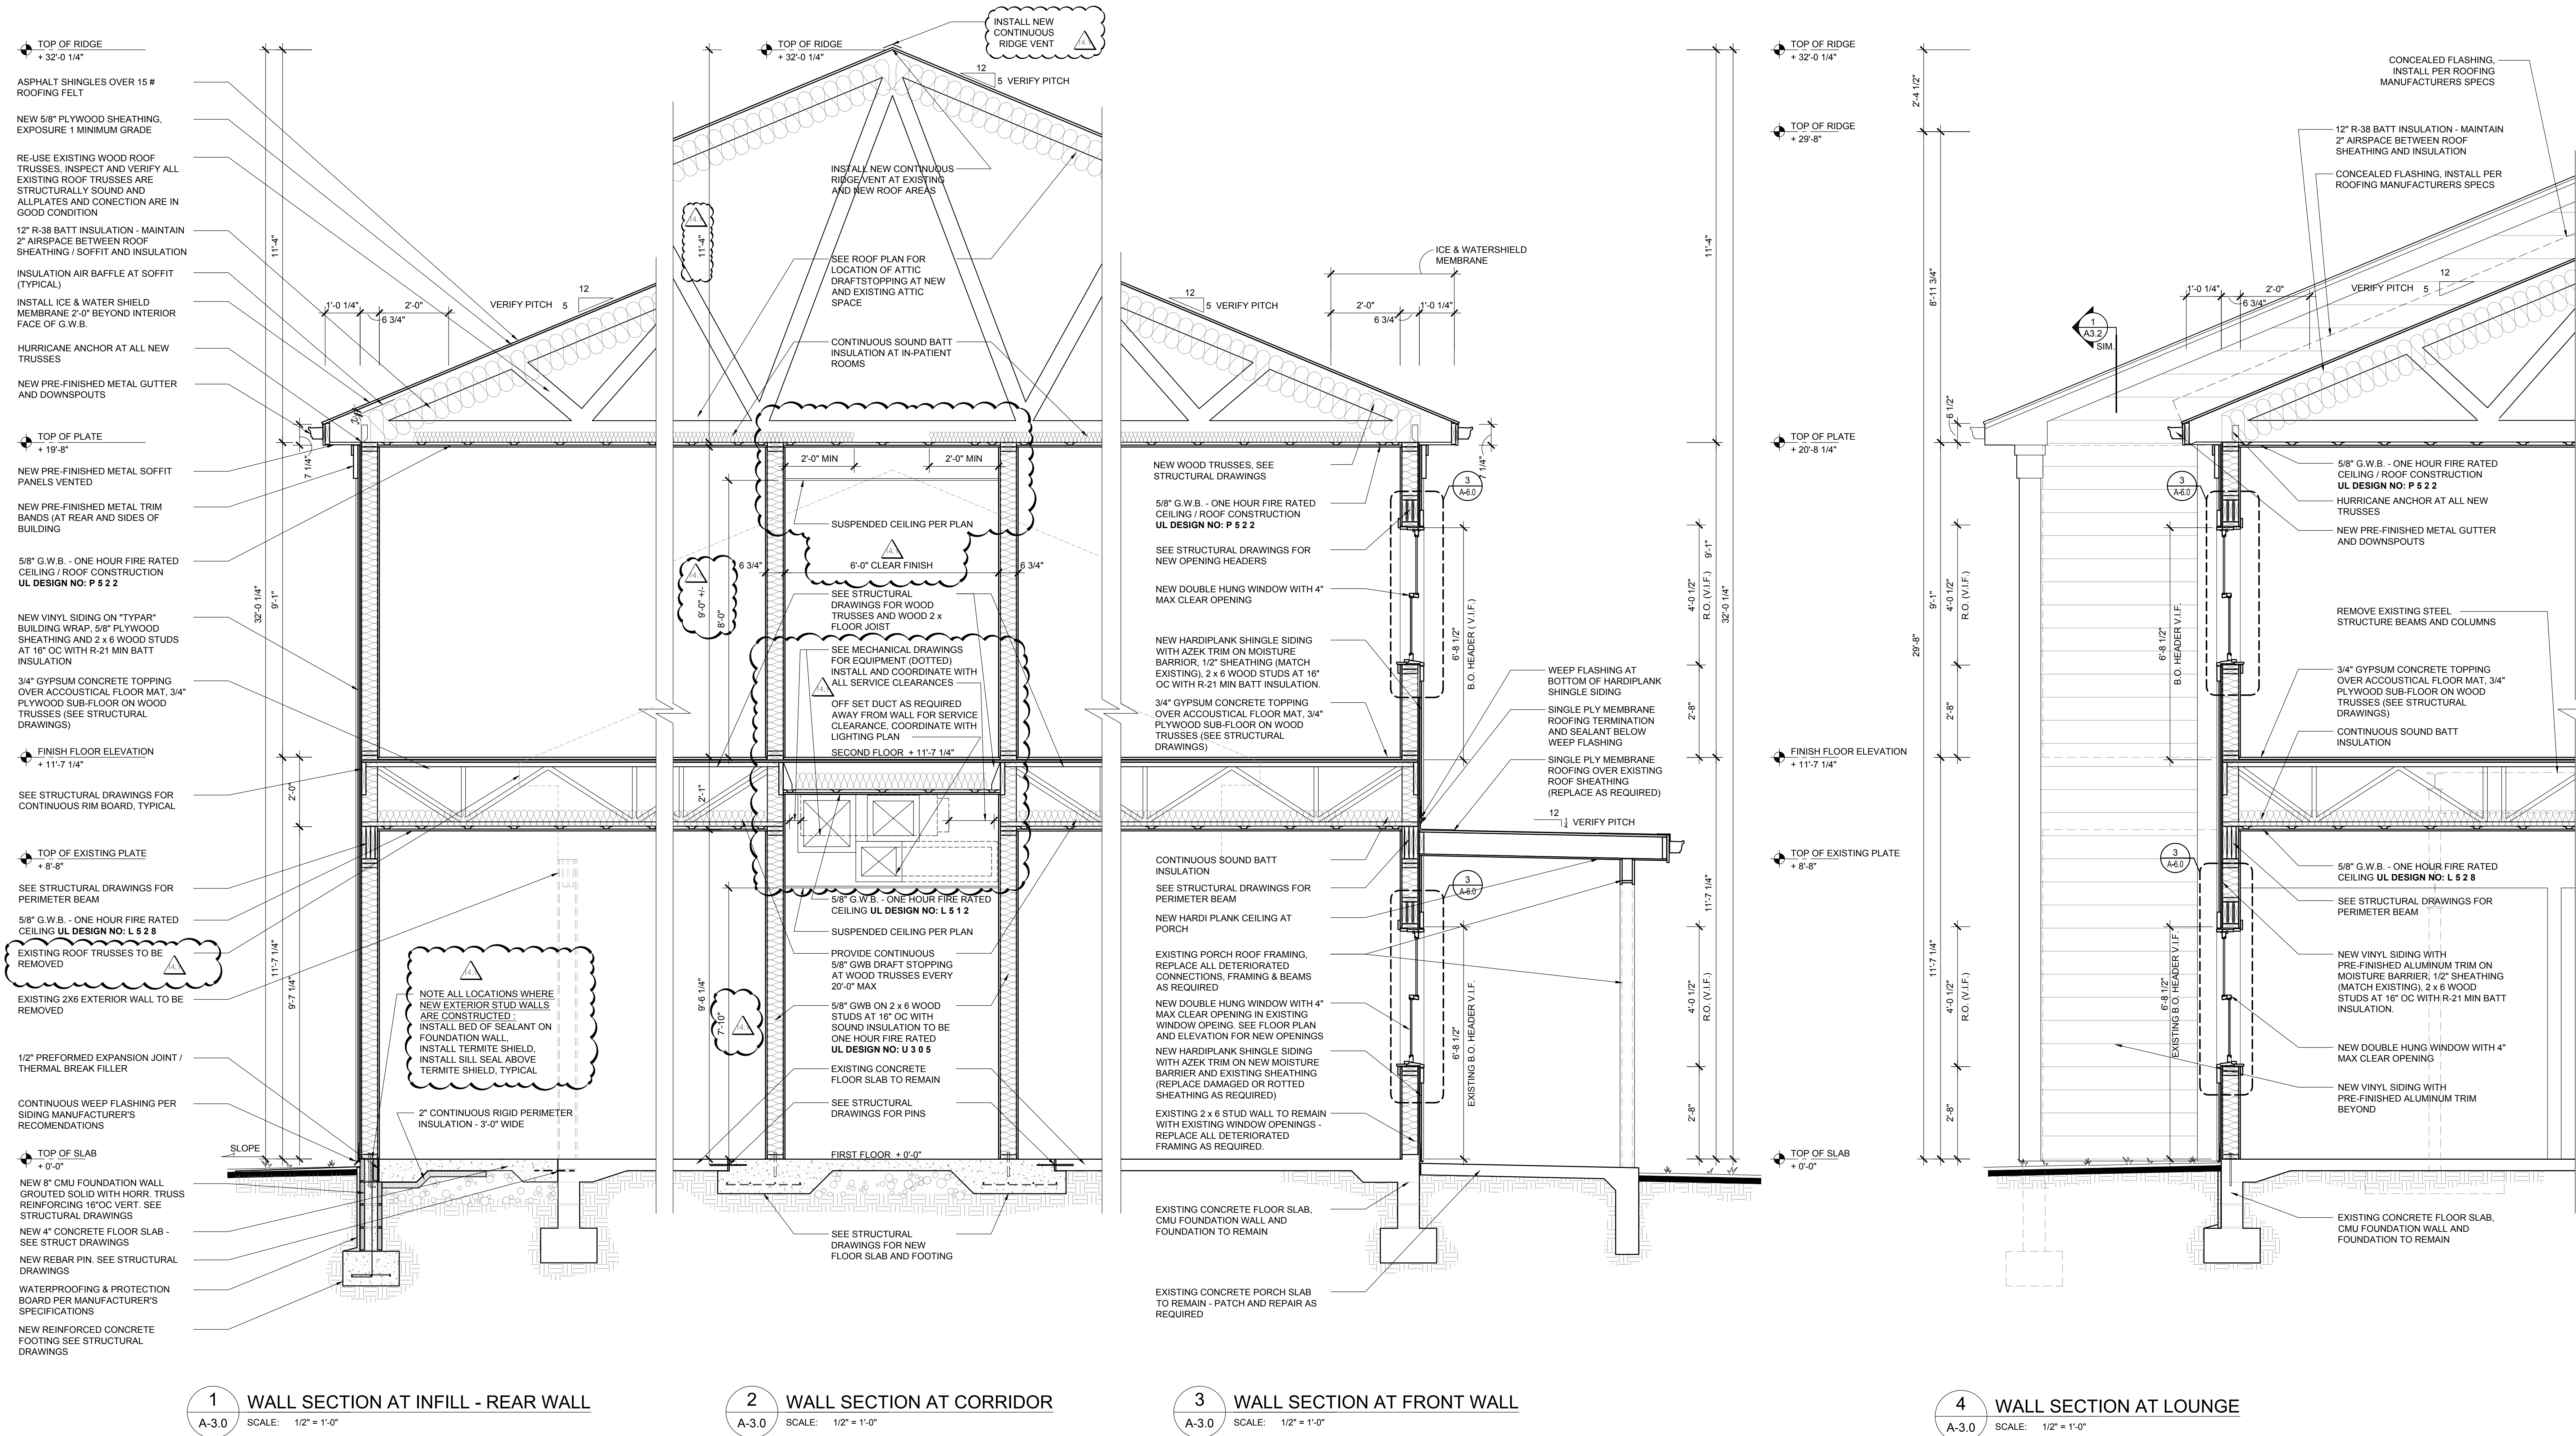

FIREBLOCKING NOTE:
1. CONFIRM INSTALLATION OF FIRE
BLOCKING AT ALL CONCEALED SPACES
PRIOR TO INSTALLATION OF G.W.B. TYPICAL.

T:\06\0\Nail\RCAs - Phase 1\11,100 Billingsley for Building 1&2\Drawings\5-Sheets\A-3.0 Architectural Sections (1&2).dwg - Kapp Hupp, 2017/02/09 12:14 PM.

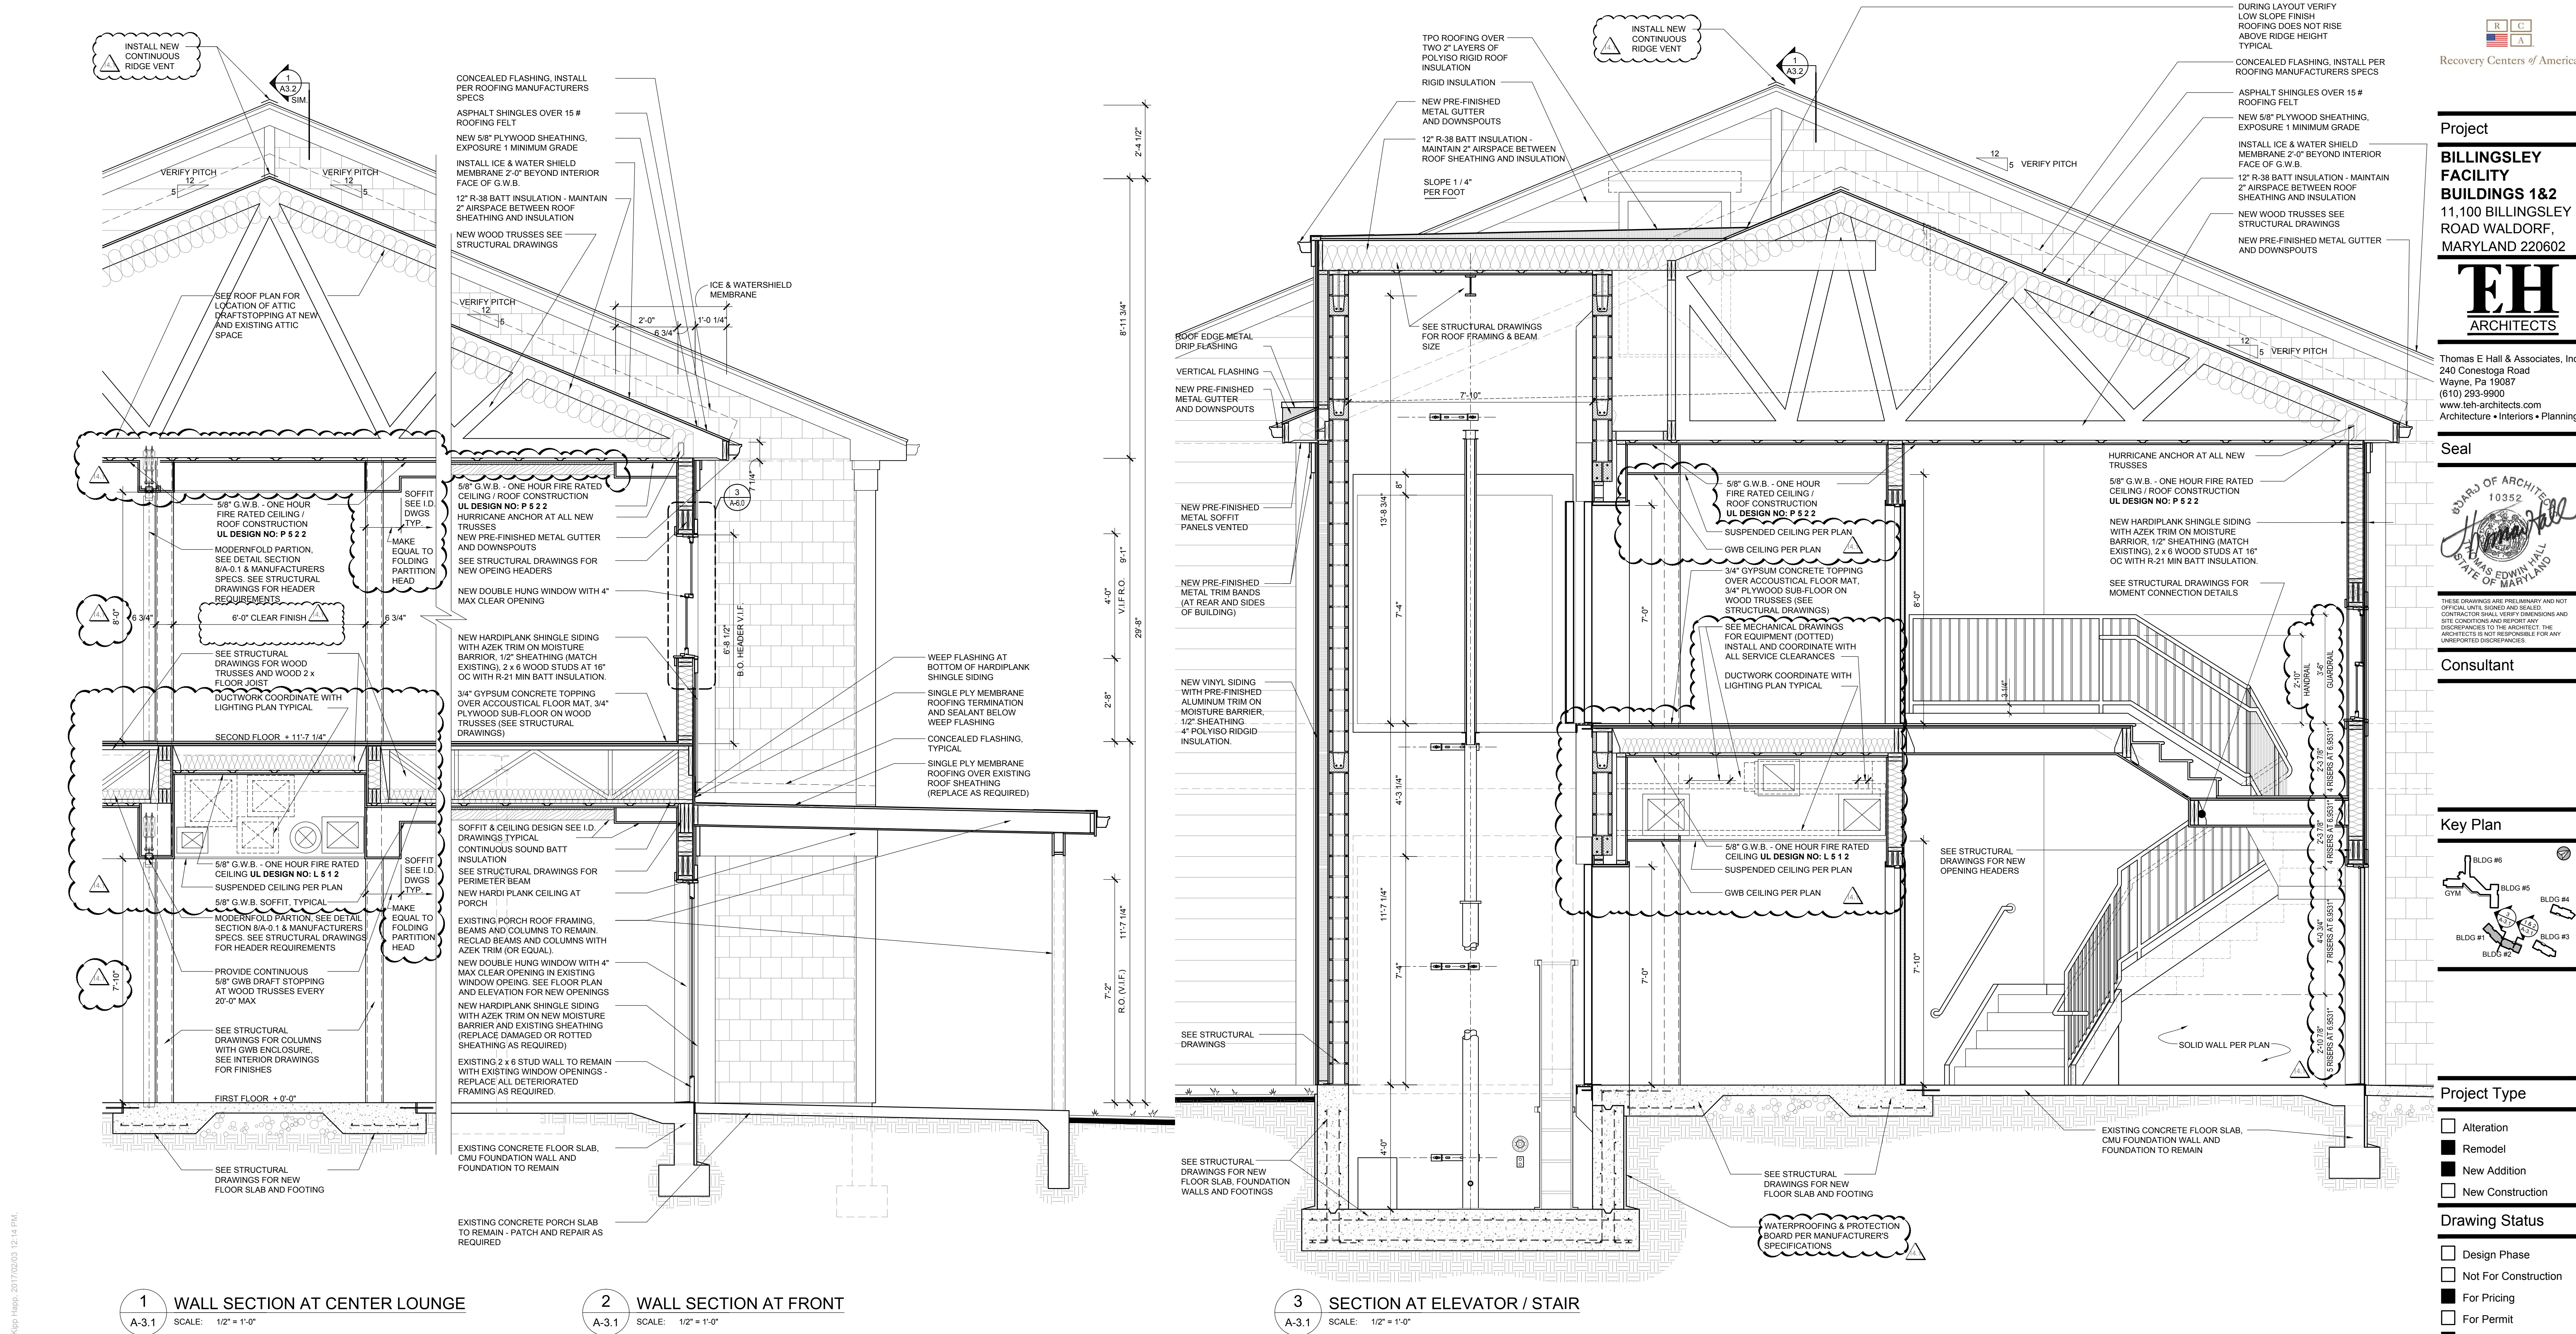

FIREBLOCKING NOTE:

1. CONFIRM INSTALLATION OF FIRE BLOCKING AT ALL CONCEALED SPACES PRIOR TO INSTALLATION OF G.W.B. TYPICAL.



Recovery Centers of America

Project

BILLINGSLEY FACILITY BUILDINGS 1&2
11,100 BILLINGSLEY ROAD WALDORF, MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

Consultant

Key Plan

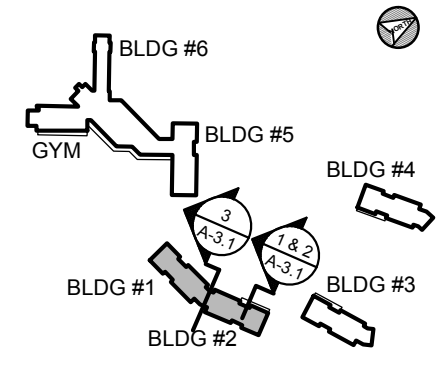

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142 00
Drawn By: FJF
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

ARCHITECTURAL SECTIONS

Sheet No:

A-3.1



**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



10352
H. H. Hall
THE STATE OF MARYLAND
THOMAS EDWIN HALL

THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00
 Drawn By: FJF
 Checked By: TEH
 Date: 17 FEB 03
 Scale: AS NOTED
 Drawing Title:


Sheet No:

A-3.2



FIREBLOCKING NOTE:

1. CONFIRM INSTALLATION OF FIRE BLOCKING AT ALL CONCEALED SPACES PRIOR TO INSTALLATION OF GWB. TYPICAL

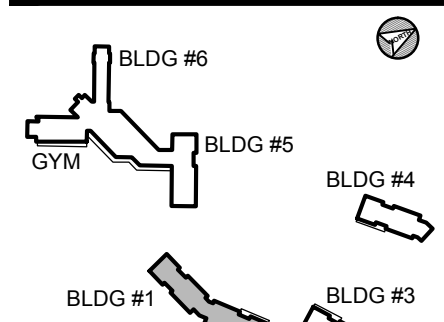


- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

- ☐ Design Phase
☐ Not For Construction
☐ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

No.	Date	Description
1	06/03/2016	REVISION #10
2	07/07/2016	REVISION #11
3	07/27/2016	REVISION #12
4	09/16/2016	REVISION #13
5	01/06/2017	REVISION #14
6	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

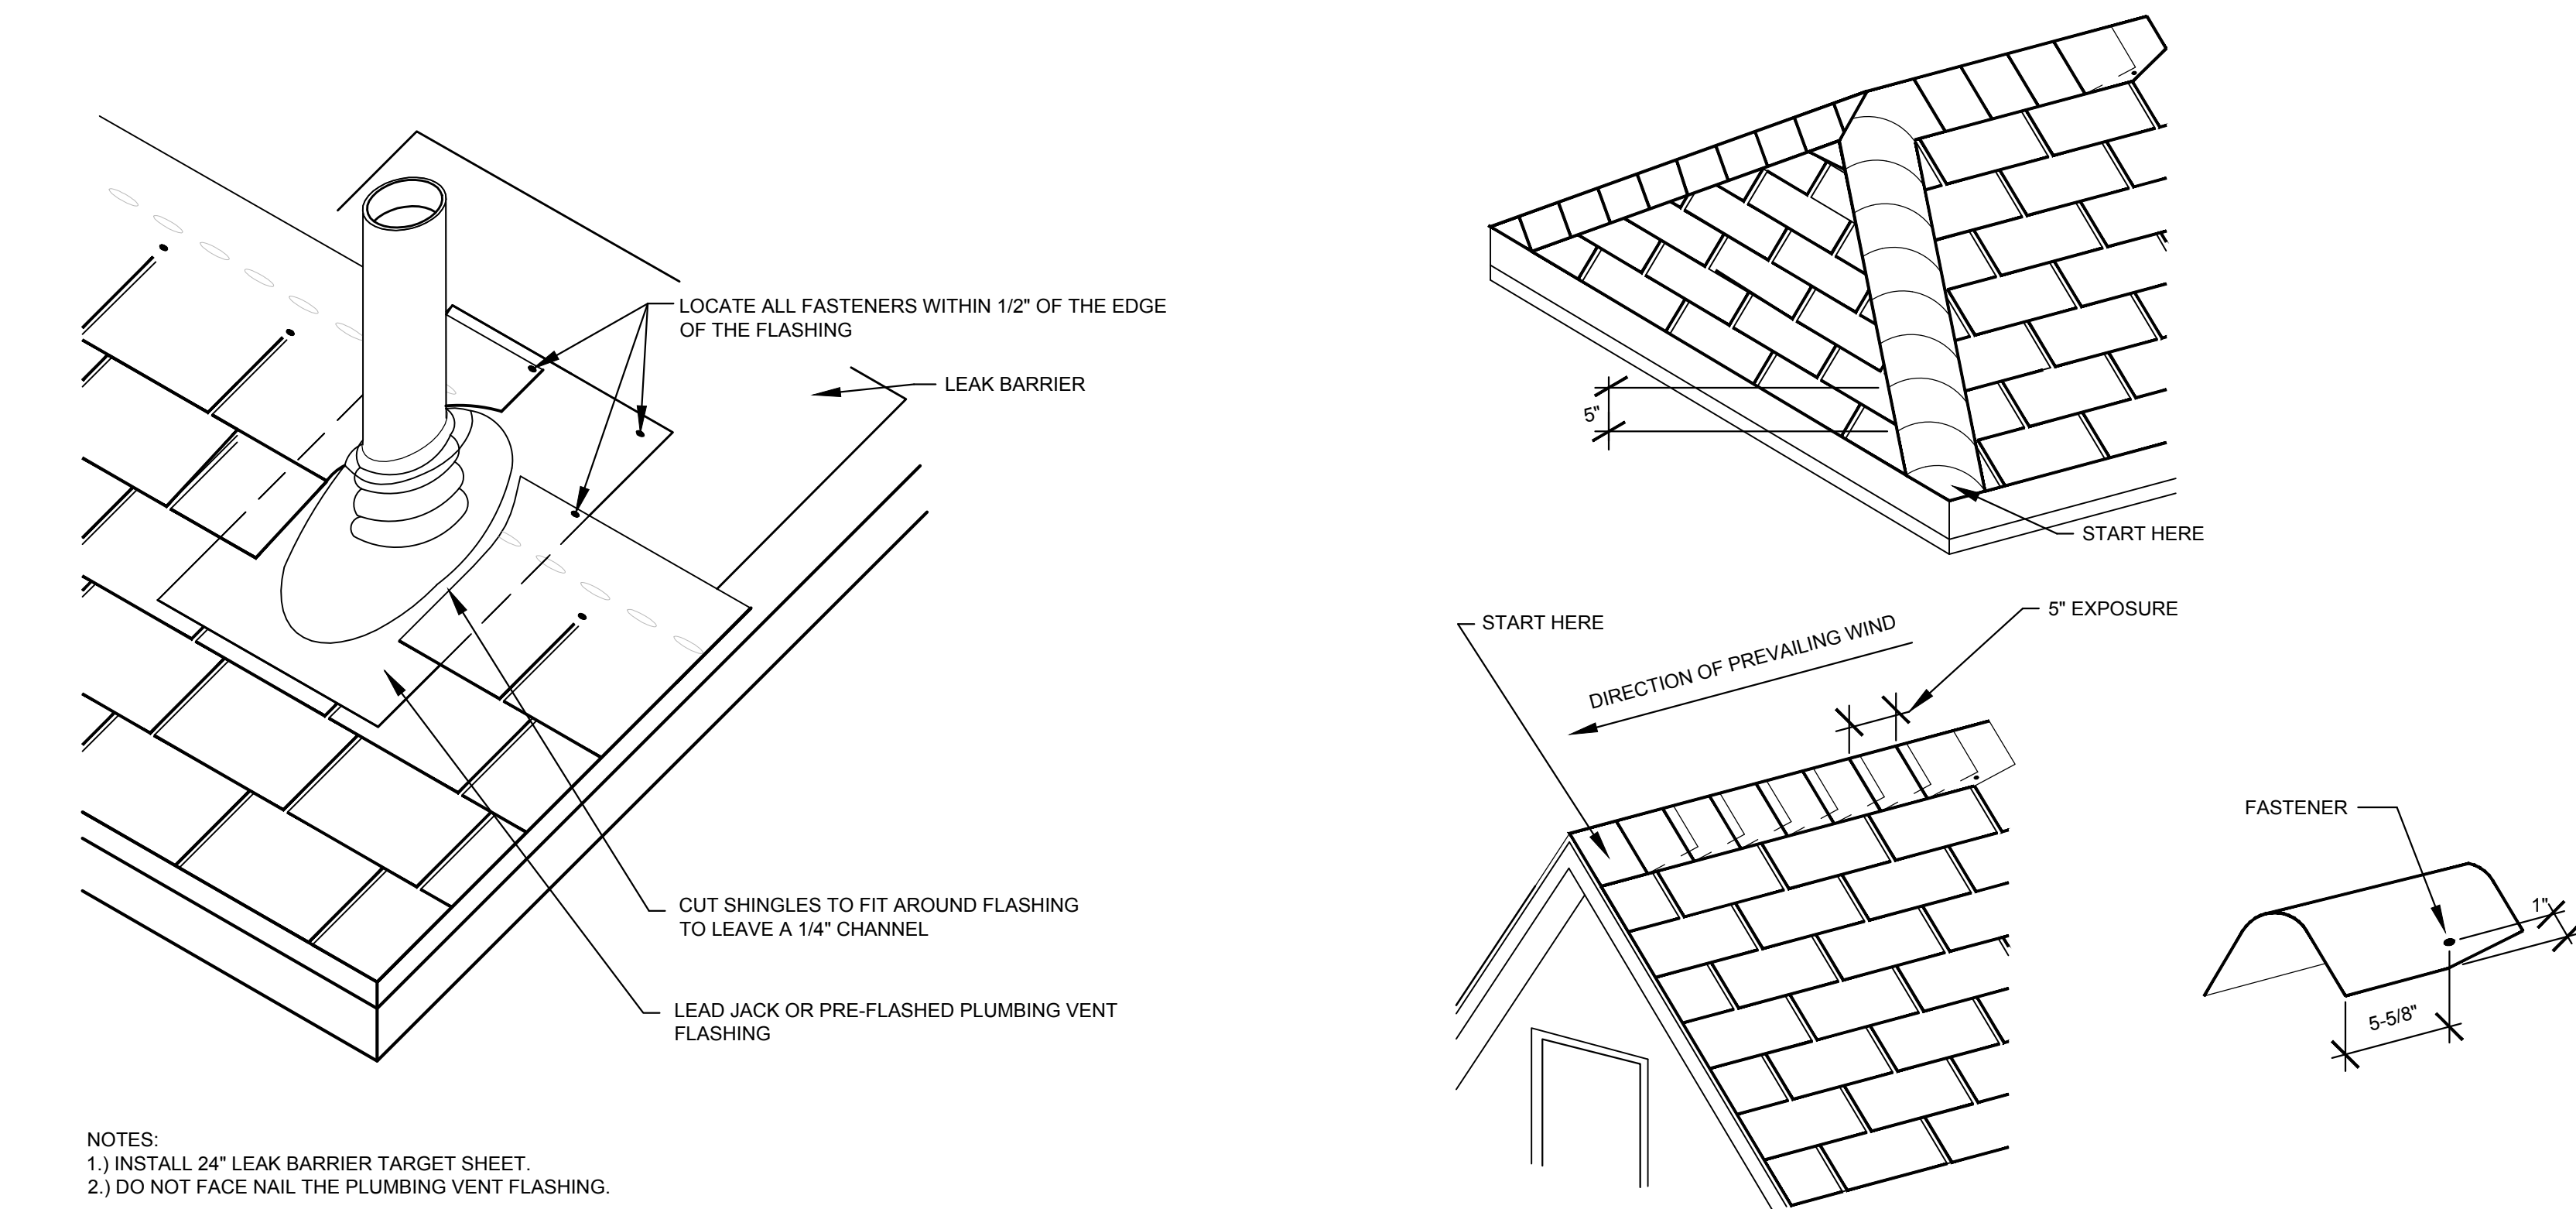


8 DETAIL - TYPICAL ROOF VENT FLASHING
A-4.0 SCALE: 1 1/2\"/>

9 DETAIL - TYPICAL RIDGE / HIP
A-4.0 SCALE: 1 1/2\"/>


10 DETAIL - TYPICAL WOVEN VALLEY
A-4.0 SCALE: 1 1/2\"/>

11 DETAIL - TYPICAL GUTTER INSTALLATION
A-4.0 SCALE: 1 1/2\"/>

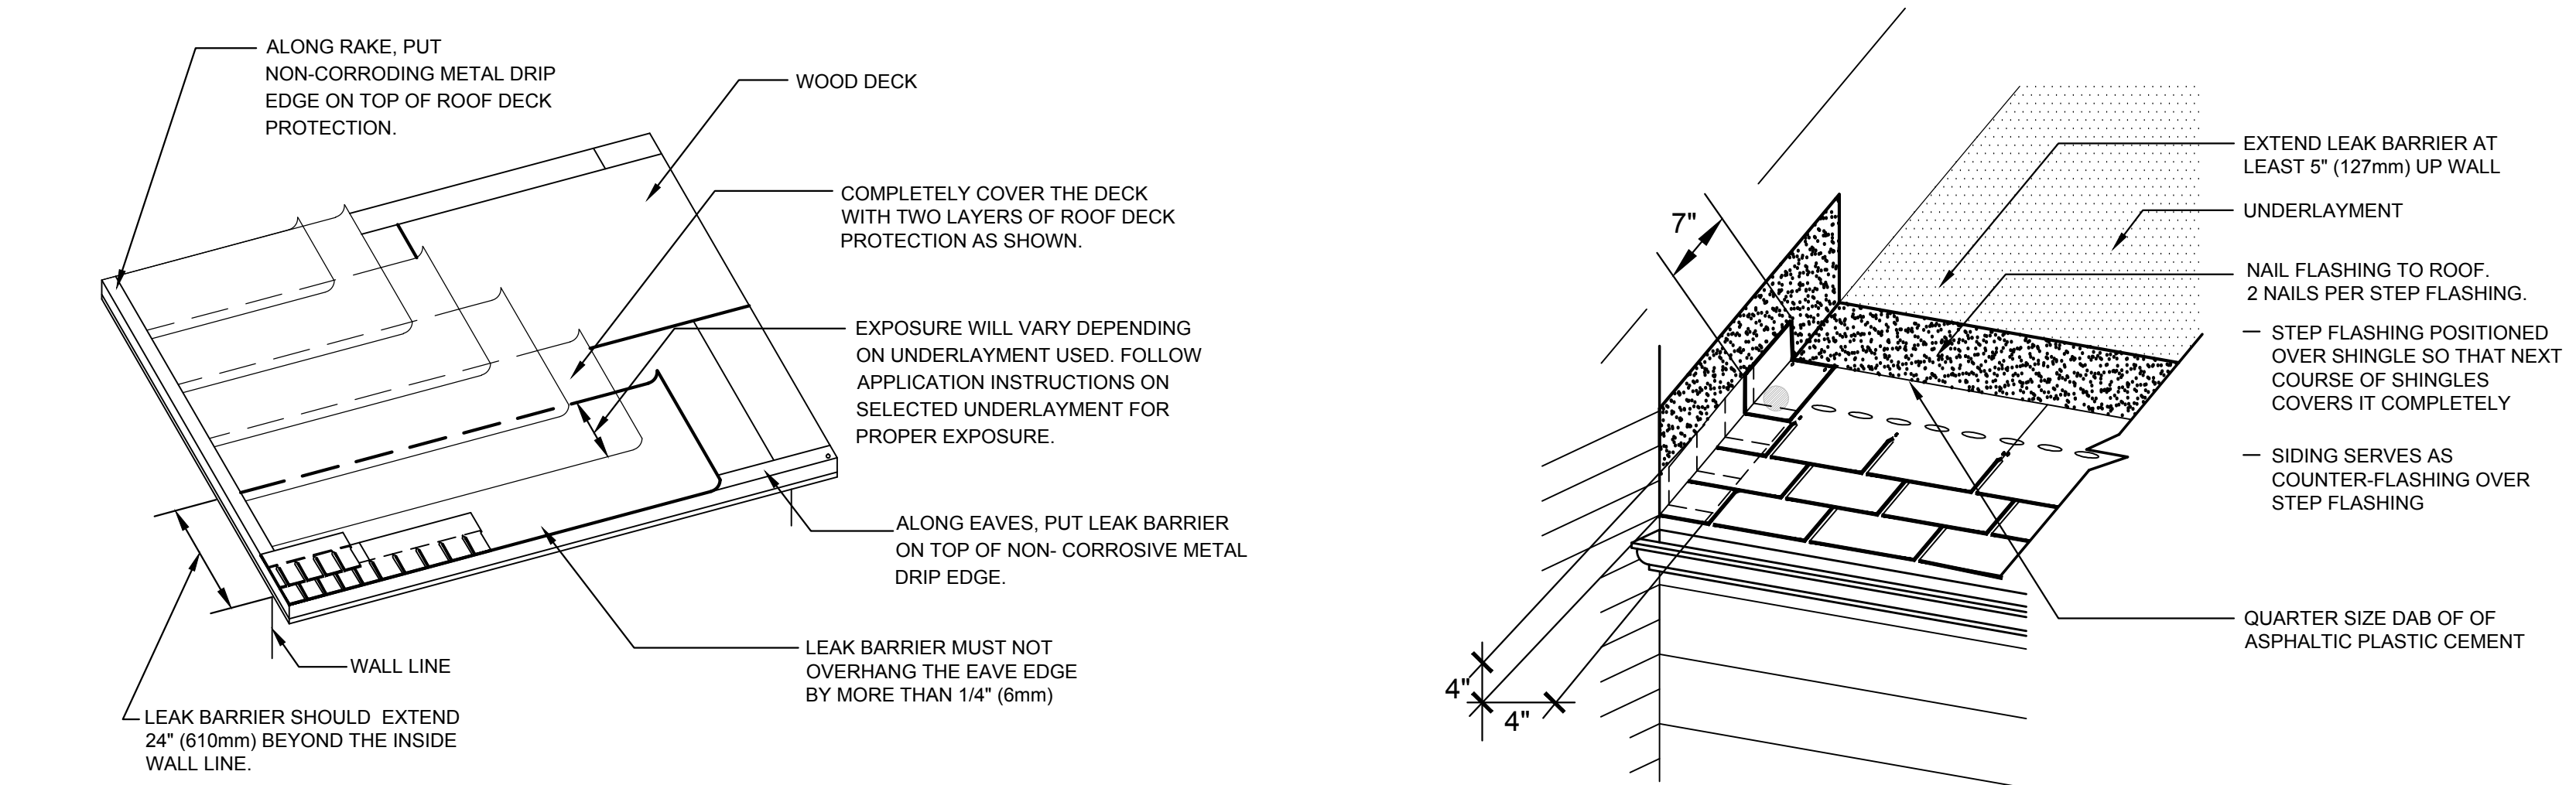


6 DETAIL - TYPICAL UNDERLAYMENT
A-4.0 SCALE: 1 1/2\"/>


7 DETAIL - TYPICAL STEP FLASHING
A-4.0 SCALE: 1 1/2\"/>

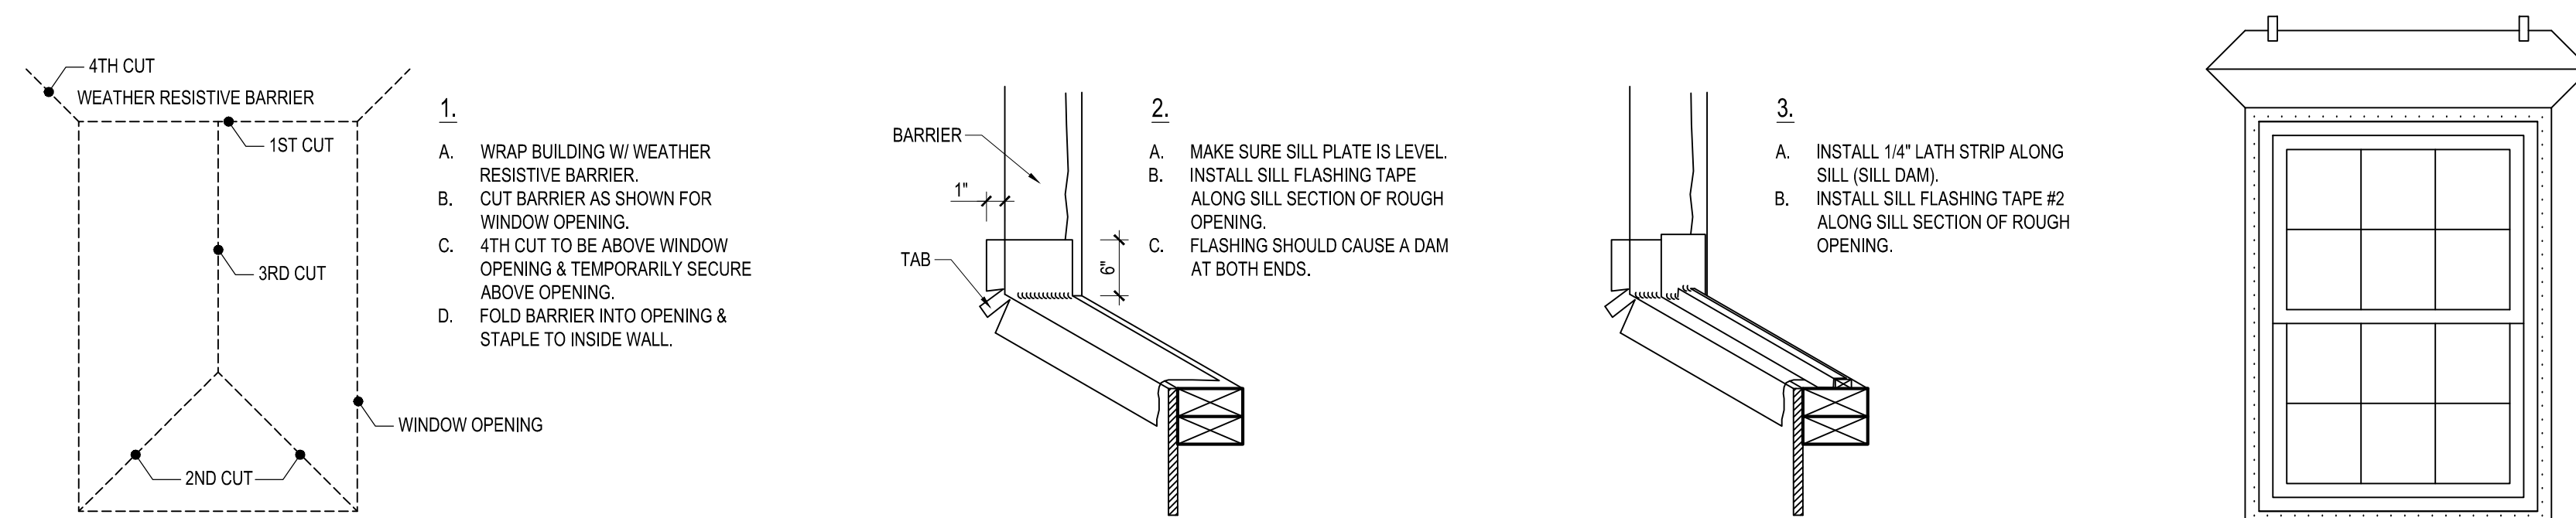

3 DETAIL - TYPICAL WINDOW FLASHING
A-4.0 SCALE: 3/4\"/>

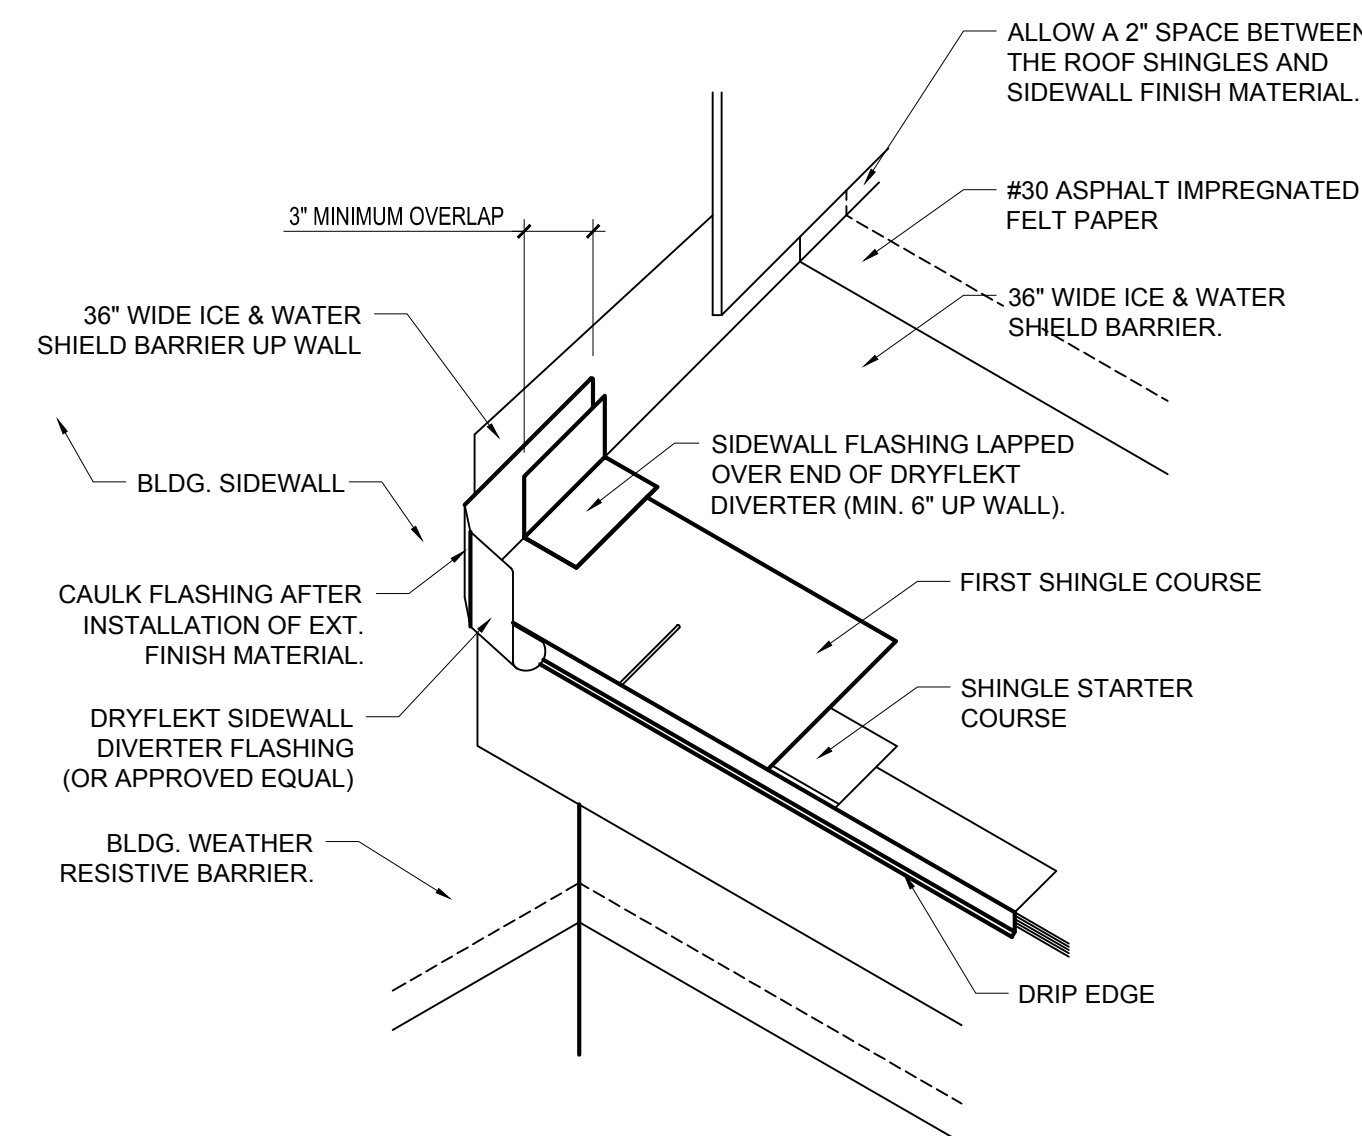

4 DETAIL - SIDEWALL DIVERTER
A-4.0 SCALE: 3/4\"/>

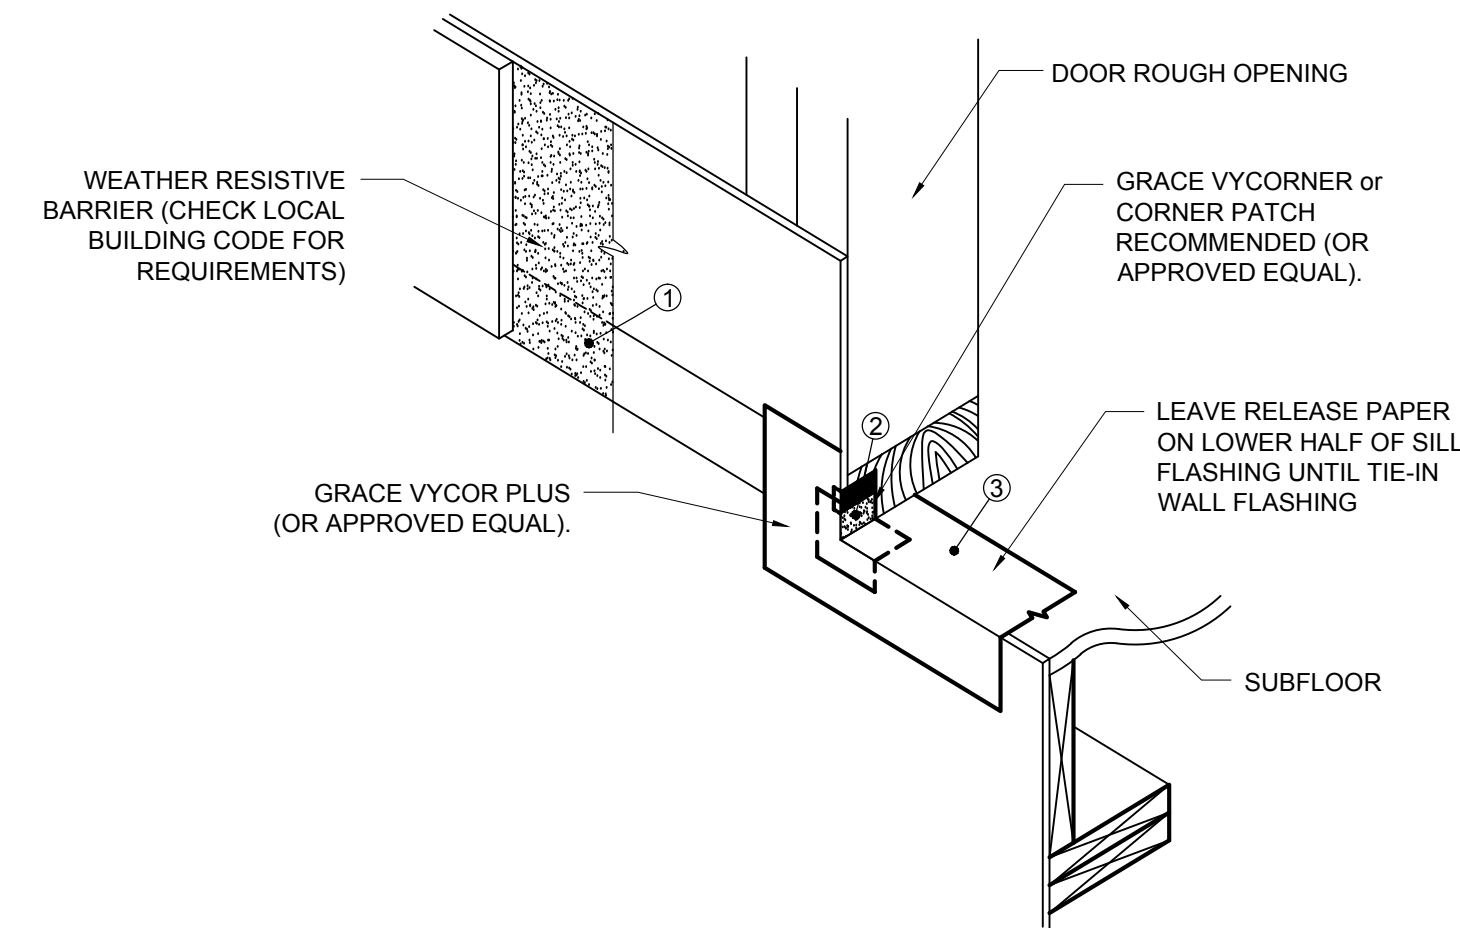

5 DETAIL - DOOR SILL FLASHING
A-4.0 SCALE: 3/4\"/>



Recovery Centers of America

Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL UNTIL SIGNED AND SEALED.
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

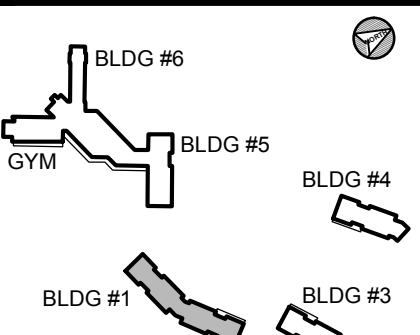

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By:
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:


WALL FLASHING &
SIDING DETAILS

Sheet No:

A-4.1


BILLINGSLEY BUILDINGS 1&2

- GENERAL NOTES
- SEAL ALL TYPAR / WRB JOINTS AND PENETRATIONS WITH APPROVED TAPE.
 - FASTEN BARRIER TO SHEATHING WITH LARGE HEAD NAILS OR USE NAILS WITH LARGE PLASTIC WASHER HEADS.
 - LOCAL LAWS, ZONING, AND BUILDING CODES VARY AND THEREFORE GOVERNS OVER MATERIAL SELECTION AND DETAILING SHOWN BELOW.

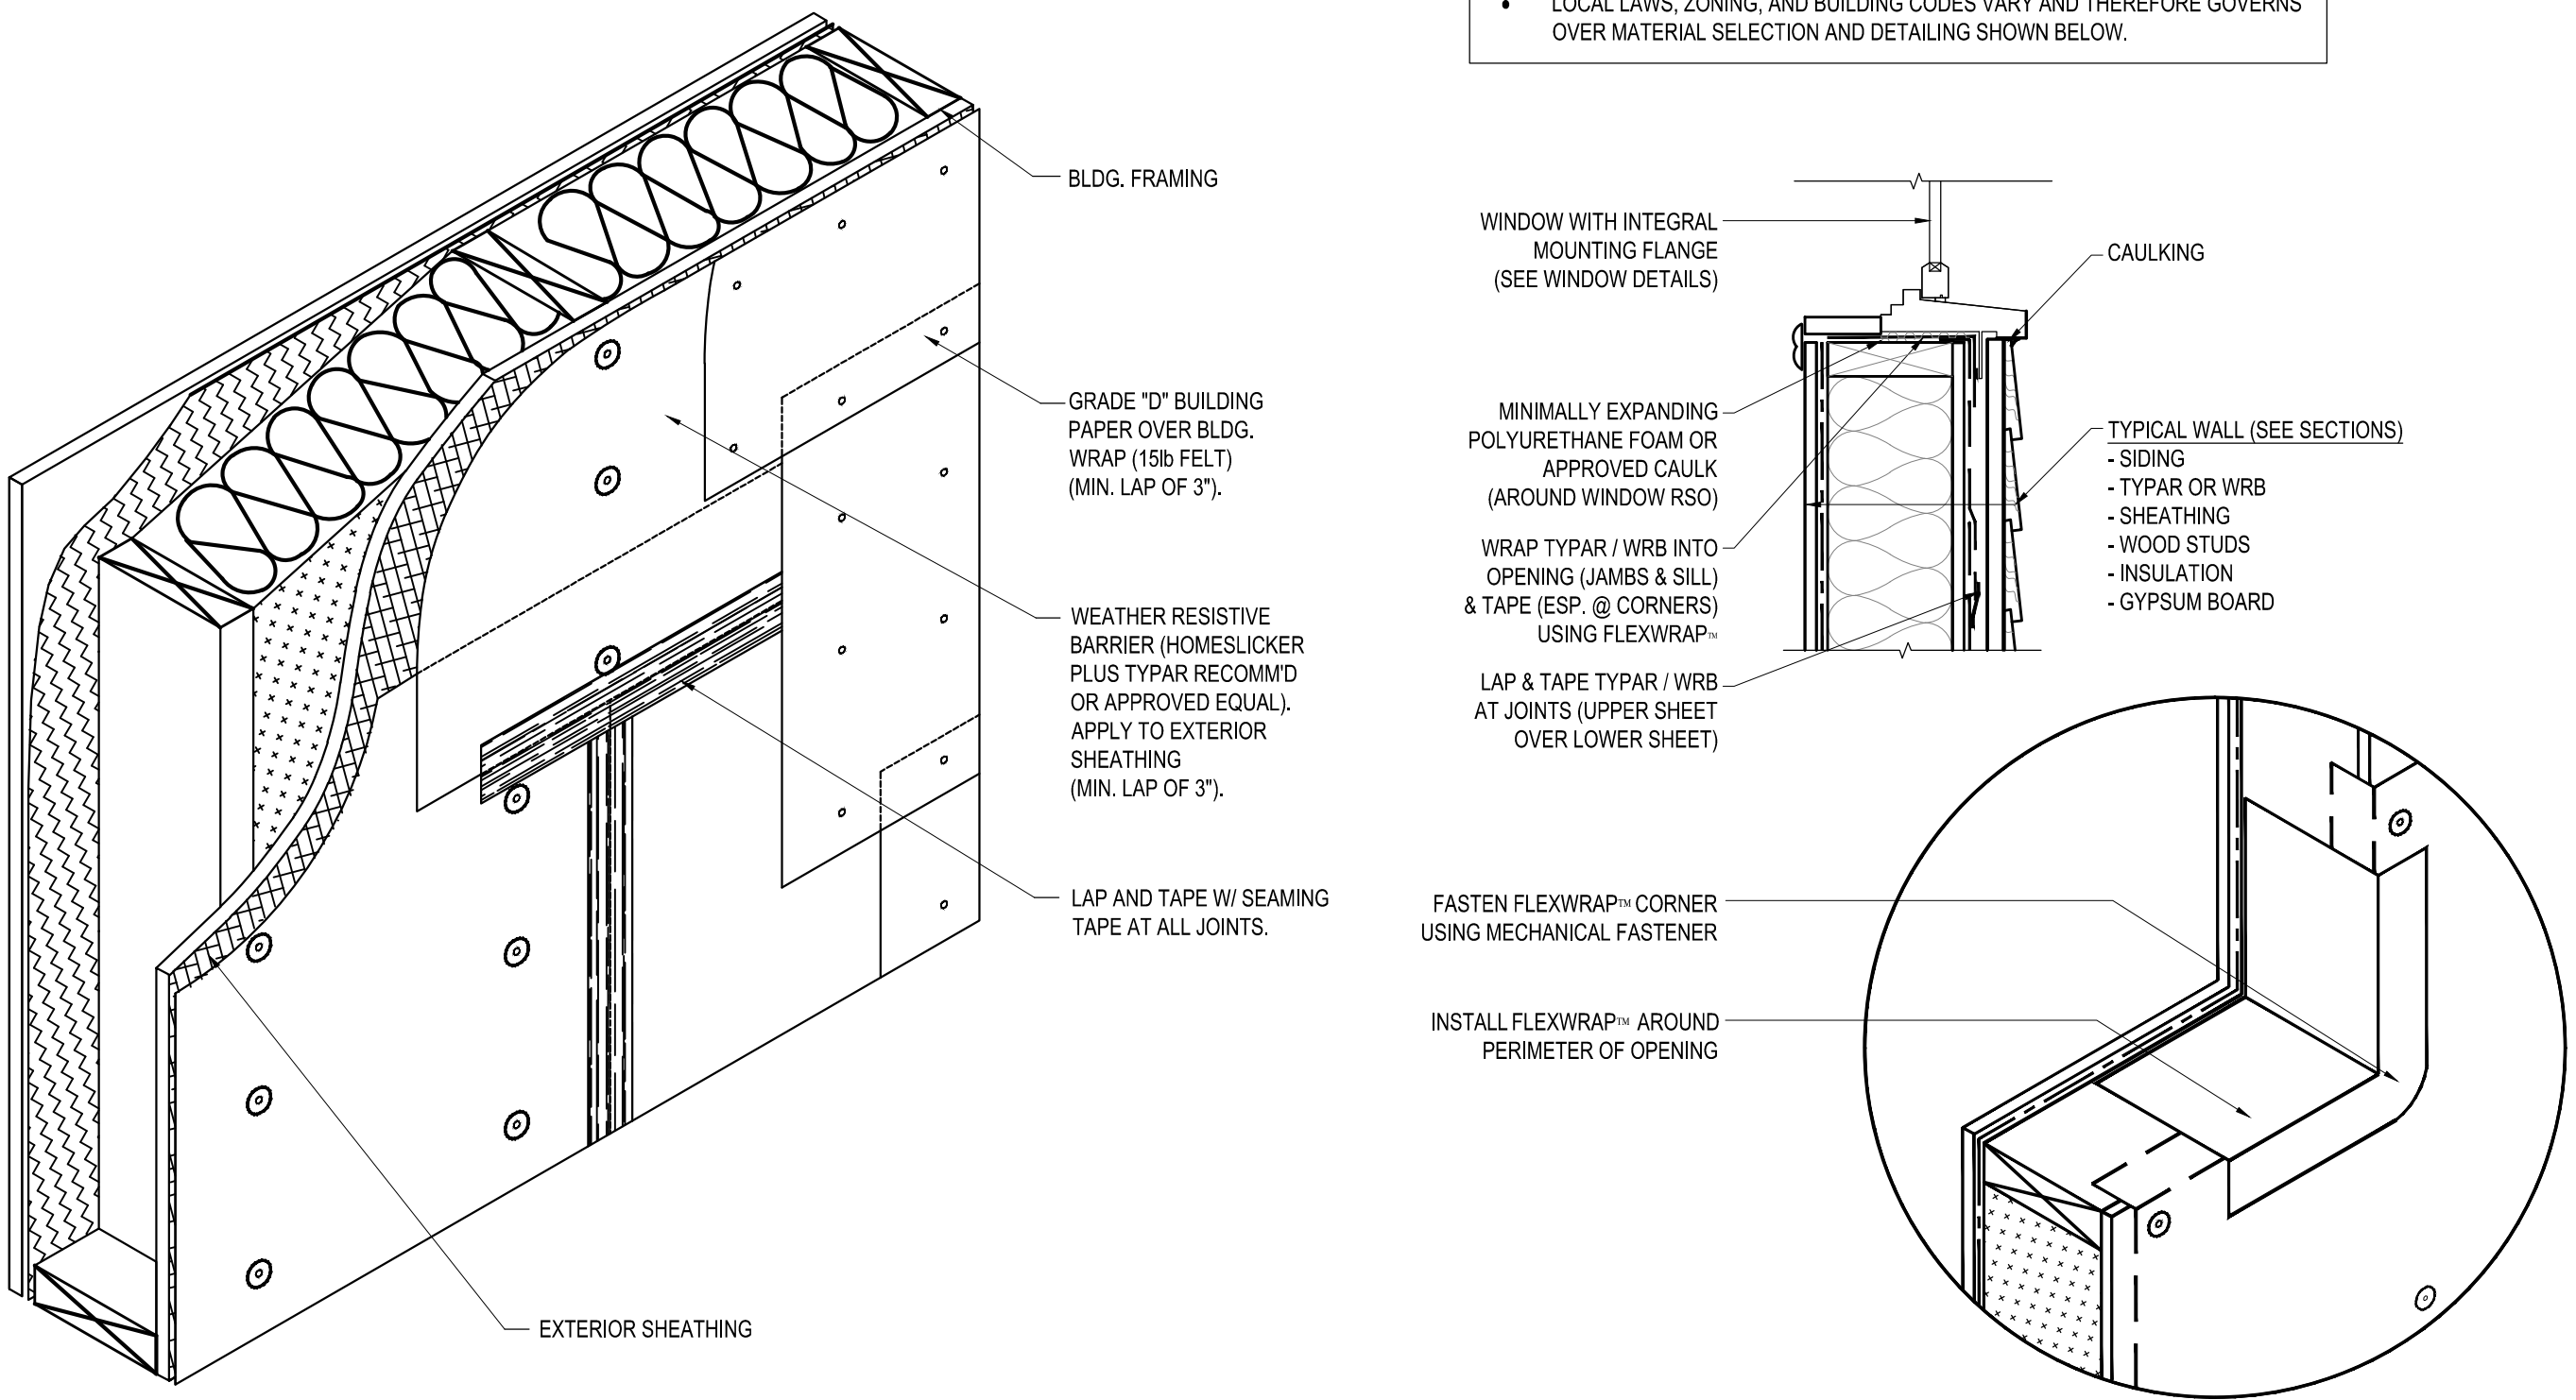


11 DETAIL - WEATHER PROTECTIVE BARRIER
A-4.1 SCALE: 1-1/2" = 1'-0"


12 DETAIL - WINDOW SILL FLASHING
A-4.1 SCALE: 1-1/2" = 1'-0"

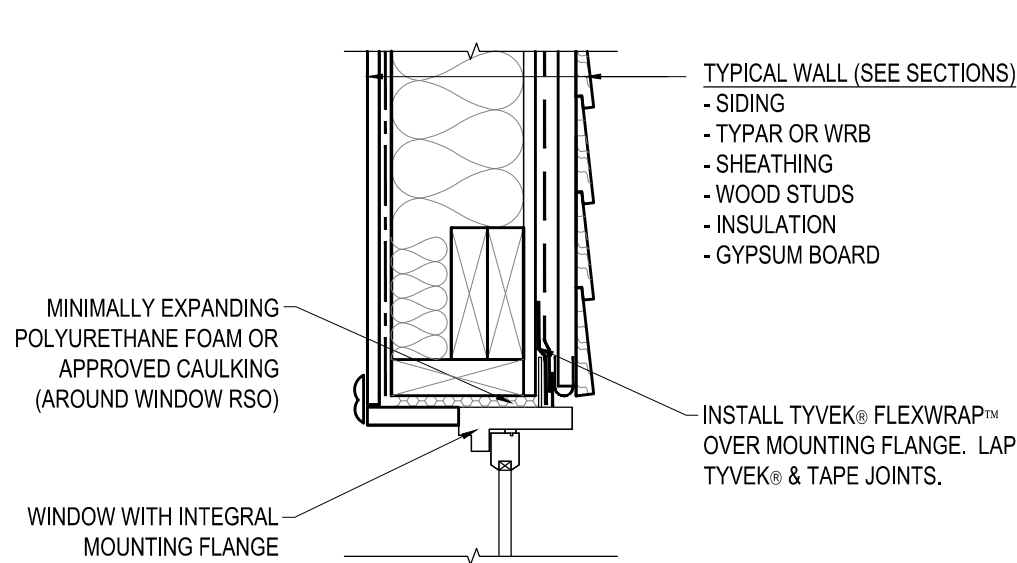


13 DETAIL - WINDOW HEAD FLASHING
A-4.1 SCALE: 1-1/2" = 1'-0"

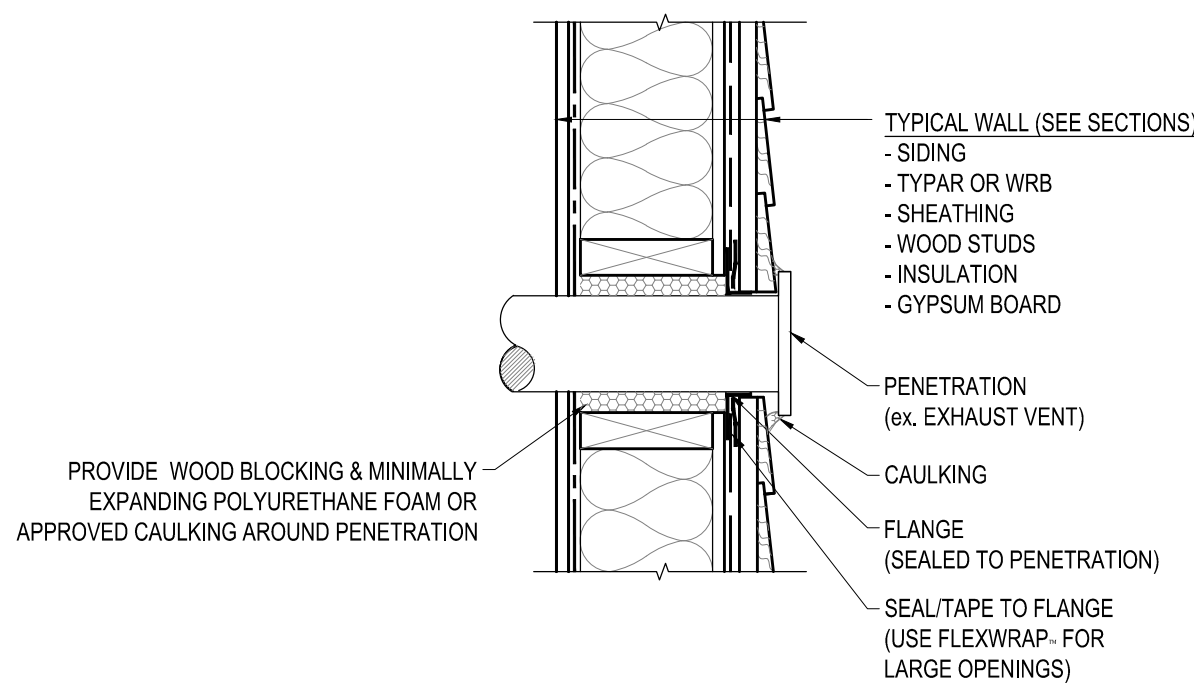


14 DETAIL - WALL PENETRATION
A-4.1 SCALE: 1-1/2" = 1'-0"

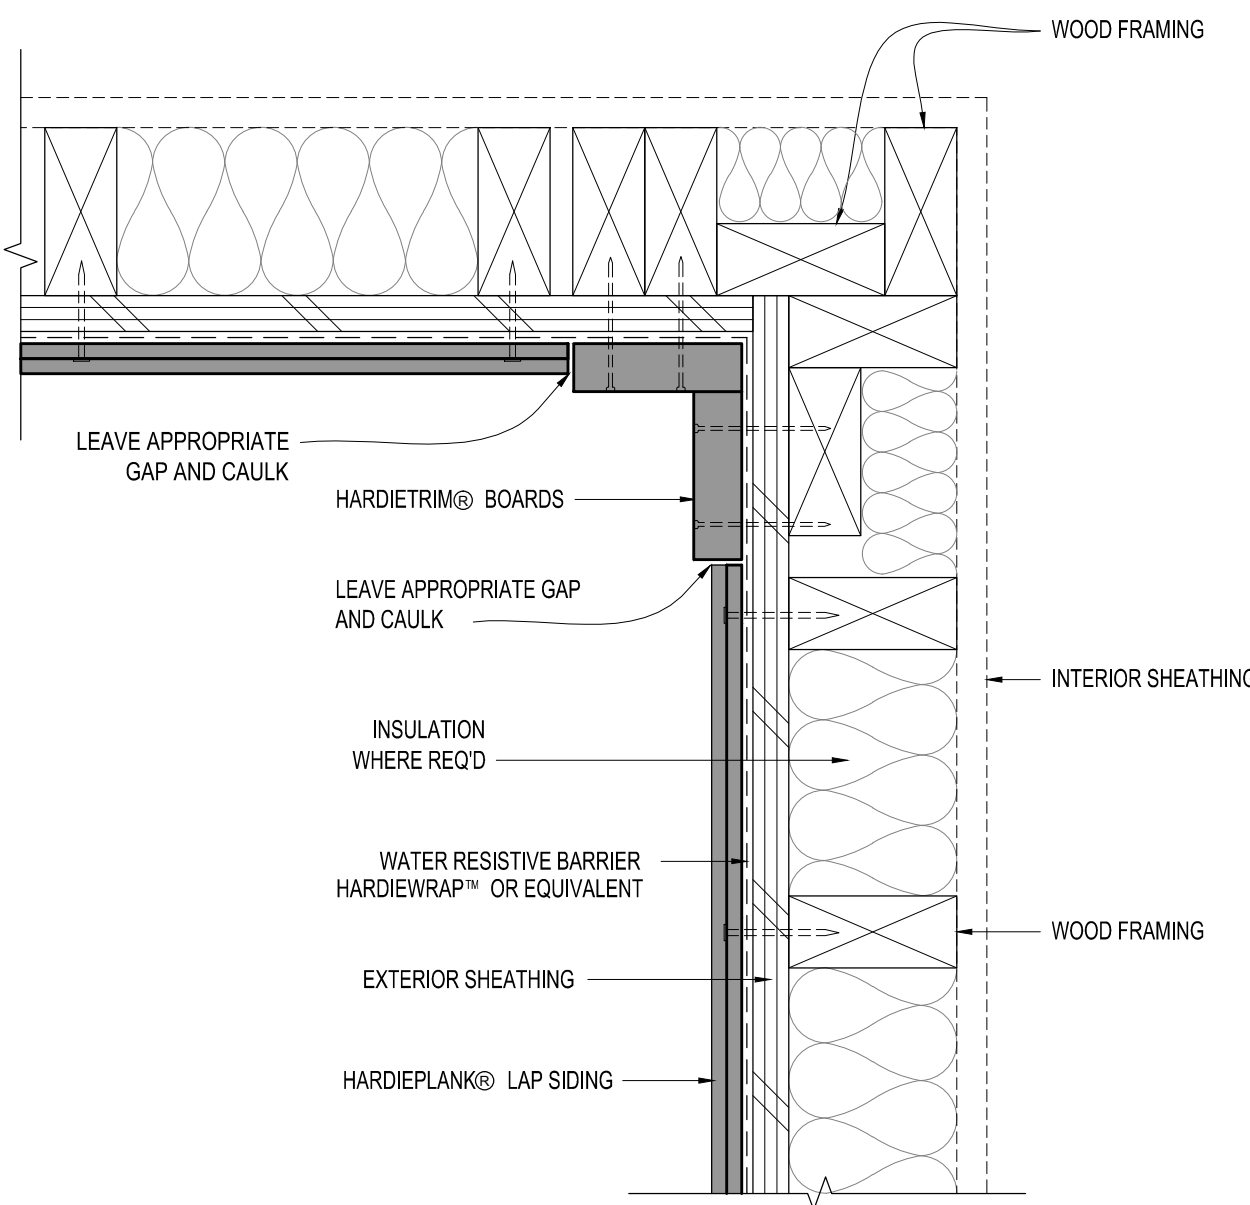


6 DETAIL - SIDING INSIDE CORNER
A-4.1 SCALE: 3" = 1'-0"

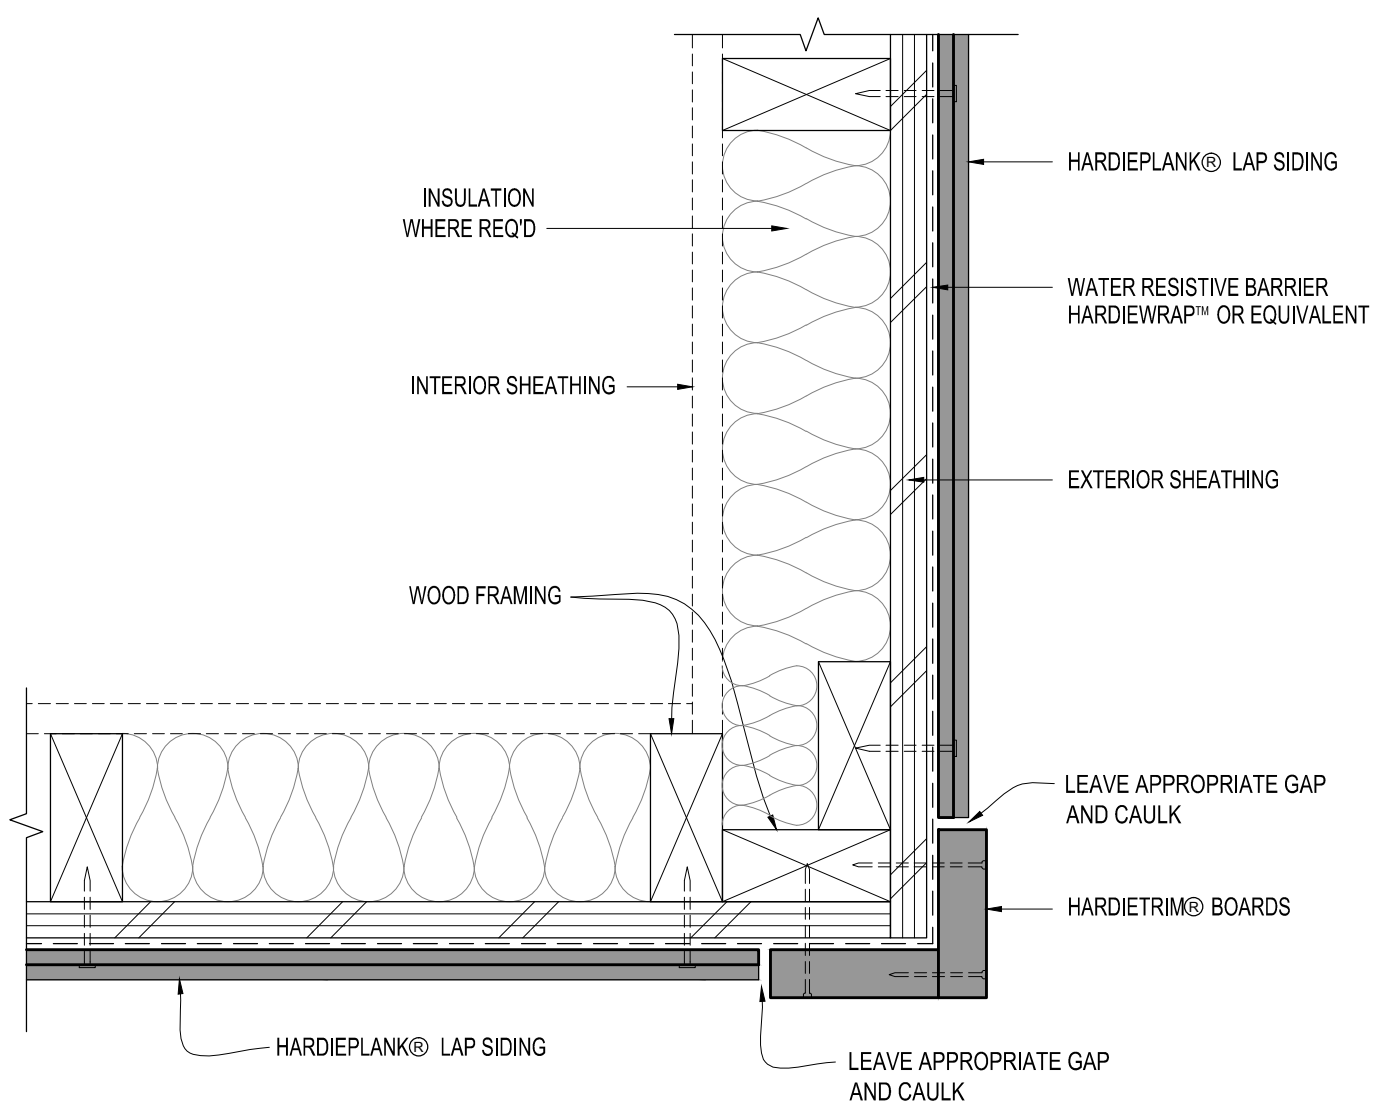


7 DETAIL - SIDING OUTSIDE CORNER
A-4.1 SCALE: 3" = 1'-0"

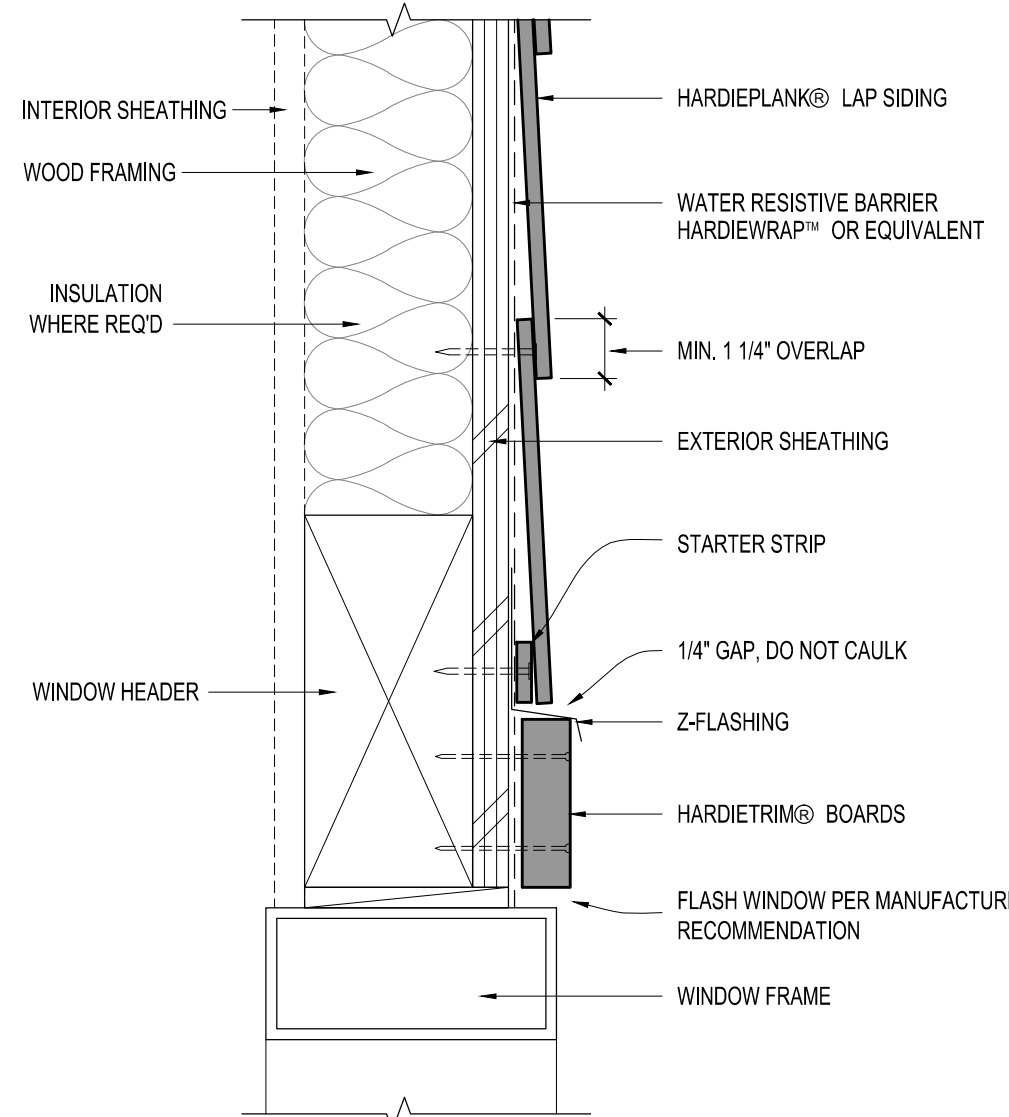


8 DETAIL - SIDING WINDOW / DOOR HEAD
A-4.1 SCALE: 3" = 1'-0"

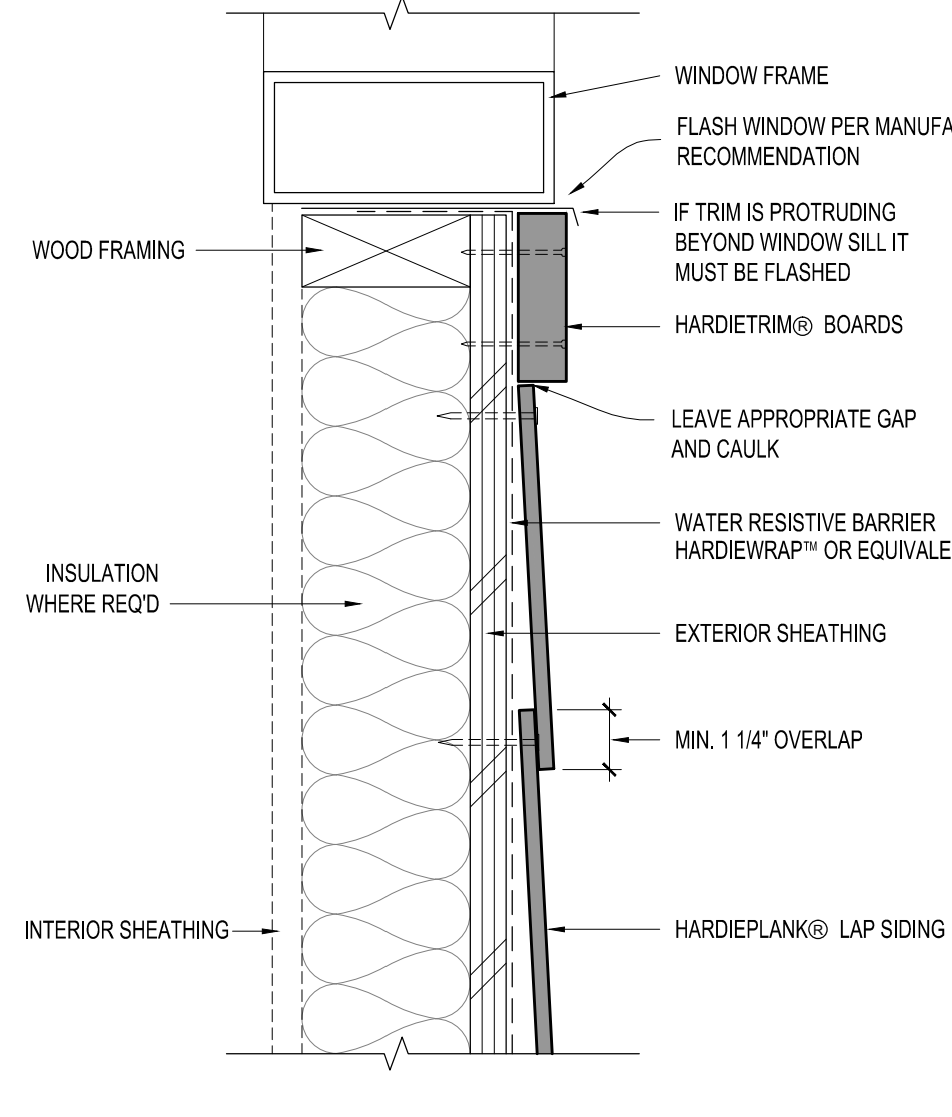


9 DETAIL - SIDING WINDOW / DOOR SILL
A-4.1 SCALE: 3" = 1'-0"

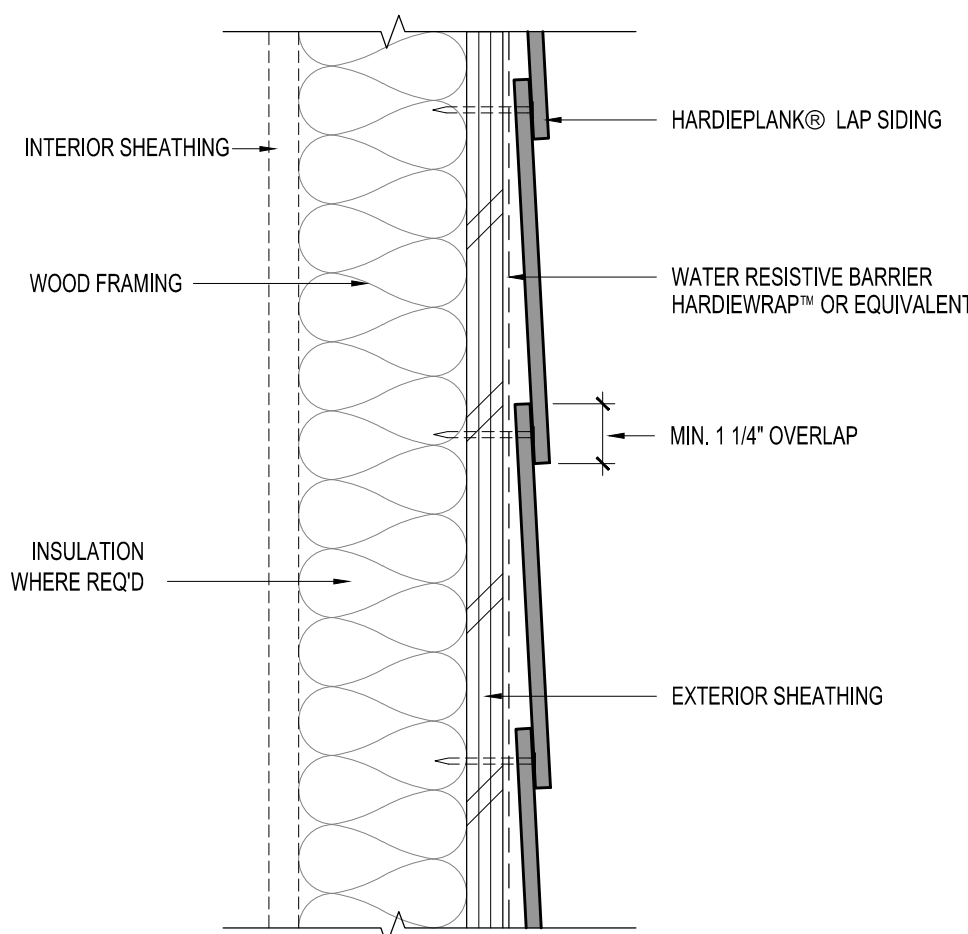


10 DETAIL - SIDING TYPICAL WALL
A-4.1 SCALE: 3" = 1'-0"

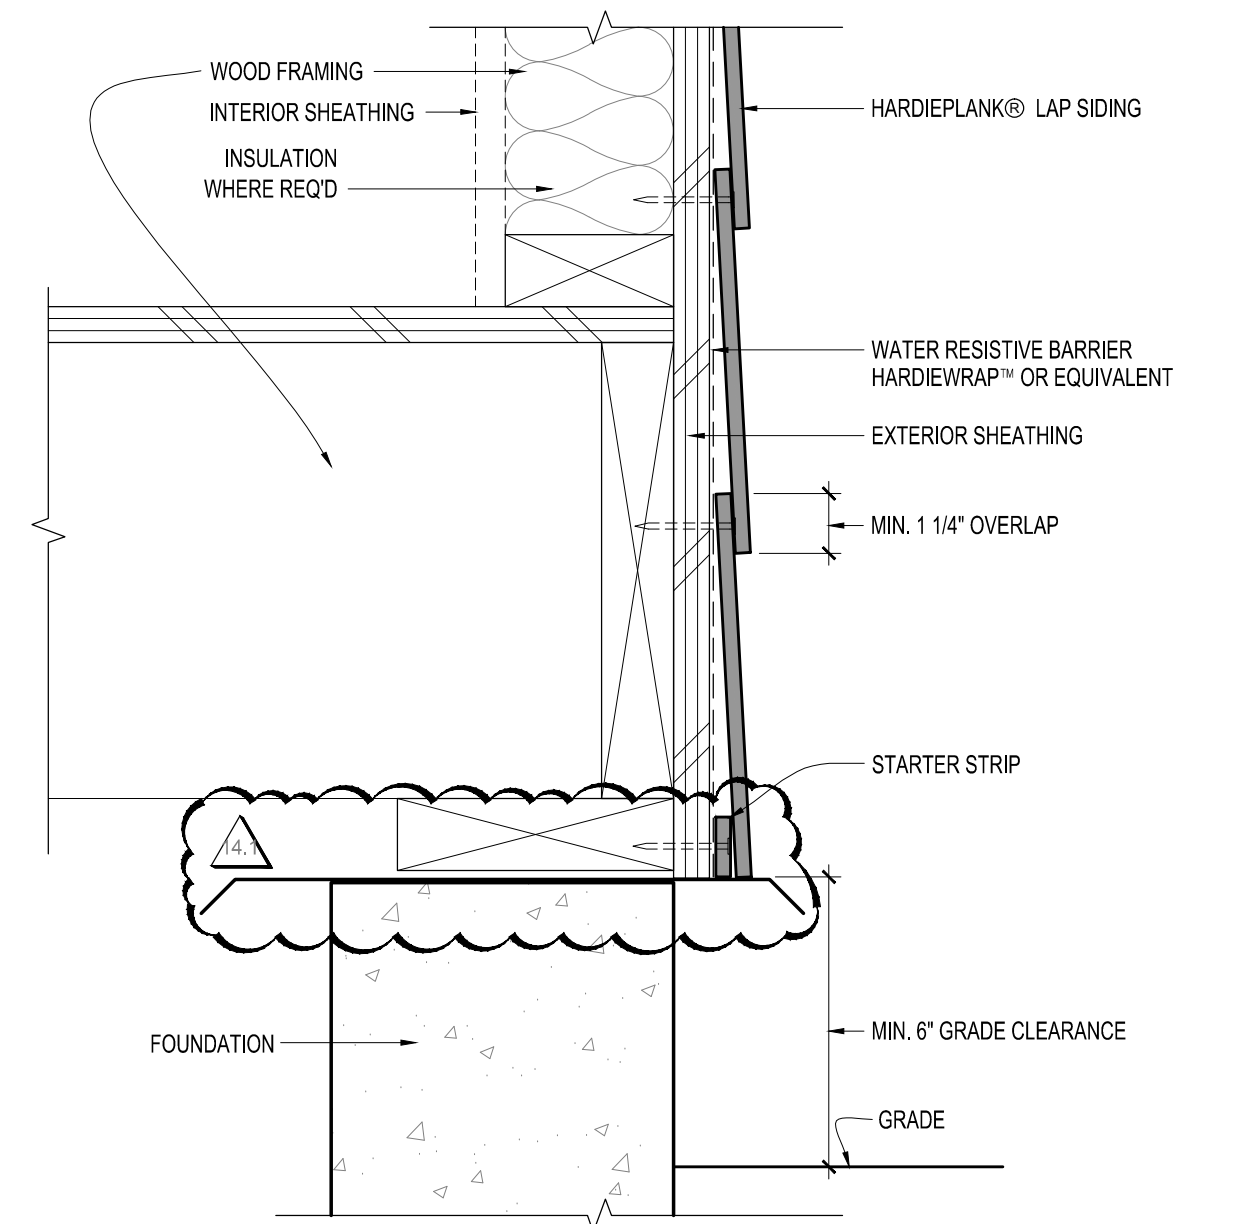


1 DETAIL - SIDING AT GRADE
A-4.3 SCALE: 3" = 1'-0"

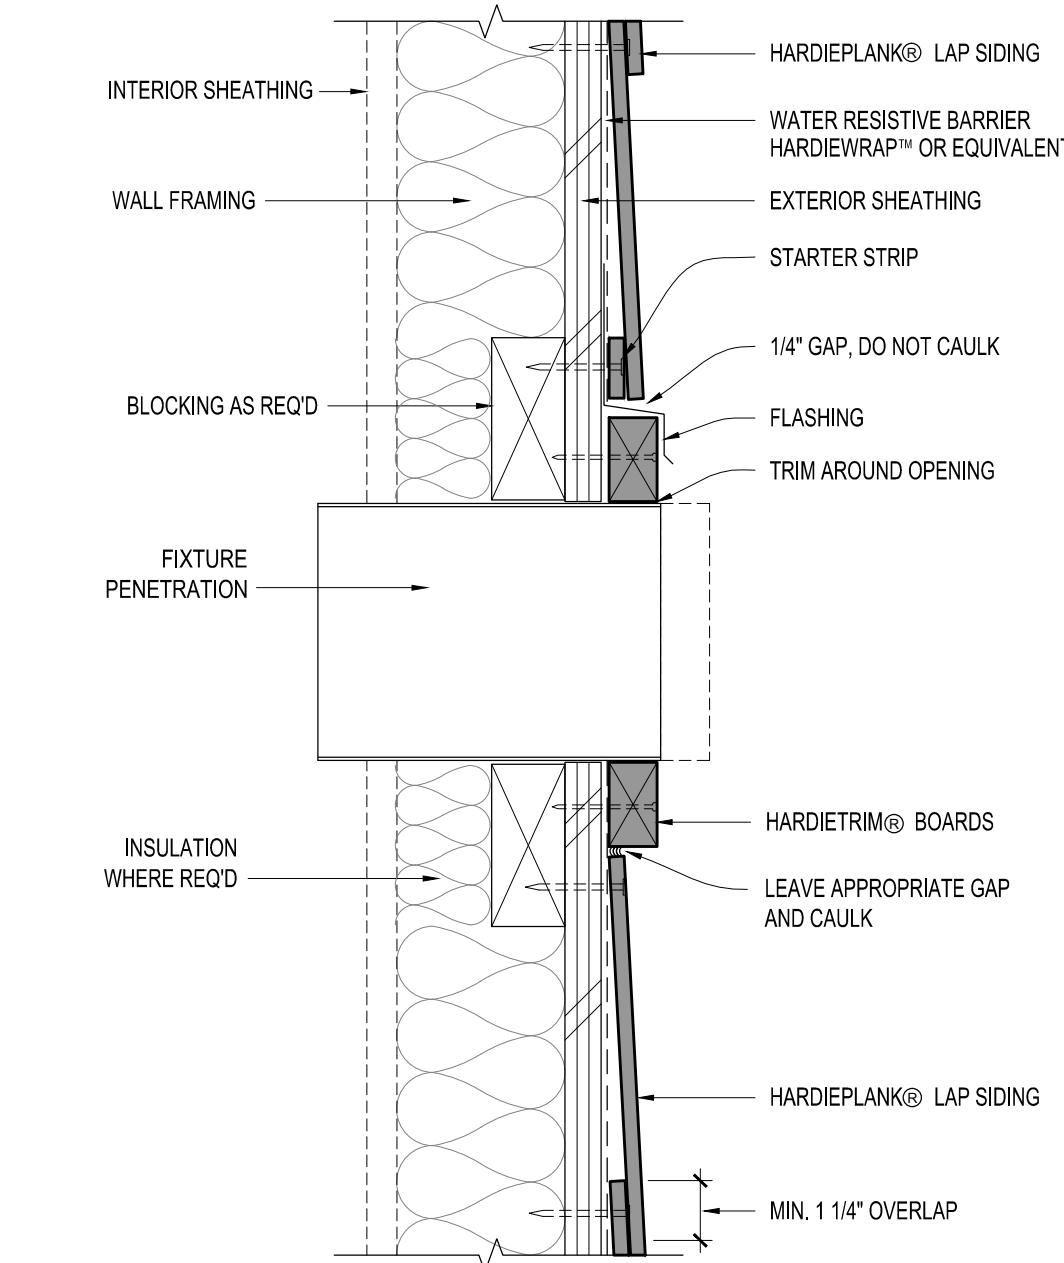


2 DETAIL - SIDING AT PENETRATION
A-4.3 SCALE: 3" = 1'-0"

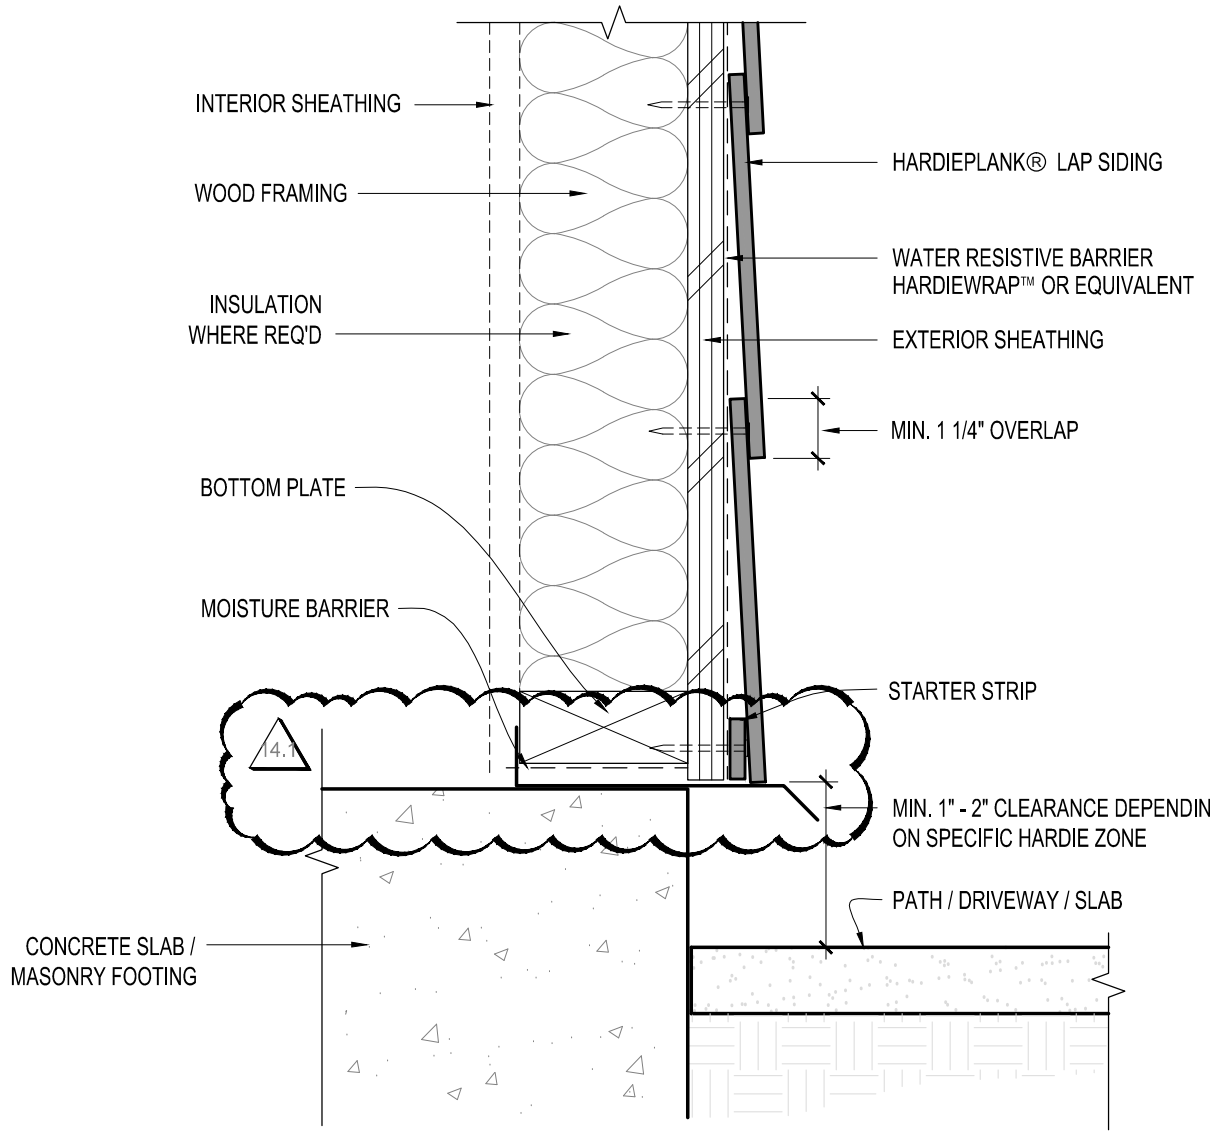

3 DETAIL - SIDING AT PATH / DRIVEWAY
A-4.3 SCALE: 3" = 1'-0"

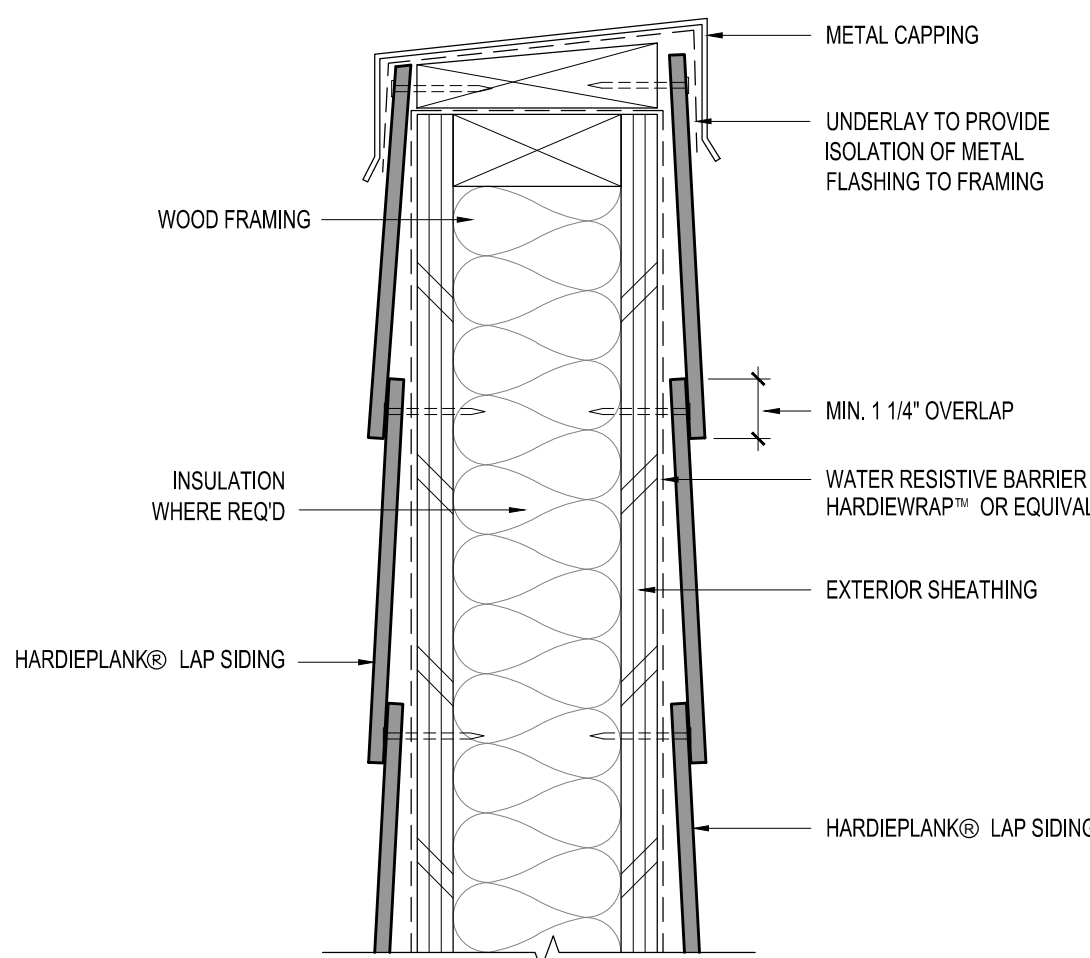

4 DETAIL - SIDING AT PARAPET WALL
A-4.3 SCALE: 3" = 1'-0"

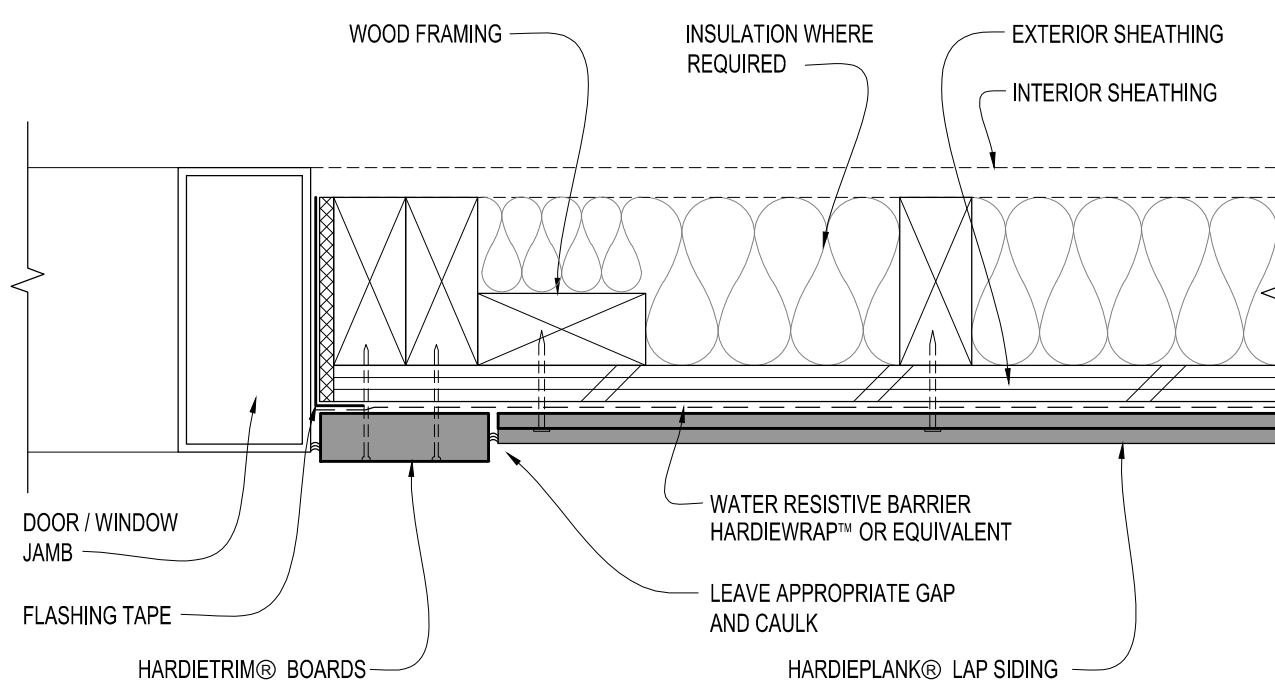

5 DETAIL - SIDING AT WINDOW / DOOR JAMB
A-4.3 SCALE: 3" = 1'-0"



Recovery Centers of America


Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal

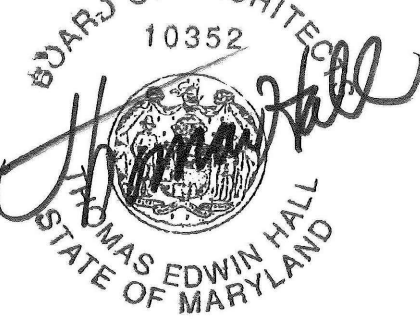

THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL UNTIL SIGNED AND SEALED.
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

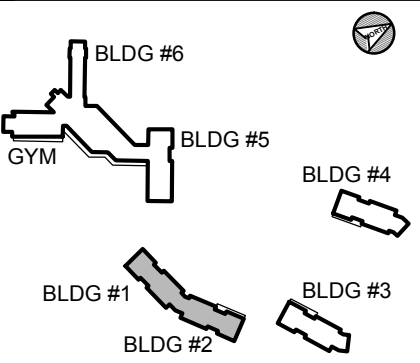

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☒ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions

No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00

Drawn By:


Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

FOLDING PARTITION
DETAILS

Sheet No:


A-4.2

BILLINGSLEY BUILDINGS 1&2

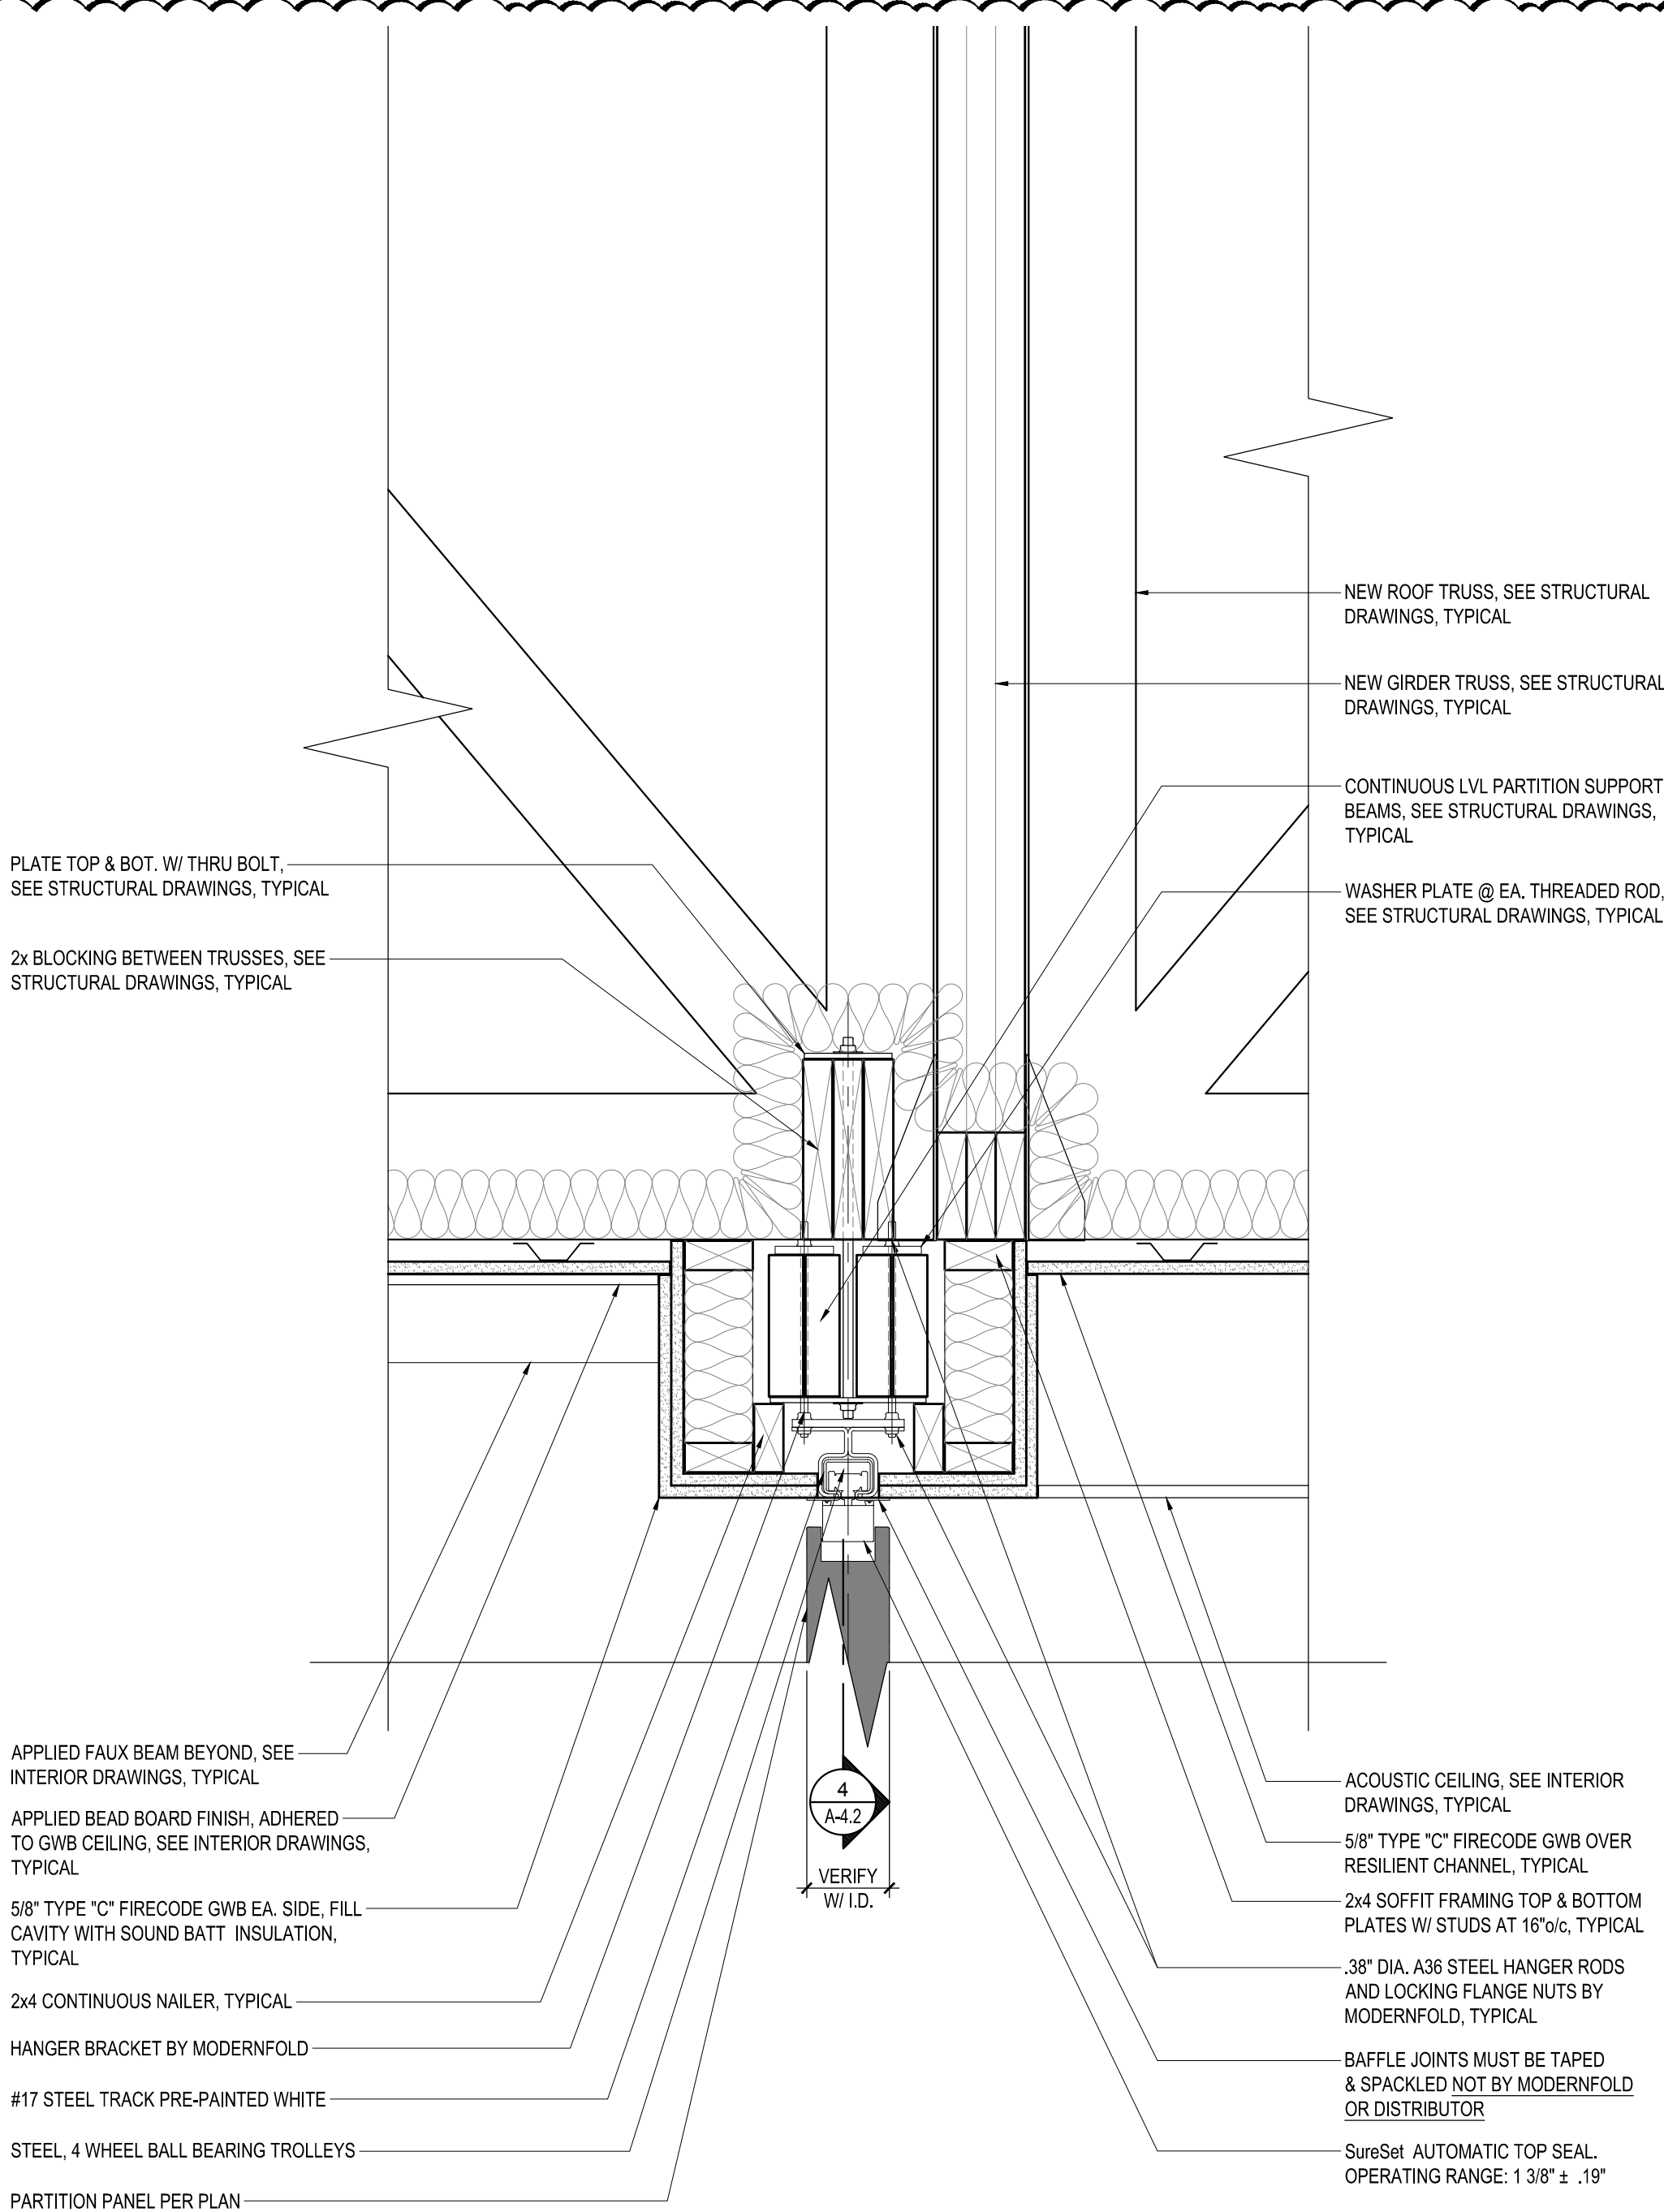


3 SECTION DETAIL - TYPICAL FOLDING PARTITION, 2ND FLOOR

A-4.2 SCALE: 1 1/2" = 1'-0"

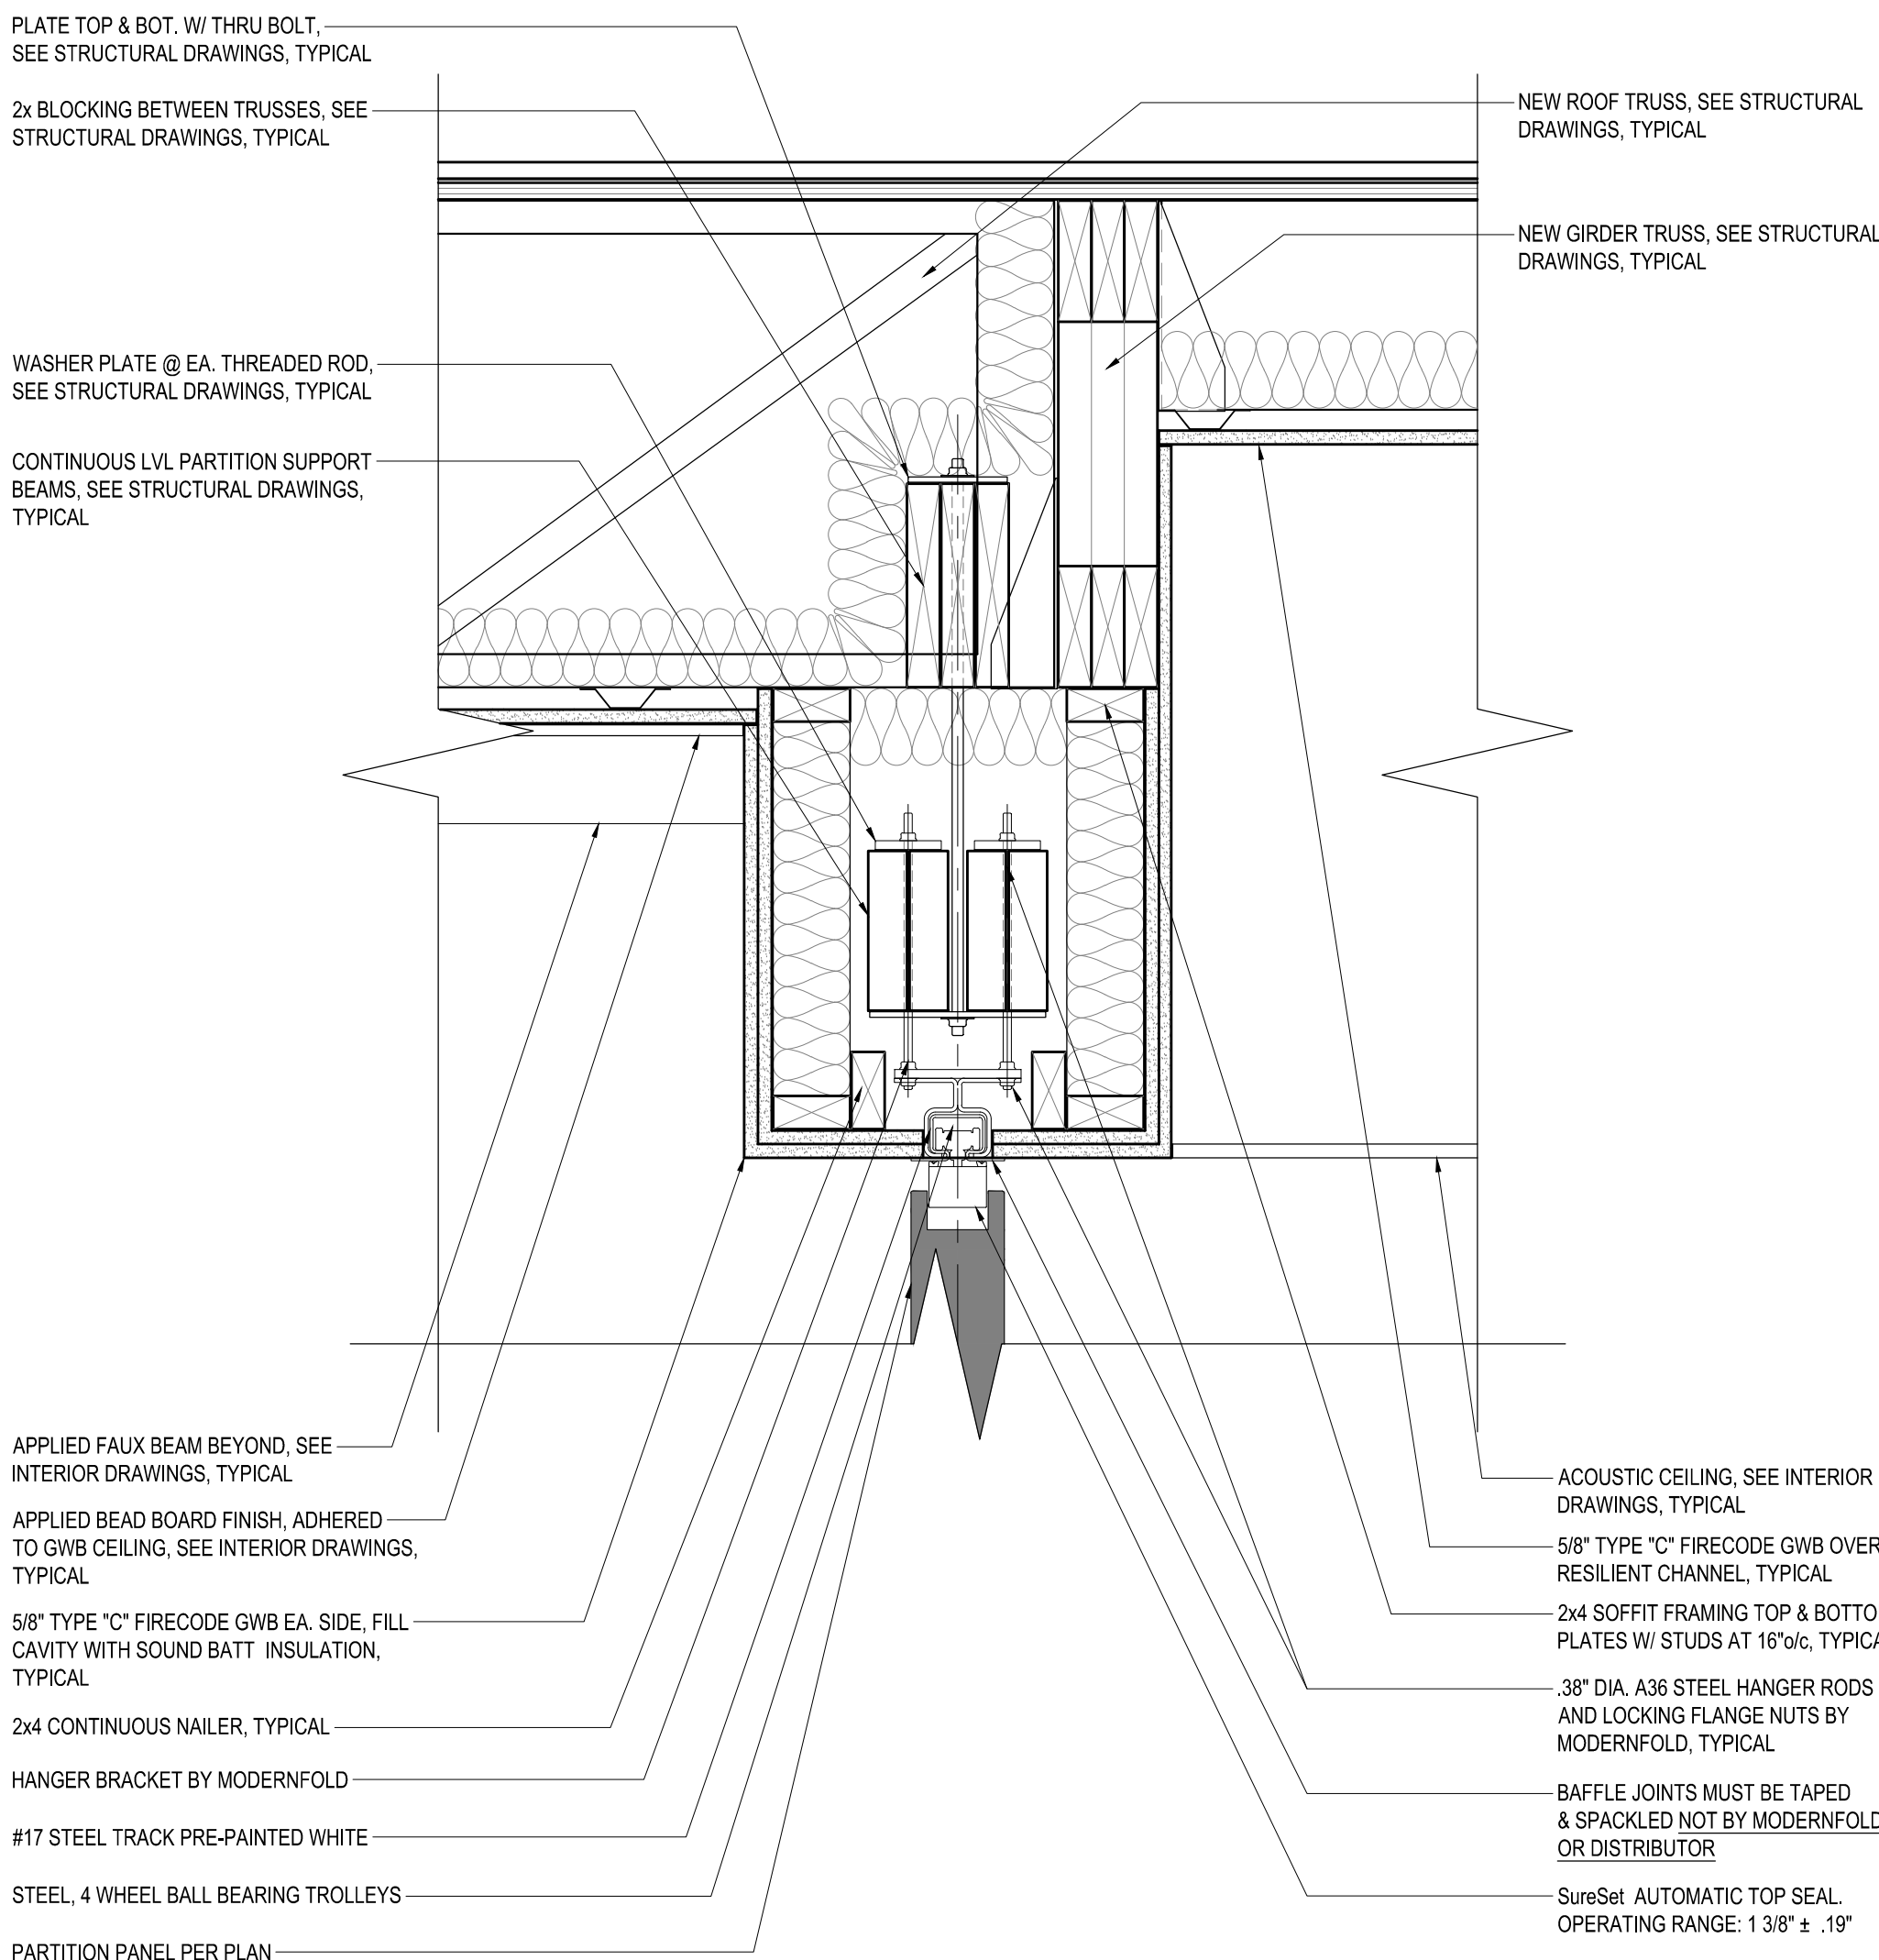


2 SECTION DETAIL - TYPICAL FOLDING PARTITION, 1ST FLOOR

A-4.2 SCALE: 1 1/2" = 1'-0"

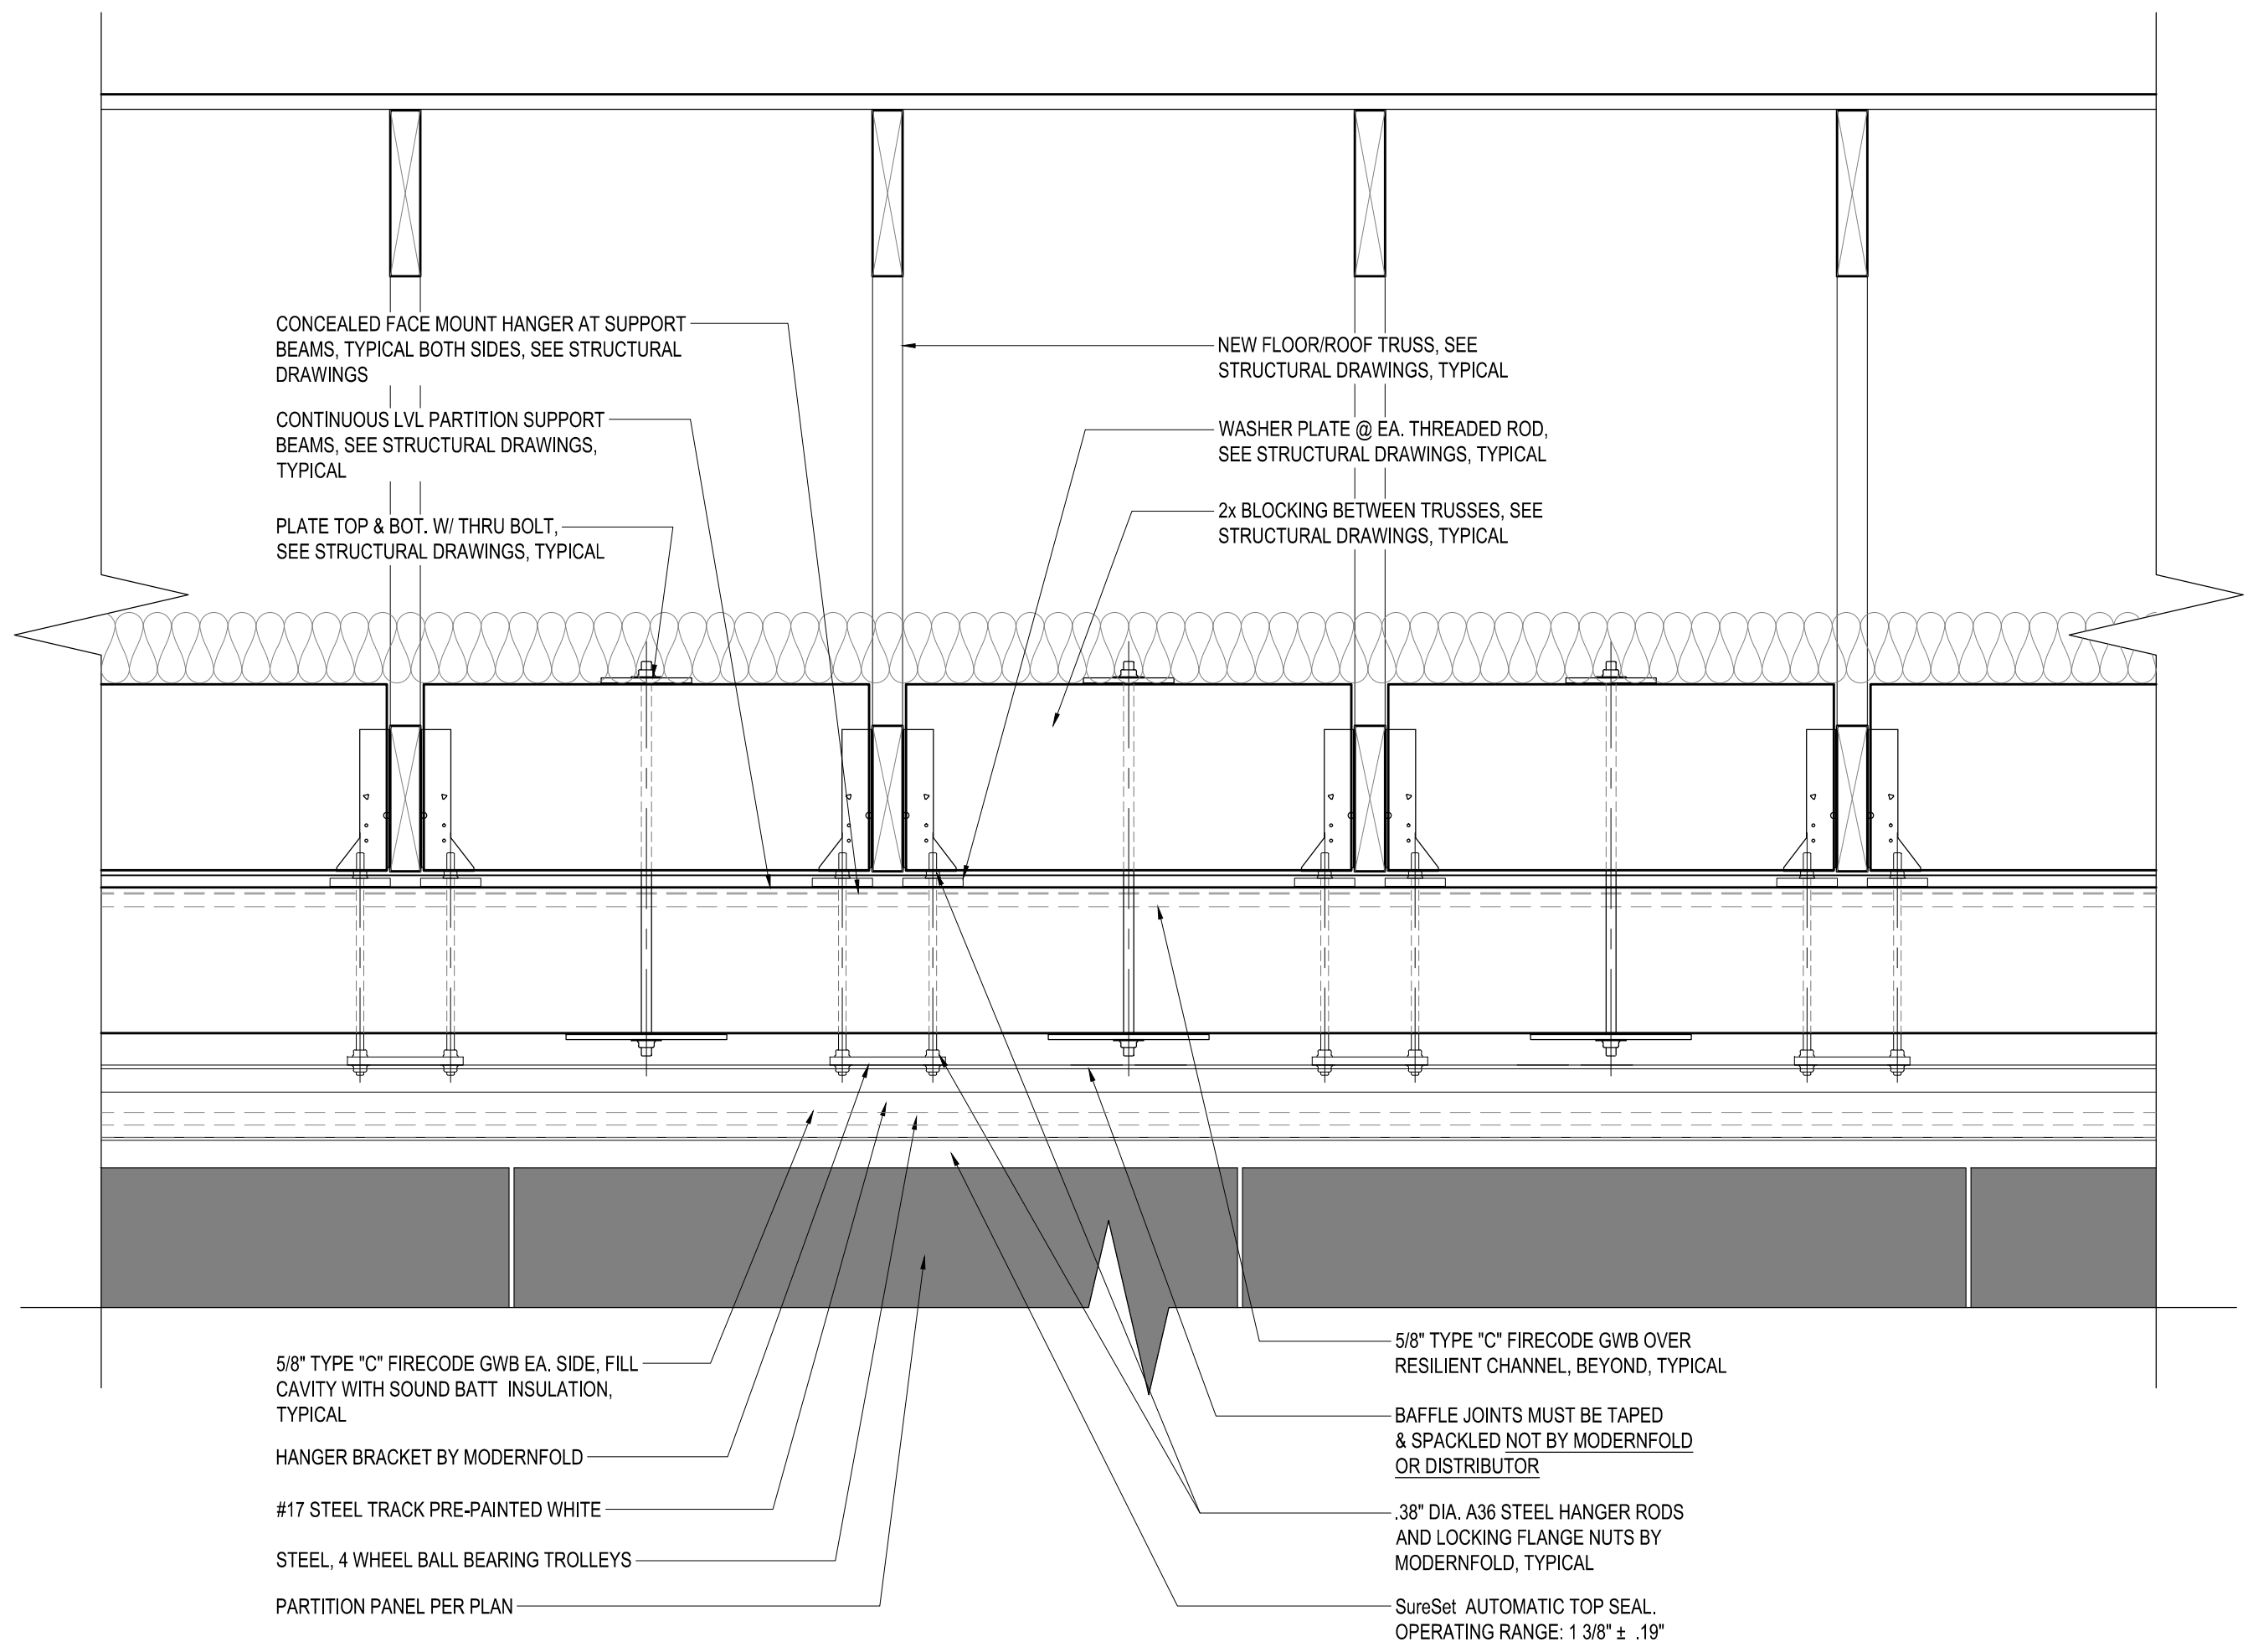

4 SECTION DETAIL - TYPICAL FOLDING PARTITION

A-4.2 SCALE: 1 1/2" = 1'-0"

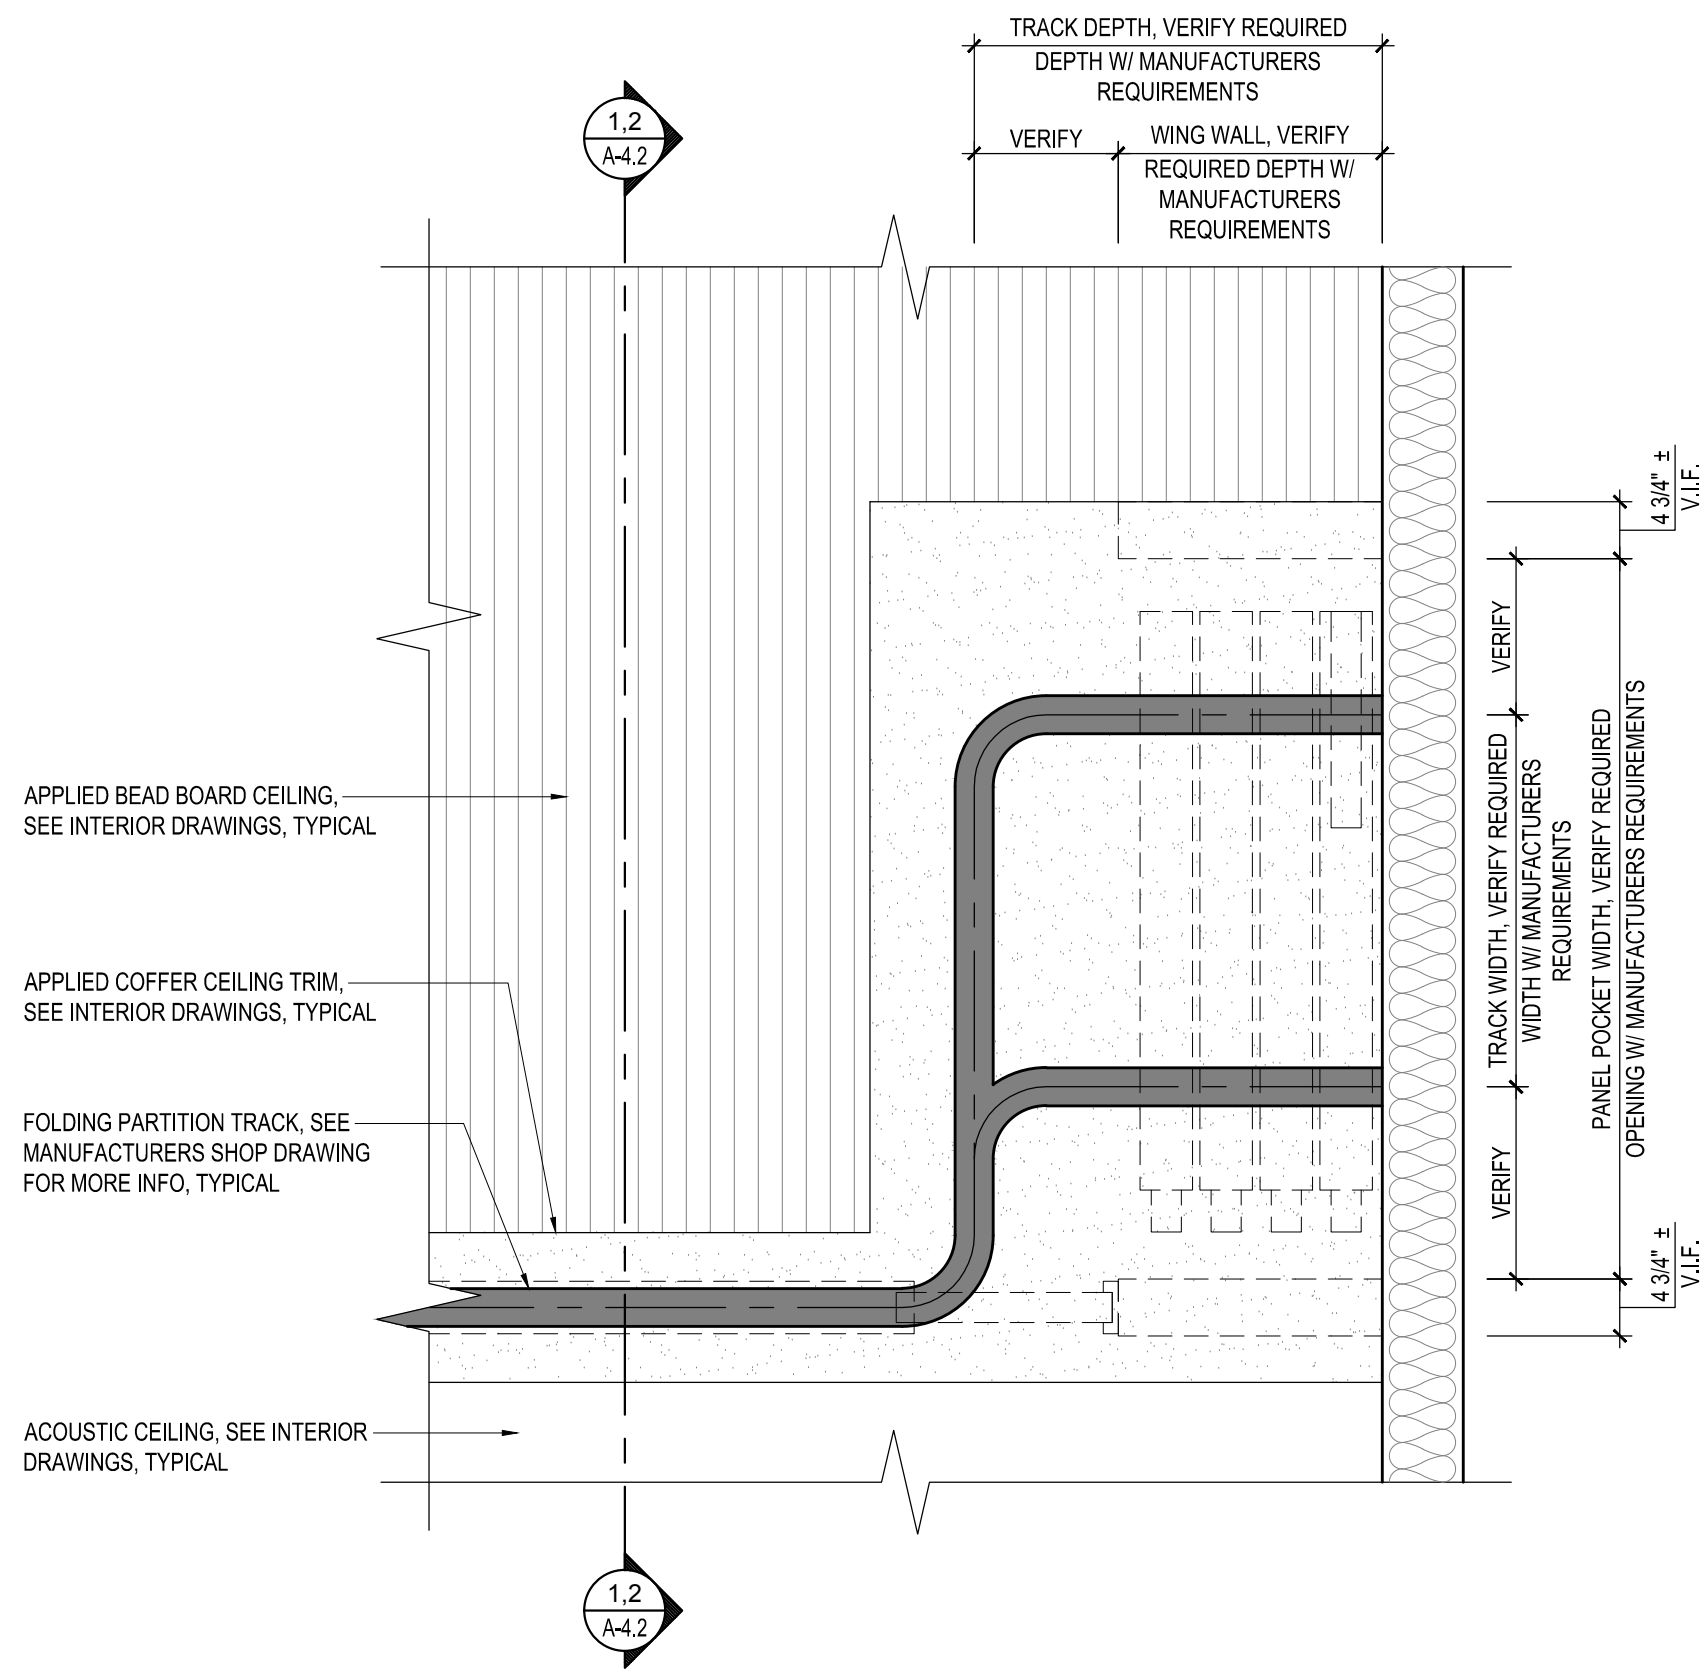

1 RCP DETAIL - TYPICAL FOLDING PARTITION

A-4.2 SCALE: 3/4" = 1'-0"



Project

**BILLINGSLEY
FACILITY
BUILDINGS 1&2**
11,100 BILLINGSLEY
ROAD WALDORF,
MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teth-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT
OFFICIAL UNTIL SIGNED AND SEALED.
CONTRACTOR SHALL VERIFY DIMENSIONS AND
SITE CONDITIONS AND REPORT ANY
DISCREPANCIES TO THE ARCHITECT. THE
ARCHITECT IS NOT RESPONSIBLE FOR ANY
UNREPORTED DISCREPANCIES.

Consultant

Key Plan

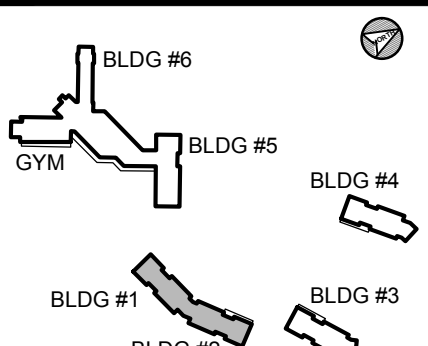

Project Type

- ☐ Alteration
☒ Remodel
☒ New Addition
☐ New Construction

Drawing Status

- ☐ Design Phase
☐ Not For Construction
☐ For Pricing
☐ For Permit
☒ Revision
☒ For Construction

Revisions





No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00
Drawn By: FJF
Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

WINDOW SCHEDULE

Sheet No:

A-6.0

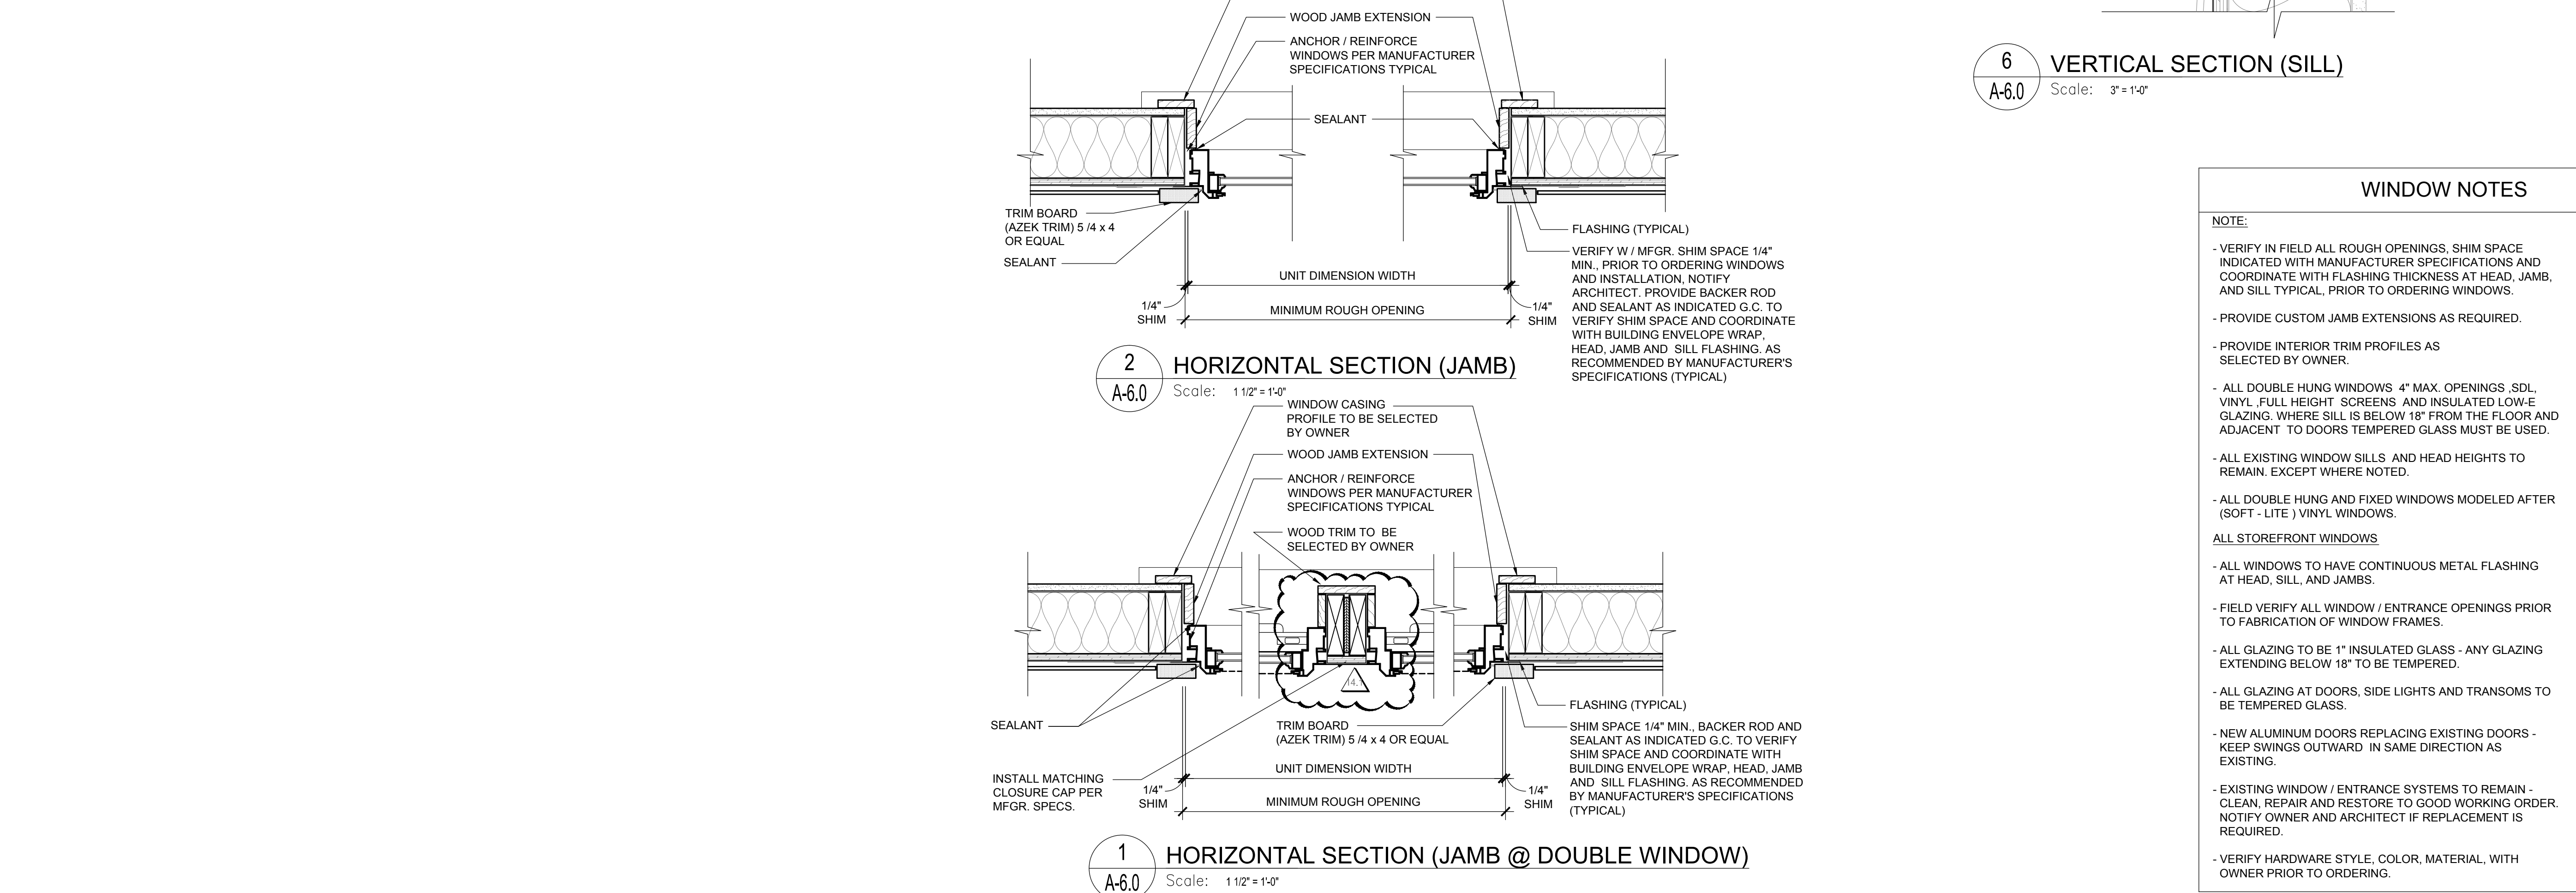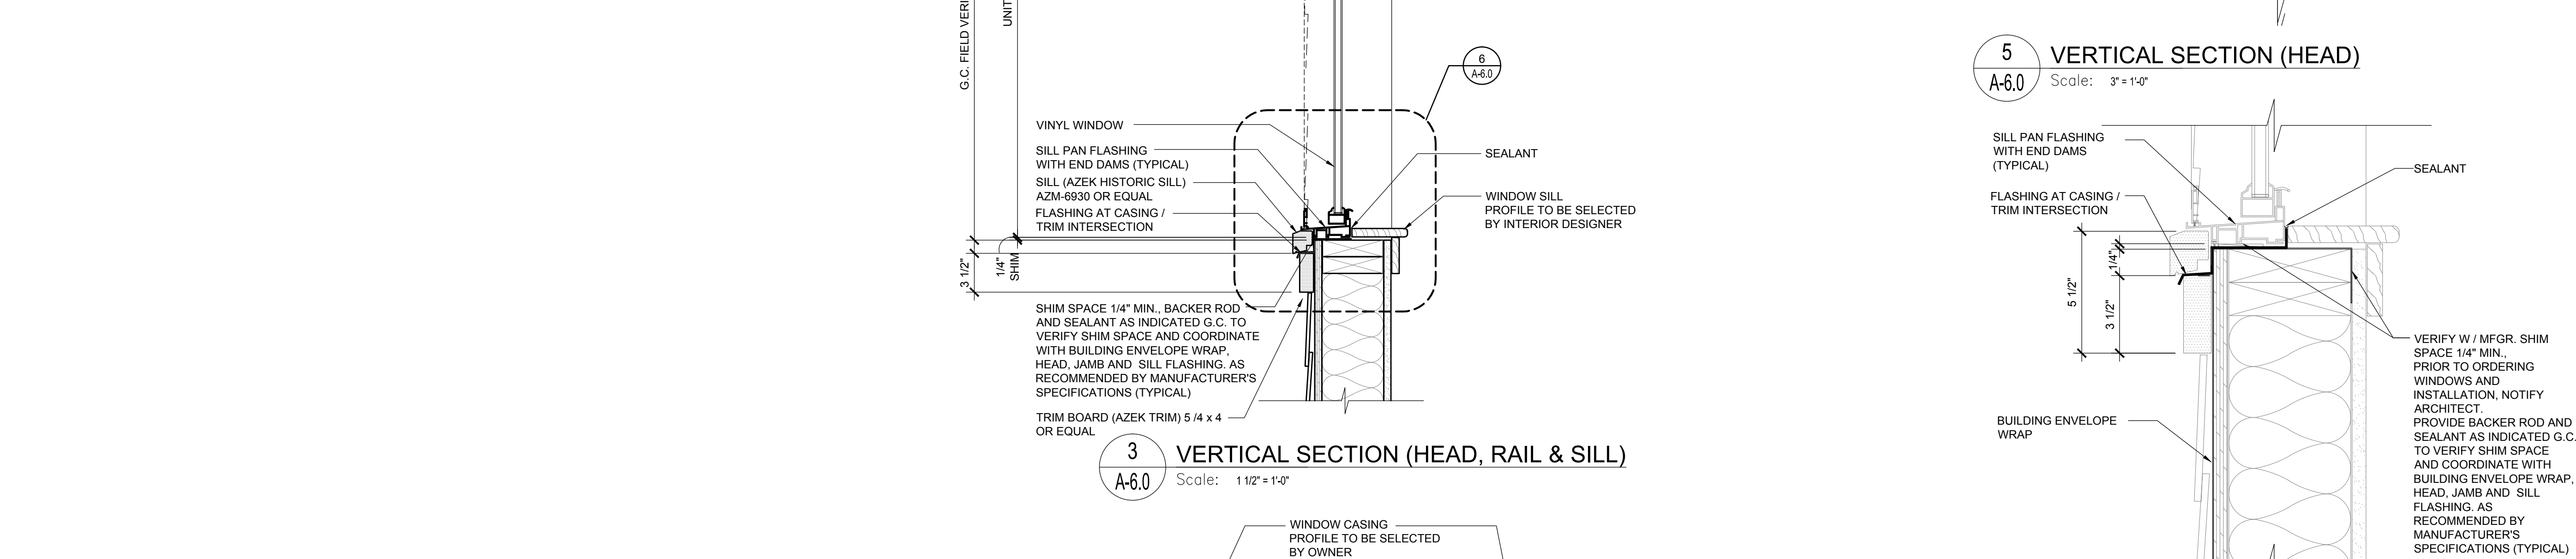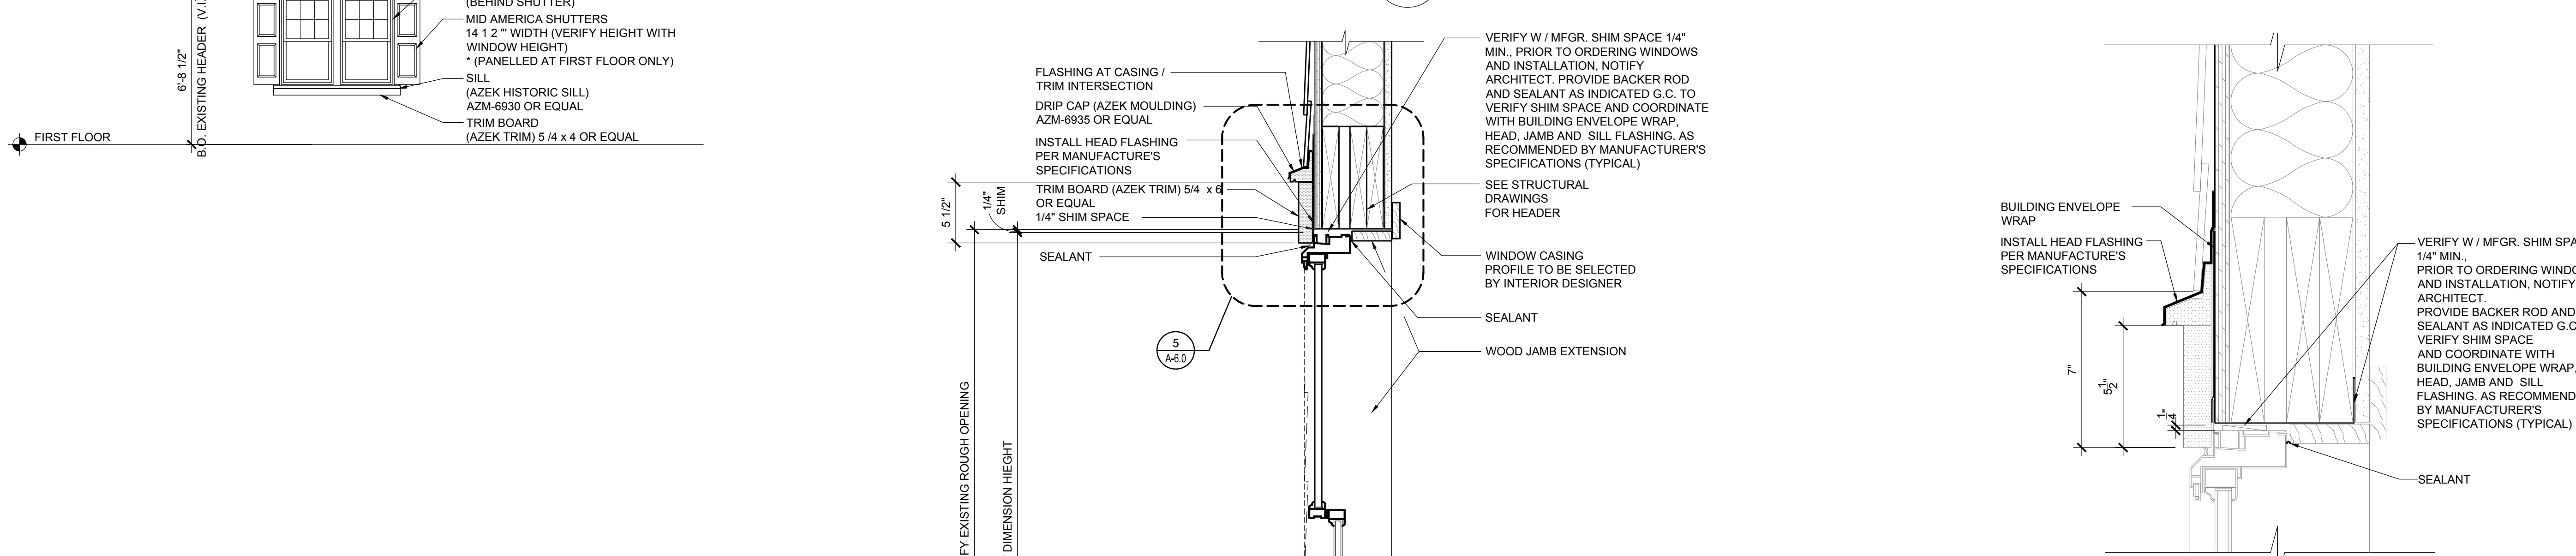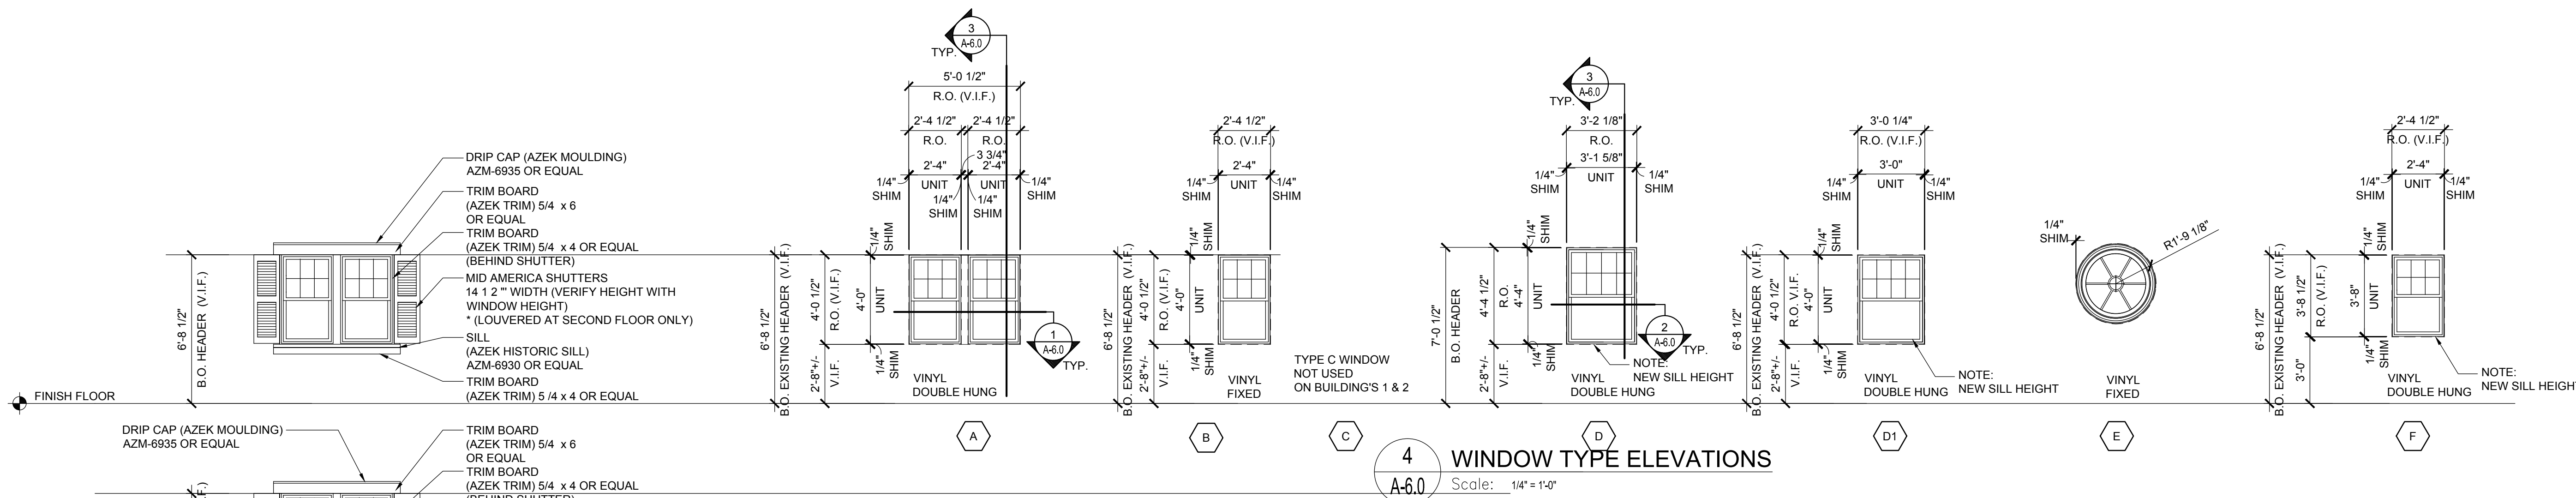

BLDG 1 & 2 - DOOR SCHEDULE - SECOND FLOOR													
DOOR NO.	ROOM NAME	WIDTH	HEIGHT	THICK	DOOR			FRAME			HDWR	FIRE RATING	REMARKS
					MAT.	FINISH	TYPE	MAT.	FINISH	TYPE			
2-100	LOUNGE			N/A				N/A			N/A	N/A	FOLDING PARTITION SUBMIT SHOP DRAWINGS
2-101	ALCOVE	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-101A	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-101B	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-101C	CORRIDOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-102	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-102A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-103	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-103A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-104	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-104A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-105	STAIRS	3'-0"	7'-0"	1-3/4"	WDGL	PTD	Q	HM	PTD	15	6.0	1 HOUR	SURFACE MOUNTED CLOSER
2-106	LAUNDRY	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-107	SOILED LINEN	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	12.0	1 HOUR	SURFACE MOUNTED CLOSER
2-108	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-108A	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-108B	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-109C	CORRIDOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-109	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-109A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-110	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-110A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-111	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-111A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-112	LOUNGE			N/A							N/A	N/A	FOLDING PARTITION SUBMIT SHOP DRAWINGS
2-113	WORK STATION	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-114	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-115	STAFF TOILET ROOM	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	16.0	20 MIN	SURFACE MOUNTED CLOSER
2-116	ROOM	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-117	BEDROOM (3)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-117A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-118	BEDROOM (3)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-118A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-119	BEDROOM (2) 'FA'	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-119A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-120	LOUNGE / GROUP ROOM	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-121	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-121A	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-122	CLEAN LINEN	(2) 3'-0"	7'-0"	1-3/4"	WD	PTD	O	HM	PTD	16	7.0	20 MIN	
2-123	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-124	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-124A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-125	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-125A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-126	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-126A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-127	JAN. CL.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	12.0	1 HOUR	SURFACE MOUNTED CLOSER
2-128	CLEAN LINEN	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	10.0		
2-129	OFFICE	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-130	MECHANICAL ROOM	3'-0"	7'-0"	1-3/4"	MTL	PTD	S	HM	PTD	15	11.0	1 HOUR	SURFACE MOUNTED CLOSER
2-130A	SERVER	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	12.0	1 HOUR	SURFACE MOUNTED CLOSER
2-131	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-131A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-132	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-132A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-133	BEDROOM (2)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-133A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WDGL	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-134	GROUP ROOM	3'-0"	7'-0"	1-3/4"	WDGL	PTD	N	HM	PTD	15	15.0	20 MIN	SURFACE MOUNTED CLOSER
2-135	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-136	STORAGE	(2) 3'-0"	7'-0"	1-3/4"	WD	PTD	O	HM	PTD	16	7.1	20 MIN	SURFACE MOUNTED CLOSERS

BLDG 1 & 2 - DOOR SCHEDULE - SECOND FLOOR CONT.													
DOOR NO.	ROOM NAME	WIDTH	HEIGHT	THICK	DOOR			FRAME			HDWR	FIRE RATING	REMARKS
					MAT.	FINISH	TYPE	MAT.	FINISH	TYPE			
2-137	LOUNGE / GROUP ROOM	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-138	BEDROOM (2) 'FA'	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-138A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-139	BEDROOM (3)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-139A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-140	BEDROOM (3)	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	17.0	20 MIN	CLOSER SEE HARDWARE SET
2-140A	TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	14	18.0		PROVIDE EMERGENCY PINKEY FOR STAFF ENTRY
2-141	STAFF TOIL RM.	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	16.0	20 MIN	SURFACE MOUNTED CLOSER
2-142	ROOM	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	13.0	20 MIN	SURFACE MOUNTED CLOSER
2-143	ROOM	3'-0"	7'-0"	1-3/4"	WD	PTD	M	HM	PTD	15	19.0	20 MIN	SURFACE MOUNTED CLOSER, SEE NOTE 23
2-144	WORK STATION	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-145	CORRIDOR	3'-0"	7'-0"	1-3/4"	MTLGL	PTD	E	AL	PTD	01	2.0		EXTERIOR DOOR, SEE NOTE 23, SURFACE MOUNTED CLOSER / FINISH: BLACK ANODIZED ALUMINUM
2-146	CORRIDOR	(2) 2'-10"	7'-0"	1-3/4"	WD	PTD	O	HM	PTD	17	5.0	1 HOUR	'SMOKE BARRIER' - OPPOSING SWING, RT DOOR, HOLD OPEN, CLOSER SEE HARDWARE SET
2-147	CORRIDOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
2-148	CORRIDOR	3'-0"	7'-0"	1-3/4"	MTLGL	PTD	E	AL	PTD	01	2.0		EXTERIOR DOOR, SEE NOTE 23, SURFACE MOUNTED CLOSER / FINISH: BLACK ANODIZED ALUMINUM
A-100	ATTIC ACCESS DOOR	3'-0" +/- (V.I.F.)	5'-0" +/- (V.I.F.)	1-3/4"	MTL	HM-1	PTD	C	HM	PTD	01	4.0	EXTERIOR DOOR SURFACE MOUNTED CLOSER FINISH: BLACK

GENERAL DOOR NOTES													
1.	SEE FLOOR PLAN TO CONFIRM DOOR SWING												
2.	ALL DOORS ARE KEYPED TO BE INDIVIDUALLY KEYPED ON A SINGLE MASTER KEY AND KEYPED TO MATCH BUILDING MASTER KEY SYSTEM. ALL CORES TO BE REMOVABLE. ALL DOOR CLOSURES ARE TO BE ADA, ANSI A117.1 COMPLIANT WITH CLOSING SPECIFICATIONS AS FOLLOWS:												
2.1.	FROM AN OPEN POSITION OF 70 DEGREES, IT WILL TAKE 3 SECONDS TO MOVE TO A POINT 3" FROM THE LATCH.												
2.2.	MAXIMUM OPENING FORCE OF 5 LBS												
3.	ALL DOORS MUST HAVE SILENCERS												
4.	ALL NEW LEVER HARDWARE TO BE ADA COMPLIANT												
5.	ALL NEW HM INTERIOR DOOR FRAME TO BE KD HOLLOW METAL FRAMES, COORDINATE DOOR TRIM WITH WALL WIDTH ON WHICH IT APPEARS												
6.	ALL NEW EMERGENCY RELEASE STOP ACCESS DOOR FRAMES TO BE COORDINATED WITH WALL WIDTH ON WHICH IT APPEARS												
7.	ALL PATIENT TOILET ROOMS TO HAVE EMERGENCY RELEASE STOP, THERMAL FUSED DOORS, CONTINUOUS SWING CLEAR												
8.	PROVIDE FLOOR DOOR STOPS WHERE DOOR STOPS AT ALL DOORS AS REQUIRED												
9.	ALL INTERIOR HARDWARE AND HINGES TO BE BRIGHT CHROMIUM PLATED (US2B)												
10.	ALL NEW BUTT HINGES TO BE HEAVY DUTY												
11.	SECURITY AND KEYING TO BE COORDINATED WITH BUILDING OWNER, SECURITY VENDOR AND DOOR HARDWARE PROVIDER PRIOR TO ORDERING												
12.	THE SECURITY SYSTEM NEEDS TO BE TIED INTO THE FIRE ALARM SYSTEM AND BE "FAIL SECURE"												
13.	PROVIDE "SOUND TRANSMISSION" CONTROL WITH ALL APPROPRIATE SEALS AND THRESHOLDS ON ALL INTERIOR DOORS												
14.	PROVIDE INTEGRATED WEATHER STRIPING AS REQUIRED FOR ALL EXTERIOR DOORS												
15.	PROVIDE "MICRO SHIELD" A BACTERIA, MOLD, MILDEW, ALGAE AND OTHER MICROBES INHIBITOR OR APPROVED EQUAL												
16.	PROVIDE CONCEALED CLOSERS WHERE NOTED ALL OTHER CLOSERS TO BE SURFACE MOUNTED OR SPRING HINGES												
17.	PROVIDE INTEGRATED PINPROXY BADGE READER ACCESS LOCKS ON ALL DOORS TO BE CONTROLLED BY STAFF. COORDINATE WITH SECURITY VENDOR, BUILDING OWNER AND ENGINEERS PRIOR TO ORDERING												
18.	ALL EXIT DOORS FROM THE WITHDRAWAL MANAGEMENT AREA TO RECEIVE CARD READERS ALARMED WITH A CHIME CONNECTED TO THE CLOSEST NURSE'S STATION												
19.	ALL EGRESS DOORS IN AREAS ACCESSIBLE BY PATIENTS SHOULD RECEIVE CARD READERS ALARMED WITH A CHIME CONNECTED TO THE CLOSEST NURSE'S STATION												
20.	ANY INTERIOR CARD READER SHOULD HAVE A CHIME ALARM (NOT SIREN)												
21.	ALL MAIN ENTRY DOORS TO HAVE AN INTERCOM FOR AFTER HOURS ADMITTING TO THE BUILDING, INTERCOM TO BE CONNECTED TO THE ADJACENT STAFF OCCUPIED AREA												
22.	PROVIDE FLUSH KD FRAMES WITH WOOD TRIM ON DOORS NOTED IN DOOR SCHEDULE. SEE ID DRAWINGS DOOR DETAILS												
23.	COORDINATE WITH OWNER SECURITY VENDOR ALL DOORS TO BE ALARMED												
24.	EXTERIOR DOOR PULLS TO BE BLACK ANODIZED ALUMINUM												
25.	ALL TOILET ROOM DOORS TO HAVE AN EMERGENCY PINKEY FOR STAFF ACCESS												
26.	ALL DOOR PULLS / HANDLES TO BE ADA COMPLIANT												

RATED DOOR NOTES													
1.	BEDROOM & GENERAL DOOR ASSEMBLY LOCATED IN A "1/2 OR 1 HOUR" RATED WALL ASSEMBLY TO BE 20 MINUTE RATED												
2.	ALL OTHER DOOR ASSEMBLY LOCATED IN A "1 HOUR" RATED WALL ASSEMBLY TO BE 1 HOUR RATED, IE: IT CLOSERS, JC CLOSERS, SOILED LINEN CLOSERS, STORAGE ROOMS, ELECTRIC CLOSERS/ROOMS, MECHANICAL ROOMS, ETC.												
3.	DOOR ASSEMBLY LOCATED IN A "SMOKE BARRIER" RATED WALL ASSEMBLY TO BE 1 HOUR RATED												
4.	ALL RATED INTERIOR GLAZING FOR DOORS TO BE FIRE-RATED AND IMPACT SAFETY GLAZING MATERIAL THAT BLOCKS RADIANT HEAT ASTM E-119, UL 263 "BARRIER TO HEAT" PRODUCT MANUFACTURED BY: TGP, SERIES: PILKINGTON PYROSTOP OR APPROVED EQUAL												
5.	NOTE: EXTERIOR DOORS DO NOT NEED TO BE RATED EXCEPT WHERE NOTED												
9.	IF A DOOR RATED ASSEMBLY IS NOT CALLED OUT IN THE DOOR SCHEDULE, A RATED ASSEMBLY WILL NOT BE REQUIRED												



Recovery Centers of America

Project

BILLINGSLEY FACILITY BUILDINGS 1&2
11,100 BILLINGSLEY ROAD WALDORF, MARYLAND 220602



Thomas E Hall & Associates, Inc.
240 Conestoga Road
Wayne, Pa 19087
(610) 293-9900
www.teh-architects.com
Architecture • Interiors • Planning


Seal



THESE DRAWINGS ARE PRELIMINARY AND NOT OFFICIAL UNTIL SIGNED AND SEALED. CONTRACTOR SHALL VERIFY DIMENSIONS AND SITE CONDITIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT. THE ARCHITECT IS NOT RESPONSIBLE FOR ANY UNREPORTED DISCREPANCIES.

Consultant

Key Plan

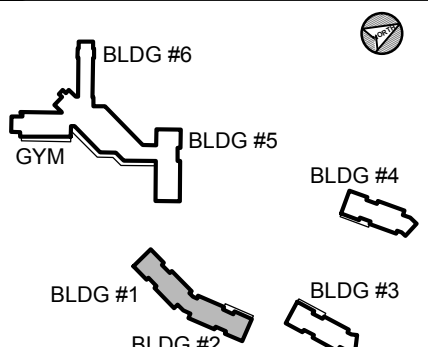

Project Type

- ☐ Alteration
- ☒ Remodel
- ☒ New Addition
- ☐ New Construction

Drawing Status

- ☐ Design Phase
- ☐ Not For Construction
- ☒ For Pricing
- ☐ For Permit
- ☒ Revision
- ☒ For Construction

Revisions

No.	Date	Description
	06/03/2016	REVISION #10
	07/07/2016	REVISION #11
	07/27/2016	REVISION #12
	09/16/2016	REVISION #13
	01/06/2017	REVISION #14
	02/03/2017	ADDENDUM #1

Job No: 6142.00

Drawn By:

Checked By: TEH
Date: 17 FEB 03
Scale: AS NOTED
Drawing Title:

DOOR & HARDWARE SCHEDULES

Sheet No:

A-6.3

BILLINGSLEY BUILDINGS 1&2

- Manufacturer Abbreviations
1. MK - McKinney
 2. PE - Pemko
 3. RF - Rixson
 4. RO - Rockwood
 5. SA - Sargent
 6. HS - HES
 7. NO - Norton
 8. SU - Securitron

Hardware Schedule

Set: 1.0

Doors: 1-100.1, 1-112.1

2 Pivot Set	147 BLACK	622	RF
2 Pivot	EM19 QC-12 BLACK	622	RF
1 Exit Device	DG164 SG 43 55 56 8710	US20D	SA
1 Exit Device	DG164 SG 43 55 56 8710	US20D	SA
2 Pull	RM3301-72 (or 96" if reqd) MP BLACK	315	RO
2 Concealed Overhead Holder/Stop	6-X36 BLACK	622	RF
2 Door Operator	6020 D BLACK	693	NO
1 Threshold	273x3AFG MSES10SS	PE	
1 Gasketing	By Door Manufacturer	00	
2 Sweep	307BPC BLACK POWDER COAT	PE	
2 ElectroLynx Harness	QC-C1500P	MK	
2 eLynx Door Harness	QC-C*** (Length / Type as Required)	MK	
2 Position Switch	DPS-M-BK By Security Vendor	SU	
2 Operator Switch	533	NO	
1 Power Supply	BPS (size & type as required)	SU	

Notes: OUTSIDE OPERATION: DURING NORMAL HOURS PUSHING OUTSIDE PUSH BUTTON UNLOCKS EXIT DEVICES AND ACTIVATES OPERATORS. AFTER HOURS OUTSIDE PUSH BUTTON IS NOT ACTIVE. AUTHORIZED CREDENTIAL IS PRESENTED TO CARD READER (SUPPLIED BY SECURITY VENDOR) WHICH UNLOCKS EXIT DEVICE AND ACTIVATES OPERATOR.
INSIDE OPERATION: PUSHING PUSH BUTTON WILL UNLOCK EXIT AND ACTIVATE OPERATOR. EGRESS IS BY EXIT DEVICE. EMERGENCY ACCESS IS BY KEY. AFTER HOURS THE SECURITY SYSTEM WILL TURN OFF OPERATOR AND ELECTRIC LATCH RETRACTION. THE SECURITY SYSTEM WILL MONITOR EXIT DEVICE REQUEST TO EXIT SWITCHES AND ALARM IF SOMEONE PUSHES ON THE BAR.

Set: 2.0

Doors: 1-100.2, 1-105.1, 1-112.2, 1-150, 1-153, 2-145, 2-148

1 Pivot Set	147 BLACK	622	RF
1 Pivot	EM19 QC-12 BLACK	622	RF
1 Exit Device	DG164 GL SG 59 8804	US20D	SA
1 Electric Strike	9600-LBM 2004M 2005M	630	HS
1 Pull	RM3301-72 (or 96" if reqd) MP BLACK	315	RO
1 Concealed Closer	91N (PH as required) BLACK	693	RF
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Threshold	273x3AFG MSES10SS	PE	
1 Gasketing	By Door Manufacturer	00	
2 Sweep	307BPC BLACK POWDER COAT	PE	
1 ElectroLynx Harness	QC-C1500P	MK	
1 eLynx Door Harness	QC-C*** (Length / Type as Required)	MK	
1 Power Supply	BPS (size & type as required)	SU	

Notes: PROVIDED BY SECURITY VENDOR – 1 PIN/PROX BADGE READER POWER SUPPLY SIZE AS NEEDED. PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK ELECTRIC STRIKE ALLOWING ACCESS. EGRESS IS BY EXIT DEVICE.
EMERGENCY ACCESS BY KEY
PRESENTING AUTHORIZED CREDENTIAL TO INTERIOR CARD READER WILL SHUNT DELAYED EGRESS ALLOWING EGRESS. PUSHING ON DELAYED EGRESS EXIT DEVICE WHICH WILL GO INTO ALARM (CHIME) AT NURSES STATION AND ACTIVATES DELAYED EGRESS FUNCTION WHICH DELAYS PASSAGE FOR 15 SECONDS.

Set: 3.0

Doors: 1-106

1 Continuous Hinge	BLFM_HD1	BLACK	PE
1 Storeroom Lock	DG164 SG 28 10G04 LP BLACK	US20D	SA
1 Electric Strike	1006 2004M 2005M	629	HS
1 Concealed Closer	91N (PH as required) BLACK	693	RF
1 Door Stop	467	Black	RO
1 Threshold	2009APK MSES10	PE	
1 Rain Guard	346C	PE	
1 Sweep	307APK	PE	
1 ElectroLynx Harness	QC-C1500P	MK	
1 Position Switch	DPS-M-BK By Security Vendor	SU	
1 Power Supply	BPS (size & type as required)	SU	
1 Latch Protector	320CL	US32D	RO
1 Gasketing	By Door Manufacturer	00	

Notes: PROVIDED BY SECURITY VENDOR – 1 PIN/PROX BADGE READER POWER SUPPLY SIZE AS NEEDED
PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK ELECTRIC STRIKE ALLOWING ACCESS. FREE EGRESS BY LEVER.

Set: 4.0

Doors: A-100

1 Continuous Hinge	BLFM_HD1	BLACK	PE
1 Institutional Lock	DG163 SG 28 10G17 LP	US20D	SA
1 Concealed Closer	91N (PH as required) BLACK	693	RF
1 Threshold	2009APK MSES10	PE	
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Rain Guard	346C	PE	
1 Sweep	307APK	PE	
1 Position Switch	DPS-M-BK By Security Vendor	SU	
1 Latch Protector	320CL	US32D	RO

Notes:

Set: 5.0

Doors: 1-151, 2-146

6 Hinge (heavy weight)	T4A3786	US26	MK
2 Exit Device	12 SG 43 NB8710	US32	SA
2 Concealed Closer	91N (PH as required)	689	RF
2 Kick Plate	K1050 10" high 4BE CSK	US32	RO
2 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Astragal	S771C	PE	

Set: 6.0

Doors: 1-105, 2-105

3 Hinge (heavy weight)	T4A3786	US26	MK
1 Exit Device	DG164 12 SG 43 8876-24v ETP	US32	SA
1 Concealed Closer	91N (PH as required)	689	RF
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 ElectroLynx Harness	QC-C1500P	MK	
1 eLynx Door Harness	QC-C*** (Length / Type as Required)	MK	
1 Electric Power Transfer	EL-CEPT	SU	
1 Power Supply	BPS (size & type as required)	SU	

Notes: PROVIDED BY SECURITY VENDOR – 1 PIN/PROX BADGE READER POWER SUPPLY SIZE AS NEEDED
PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK EXIT TRIM ALLOWING ACCESS. FREE EGRESS BY EXIT.
OPENING OF DOOR WILL ACTIVATE CHIME (BY SECURITY VENDOR) IN NURSE'S STATION.

Set: 7.0

Doors: 2-122

6 Hinge	H TA2714 x NRP	US26D	MK
2 Flush Bolt	555 (metal) / 557 (wood)	US26D	RO
1 Dust Proof Strike	570	US26D	RO
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
2 Surface Overhead Holder/Stop	10-X36	630	RF
2 Silencer	608	RO	

Set: 7.1

Doors: 2-136

6 Hinge	H TA2714 x NRP	US26D	MK
1 Flush Bolt (automatic- set)	2842/ 2942	US26	RO
1 Dust Proof Strike	570	US26D	RO
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Coordinator	2672 Wear Plates	Black	RO
2 Door Closer	CLP7500	689	NO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	

Set: 8.0

Doors: 1-122

6 Hinge (heavy weight)	T4A3786 NRP	US26	MK
1 Flush Bolt (automatic- set)	2842/ 2942	US26	RO
1 Dust Proof Strike	570	US26D	RO
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Coordinator	2672 Wear Plates	Black	RO
2 Door Closer	UNJ7500	689	NO
2 Kick Plate	K1050 10" high 4BE CSK	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Astragal	S771C	PE	

Set: 10.0

Doors: 1-128, 1-137, 2-128

3 Hinge (heavy weight)	T4A3786 NRP	US26	MK
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Surface Overhead Stop	10-X36	630	RF
3 Silencer	608	RO	

Set: 11.0

Doors: 1-129, 1-130, 2-130

3 Hinge (heavy weight)	T4A3786	US26	MK
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Door Closer	7500	689	NO
1 Kick Plate	K1050 10" high 4BE CSK	US32D	RO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	

Set: 12.0

Doors: 1-127, 1-135, 1-141, 1-142, 2-107, 2-127, 2-130A

3 Hinge (heavy weight)	T4A3786 NRP	US26	MK
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Door Closer	CLP7500	689	NO
1 Kick Plate	K1050 10" high 4BE CSK	US32D	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	

Set: 13.0

Doors: 1-108, 1-108B, 1-114, 1-116, 1-138, 1-139, 1-147, 2-101A, 2-101B, 2-108, 2-108A, 2-108B, 2-114, 2-116, 2-121, 2-121A, 2-129, 2-142

3 Hinge (heavy weight)	T4A3786	US26	MK
1 Office Lock	DG163 SG 28 10G05 LP	US26	SA
1 Door Closer	7500	689	NO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	

Set: 15.0

Doors: 1-101, 1-121, 2-134

3 Hinge (heavy weight)	H T4A3786	US26D	MK
1 Classroom Lock	DG164 SG 10G37 LP	US26	SA
1 Door Closer	7500	689	NO
1 Kick Plate	K1050 10" high 4BE CSK	US32	RO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	

Set: 16.0

Doors: 1-115, 1-148, 2-115, 2-141

3 Hinge (heavy weight)	H T4A3786	US26D	MK
1 Privacy Set	SG 28 10U65 LP	US26	SA
1 Door Closer	7500	689	NO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	

Set: 16.1

Doors: 1-136

6 Hinge (heavy weight)	H T4A3786	US26D	MK
2 Flush Bolt	555 (metal) / 557 (wood)	US26D	RO
1 Dust Proof Strike	570	US26D	RO
1 Fail Secure Electric Lock	DG163 SG 28 10G71-24V LP	US26	SA
1 Surface Overhead Stop	10-X36	630	RF
1 Door Closer	CLP7500	689	NO
2 Kick Plate	K1050 10" high 4BE CSK	US32D	RO
2 Silencer	608	RO	
1 ElectroLynx Harness	QC-C1500P	MK	
1 eLynx Door Harness	QC-C*** (Length / Type as Required)	MK	
1 Electric Power Transfer	EL-CEPT	SU	
2 Position Switch	DPS-M-BK By Security Vendor	SU	
1 Power Supply	BPS (size & type as required)	SU	

Notes: CARD READER BY SECURITY VENDOR. PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK EXIT DEVICE ALLOWING ACCESS. EGRESS IS BY EXIT DEVICE. EMERGENCY ACCESS BY KEY.

Set: 17.0

Doors: 1-102, 1-103, 1-104, 1-109, 1-110, 1-111, 1-117, 1-118, 1-119, 1-124, 1-125, 1-126, 1-131, 1-132, 1-133, 1-144, 1-145, 2-102, 2-103, 2-104, 2-109, 2-110, 2-111, 2-117, 2-118, 2-119, 2-124, 2-125, 2-126, 2-131, 2-132, 2-133, 2-138, 2-139, 2-140

3 Hinge (spring)	1502 HT	US26D	MK
1 Classroom Lock	DG164 SG 10G37 LP	US26	SA
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	
1 Viewer	622VC	CRM	RO

Set: 18.0

Doors: 1-102A, 1-103A, 1-104A, 1-109A, 1-110A, 1-111A, 1-117A, 1-118A, 1-119A, 1-124A, 1-125A, 1-126A, 1-131A, 1-132A, 1-133A, 1-144A, 1-145A, 2-102A, 2-103A, 2-104A, 2-109A, 2-110A, 2-111A, 2-117A, 2-118A, 2-119A, 2-124A, 2-125A, 2-126A, 2-131A, 2-132A, 2-133A, 2-138A, 2-139A, 2-140A

3 Hinge (heavy weight)	H T4A3786	US26D	MK
1 Privacy Set	SG 28 10U65 LP	US26	SA
1 Surface Overhead Stop	10-X36	630	RF
1 Gasketing	P88 (Perforated head & jamb)	PE	

Set: 19.0

Doors: 1-146, 2-143

3 Hinge (heavy weight)	T4A3786	US26	MK
1 Office Lock	DG163 SG 28 10G05 LP	US26	SA
1 Electric Strike	1006 2004M 2005M	629	HS
1 Door Closer	7500	689	NO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	
1 ElectroLynx Harness	QC-C1500P	MK	
1 Power Supply	BPS (size & type as required)	SU	

Notes: PROVIDED BY SECURITY VENDOR – 1 PIN/PROX BADGE READER POWER SUPPLY SIZE AS NEEDED
PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK ELECTRIC STRIKE ALLOWING ACCESS. FREE EGRESS BY LEVER.

Set: 20.0

Doors: 1-140

3 Hinge (heavy weight)	T4A3786	US26	MK
1 Storeroom Lock	DG164 SG 28 10G04 LP	US26	SA
1 Electric Strike	1006 2004M 2005M	629	HS
1 Door Closer	7500	689	NO
1 Kick Plate	K1050 10" high 4BE CSK	US32D	RO
1 Wall/ Floor Stop	409/ 446 as required	US32	RO
1 Gasketing	S88BL (Head & Jambs) (perforated at 6" as required)	PE	
1 Door Bottom	411ANBL	PE	
1 ElectroLynx Harness	QC-C1500P	MK	
1 Power Supply	BPS (size & type as required)	SU	

Notes: PROVIDED BY SECURITY VENDOR – 1 PIN/PROX BADGE READER POWER SUPPLY SIZE AS NEEDED
PRESENTING AUTHORIZED CREDENTIAL TO CARD READER WILL UNLOCK ELECTRIC STRIKE ALLOWING ACCESS. FREE EGRESS BY LEVER.

